Notes–

1. This is the general requirement for the water supply system. Contractor must provide the , schematic diagrams, and other relevant details as per the given drawings and documents.
2. Contractor must coordinate the service with other services and building structure.

LEGEND	DESCRIPTION
	COLD WATER OUT WITH ANGLE VALVE
	HOT WATER OUT WITH ANGLE VALVE
	COLD WATER PPR PIPE
	HOT WATER PPR PIPE WITH INSULATION
	HOT WATER RETURN PPR PIPE WITH INSULATION

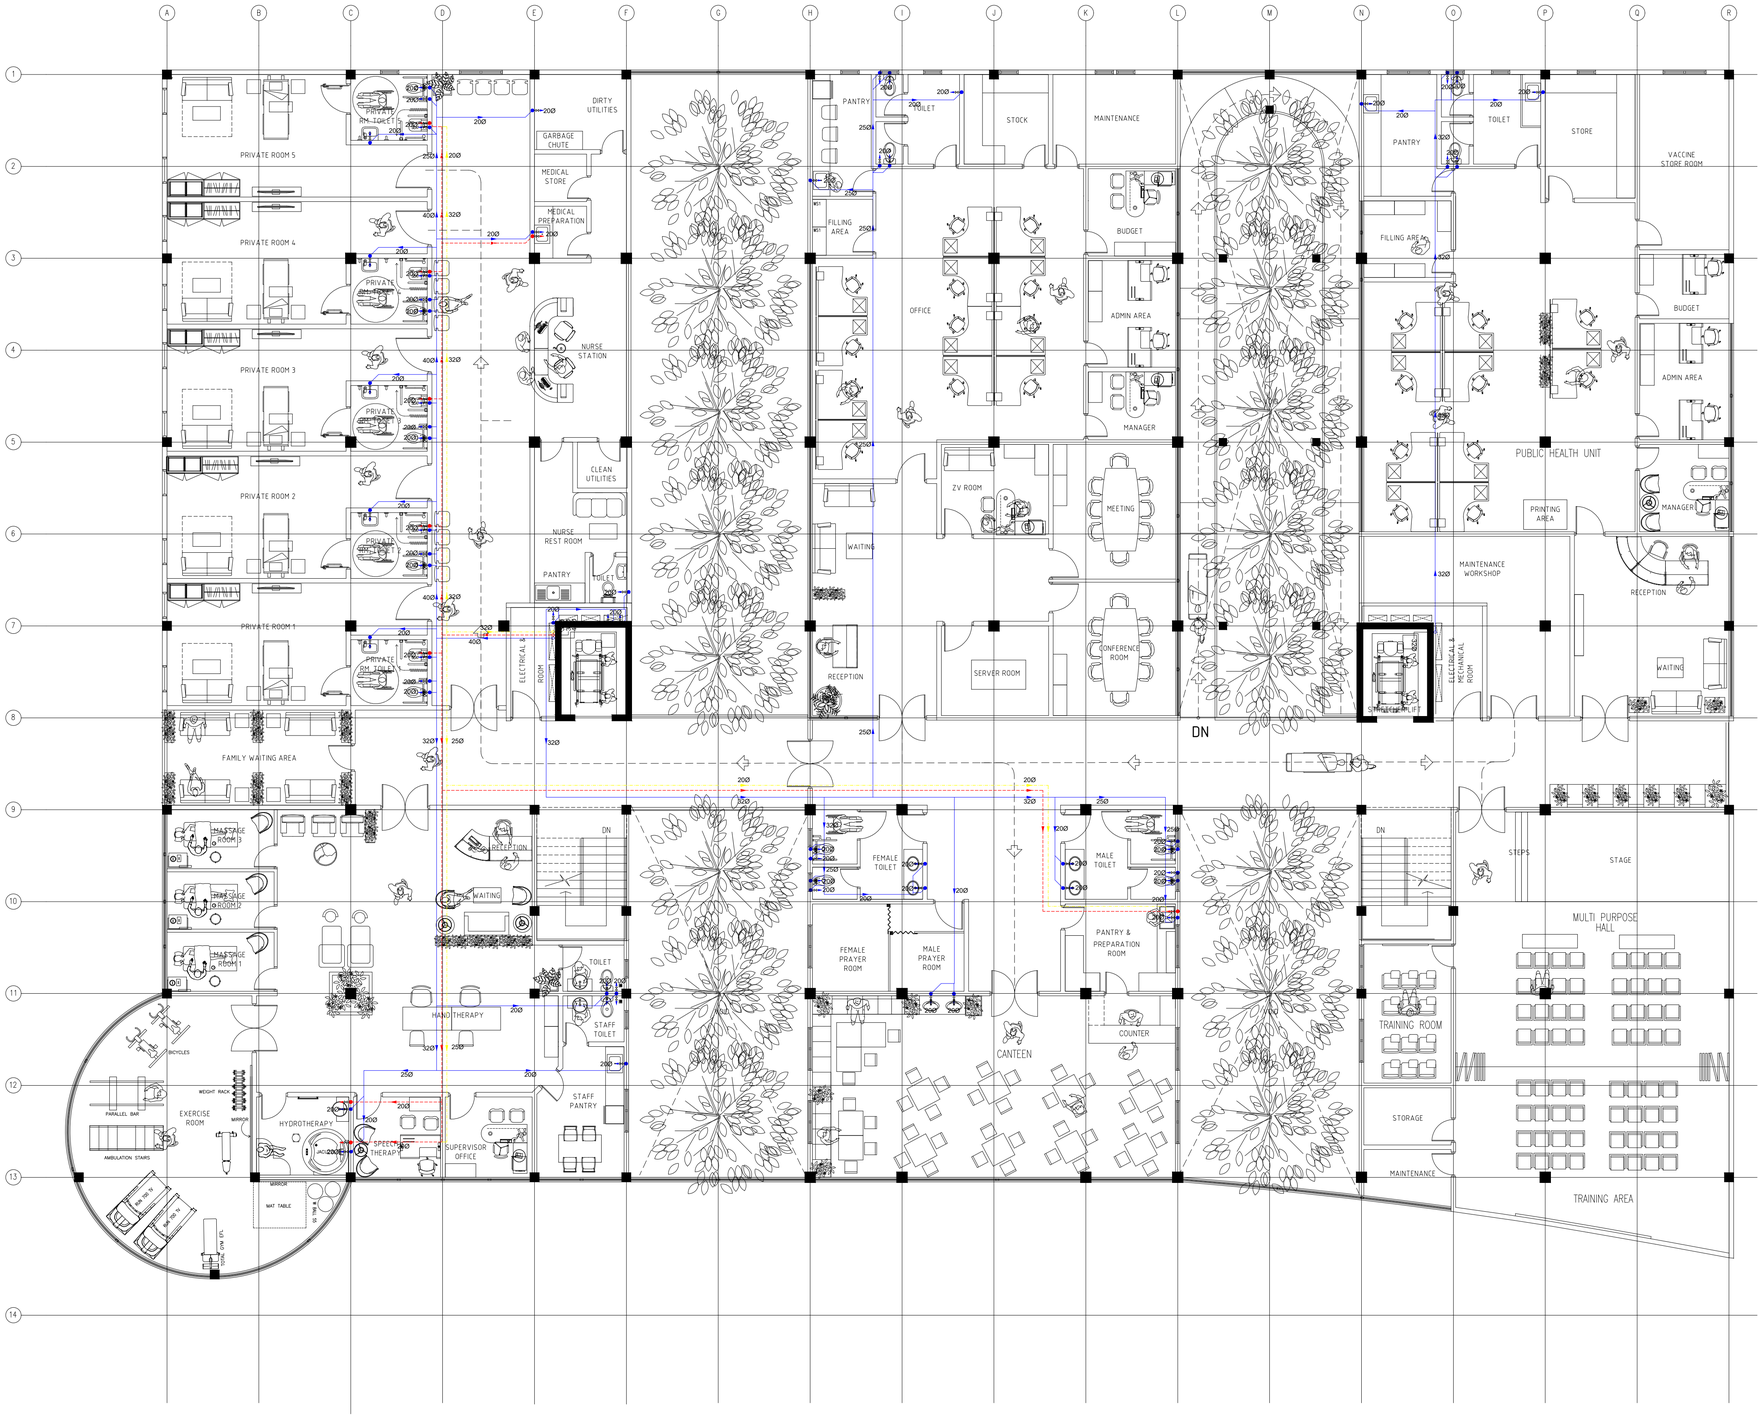

SECOND FLOOR WATER SUPPLY LAYOUT

SCALE 1:100

0m 5m

CLIENT:

DESIGN AND CONSULTANCY:

SIARCH PRIVATE LIMITED
LONUZIYAARAIY MAGU,MALE',20075,MALDIVES
EMAIL: INFO@SIARCH.DESIGN
HTTP://WWW.SIARCH.DESIGN

KEY PLAN:

WARNING:

- This drawing shall not be used for construction unless certified.
- Contractor to verify all dimensions of existing works on site before commencing any work or preparing shop drawings.
- Do not scale drawings, use written dimensions only.
- This drawing is to be read in conjunction with the specifications and conditions of contract.
- This drawing and design is copyright and no portion may be reproduced without the permission of the Consultant

REVISIONS

NO	DESCRIPTION	DATE

PROJECT:

PROPOSED 3 STOREY HOSPITAL

PHASE:

- (●) CONCEPT DESIGN
- ( ) DESIGN DEVELOPMENT
- ( ) TENDER DOCUMENT
- ( ) FOR CONSTRUCTION
- ( ) AS BUILT DRAWINGS

DESIGNATION	NAME	SIGNATURE
DESIGN BY:	SIARCH PVT LTD	
STR. ENGINEER:		
CHief ARCHITECT:		
CHECKED:		
DRAWN:	SAMPATH	

DWG. NAME:

HOSPITAL PROJECT

SECOND FLOOR WATER SUPPLY LAYOUT

CODE	DATE			DWG. NO:
COM-29	17-03-2021			WS03
FORMAT	A1	A2	A3	
SCALE	1:100	-	-	ISSUE: B

PDF FILE NAME:COM-29_MH_WS03_B