

Ha Kelaa 12 Classroom  
Sen Room and Office  
Building

Architectural Detail Drawings

Ministry of Education, Maldives

Date: Wednesday, March 15, 2023  
Project Number: #Project ID



Sheet Index					
Layout ID	Layout Name	Revision	Issued	Published	Remark
	Sheet Index		<input type="checkbox"/>	<input checked="" type="checkbox"/>	
A.01	Cover Page		<input type="checkbox"/>	<input checked="" type="checkbox"/>	
A.02.1	Sections X-X and Y-Y		<input type="checkbox"/>	<input checked="" type="checkbox"/>	
A.02.1	Site		<input type="checkbox"/>	<input checked="" type="checkbox"/>	
A.03.1	Ground Floor Plan		<input type="checkbox"/>	<input checked="" type="checkbox"/>	
A.03.2	First Floor Plan		<input type="checkbox"/>	<input checked="" type="checkbox"/>	
A.03.3	Second Floor Plan		<input type="checkbox"/>	<input checked="" type="checkbox"/>	
A.03.4	Roof Plan		<input type="checkbox"/>	<input checked="" type="checkbox"/>	
A.05.1	All Openings Schedule		<input type="checkbox"/>	<input checked="" type="checkbox"/>	
A.05.1	Elevation E1 & E2		<input type="checkbox"/>	<input checked="" type="checkbox"/>	
A.05.2	Elevation E3 and E4		<input type="checkbox"/>	<input checked="" type="checkbox"/>	
A.05.2	Ventilation Schedule		<input type="checkbox"/>	<input checked="" type="checkbox"/>	
B.01.1	General Notes 1		<input type="checkbox"/>	<input checked="" type="checkbox"/>	
B.01.2	General Notes 2		<input type="checkbox"/>	<input checked="" type="checkbox"/>	
B.01.3	General Notes 3		<input type="checkbox"/>	<input checked="" type="checkbox"/>	
B.01.4	Column Setting out & Foundation...		<input type="checkbox"/>	<input checked="" type="checkbox"/>	
B.02.1	First to Second Floor Beam & Sla...		<input type="checkbox"/>	<input checked="" type="checkbox"/>	
B.02.2	Roof Beam Level 1&2		<input type="checkbox"/>	<input checked="" type="checkbox"/>	
B.02.3	Roof Truss & Framing Plan		<input type="checkbox"/>	<input checked="" type="checkbox"/>	
C.01.1	Structural Details-1		<input type="checkbox"/>	<input checked="" type="checkbox"/>	
C.01.2	Wall & Window Construction Detail		<input type="checkbox"/>	<input checked="" type="checkbox"/>	
C.01.3	Top to Bottom Detail		<input type="checkbox"/>	<input checked="" type="checkbox"/>	
C.01.4	Top to Bottom Detail 2		<input type="checkbox"/>	<input checked="" type="checkbox"/>	
C.01.5	Balcony, Stair & Ramp Details		<input type="checkbox"/>	<input checked="" type="checkbox"/>	
C.01.6	Truss Detail		<input type="checkbox"/>	<input checked="" type="checkbox"/>	
C.01.7	Toilet Details 1		<input type="checkbox"/>	<input checked="" type="checkbox"/>	

Ha Kelaa 12

REBUILDING AT

Classroom Sen  
Room and Office  
Building

Client:  
Ministry of Education,  
Maldives

3/15/2023

Architect: Fathmath Ihudha Amir  
Engineer: Ihsaan Waheed  
Drawn By: Fathmath Ihudha Amir




EPOCH


T: +960 333 3528 E: info@epoch.associates  
W: www.epoch.associates, A. M. Ahigasdhoshuge,  
Fareedhee Magu Male' Republic of Maldives

Rev:  
---  
---


Page:  
---

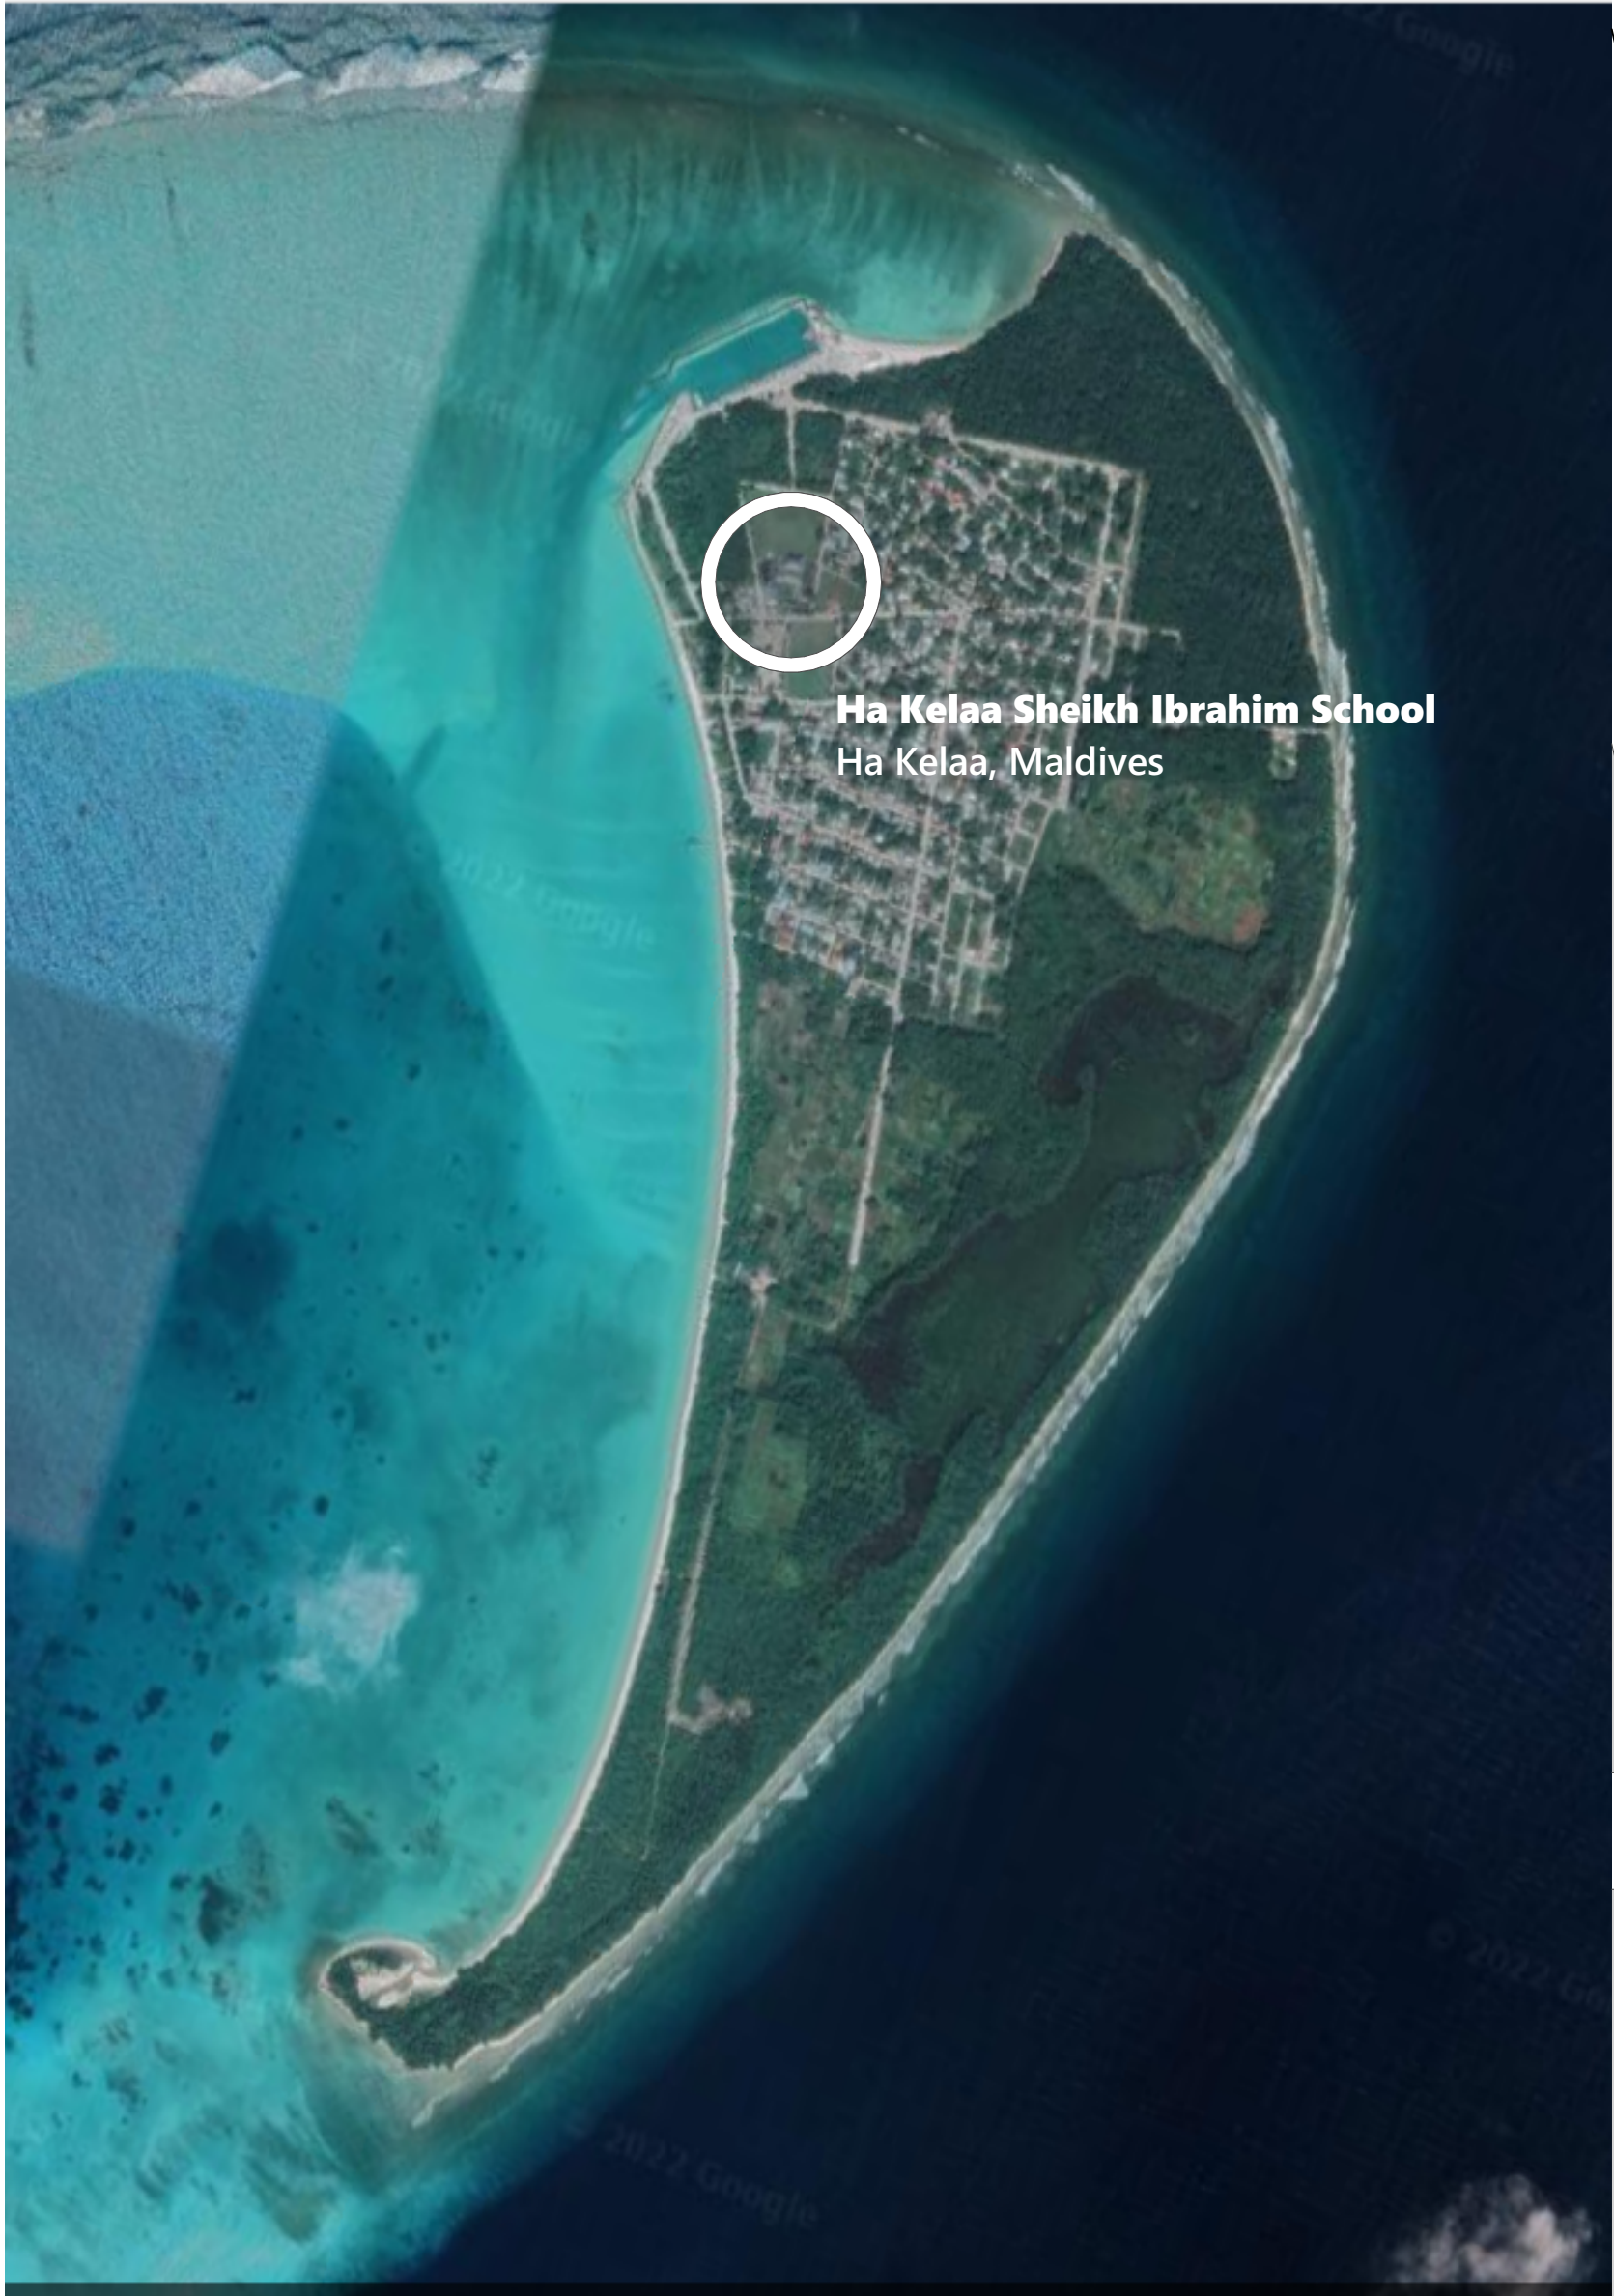


Location Plan

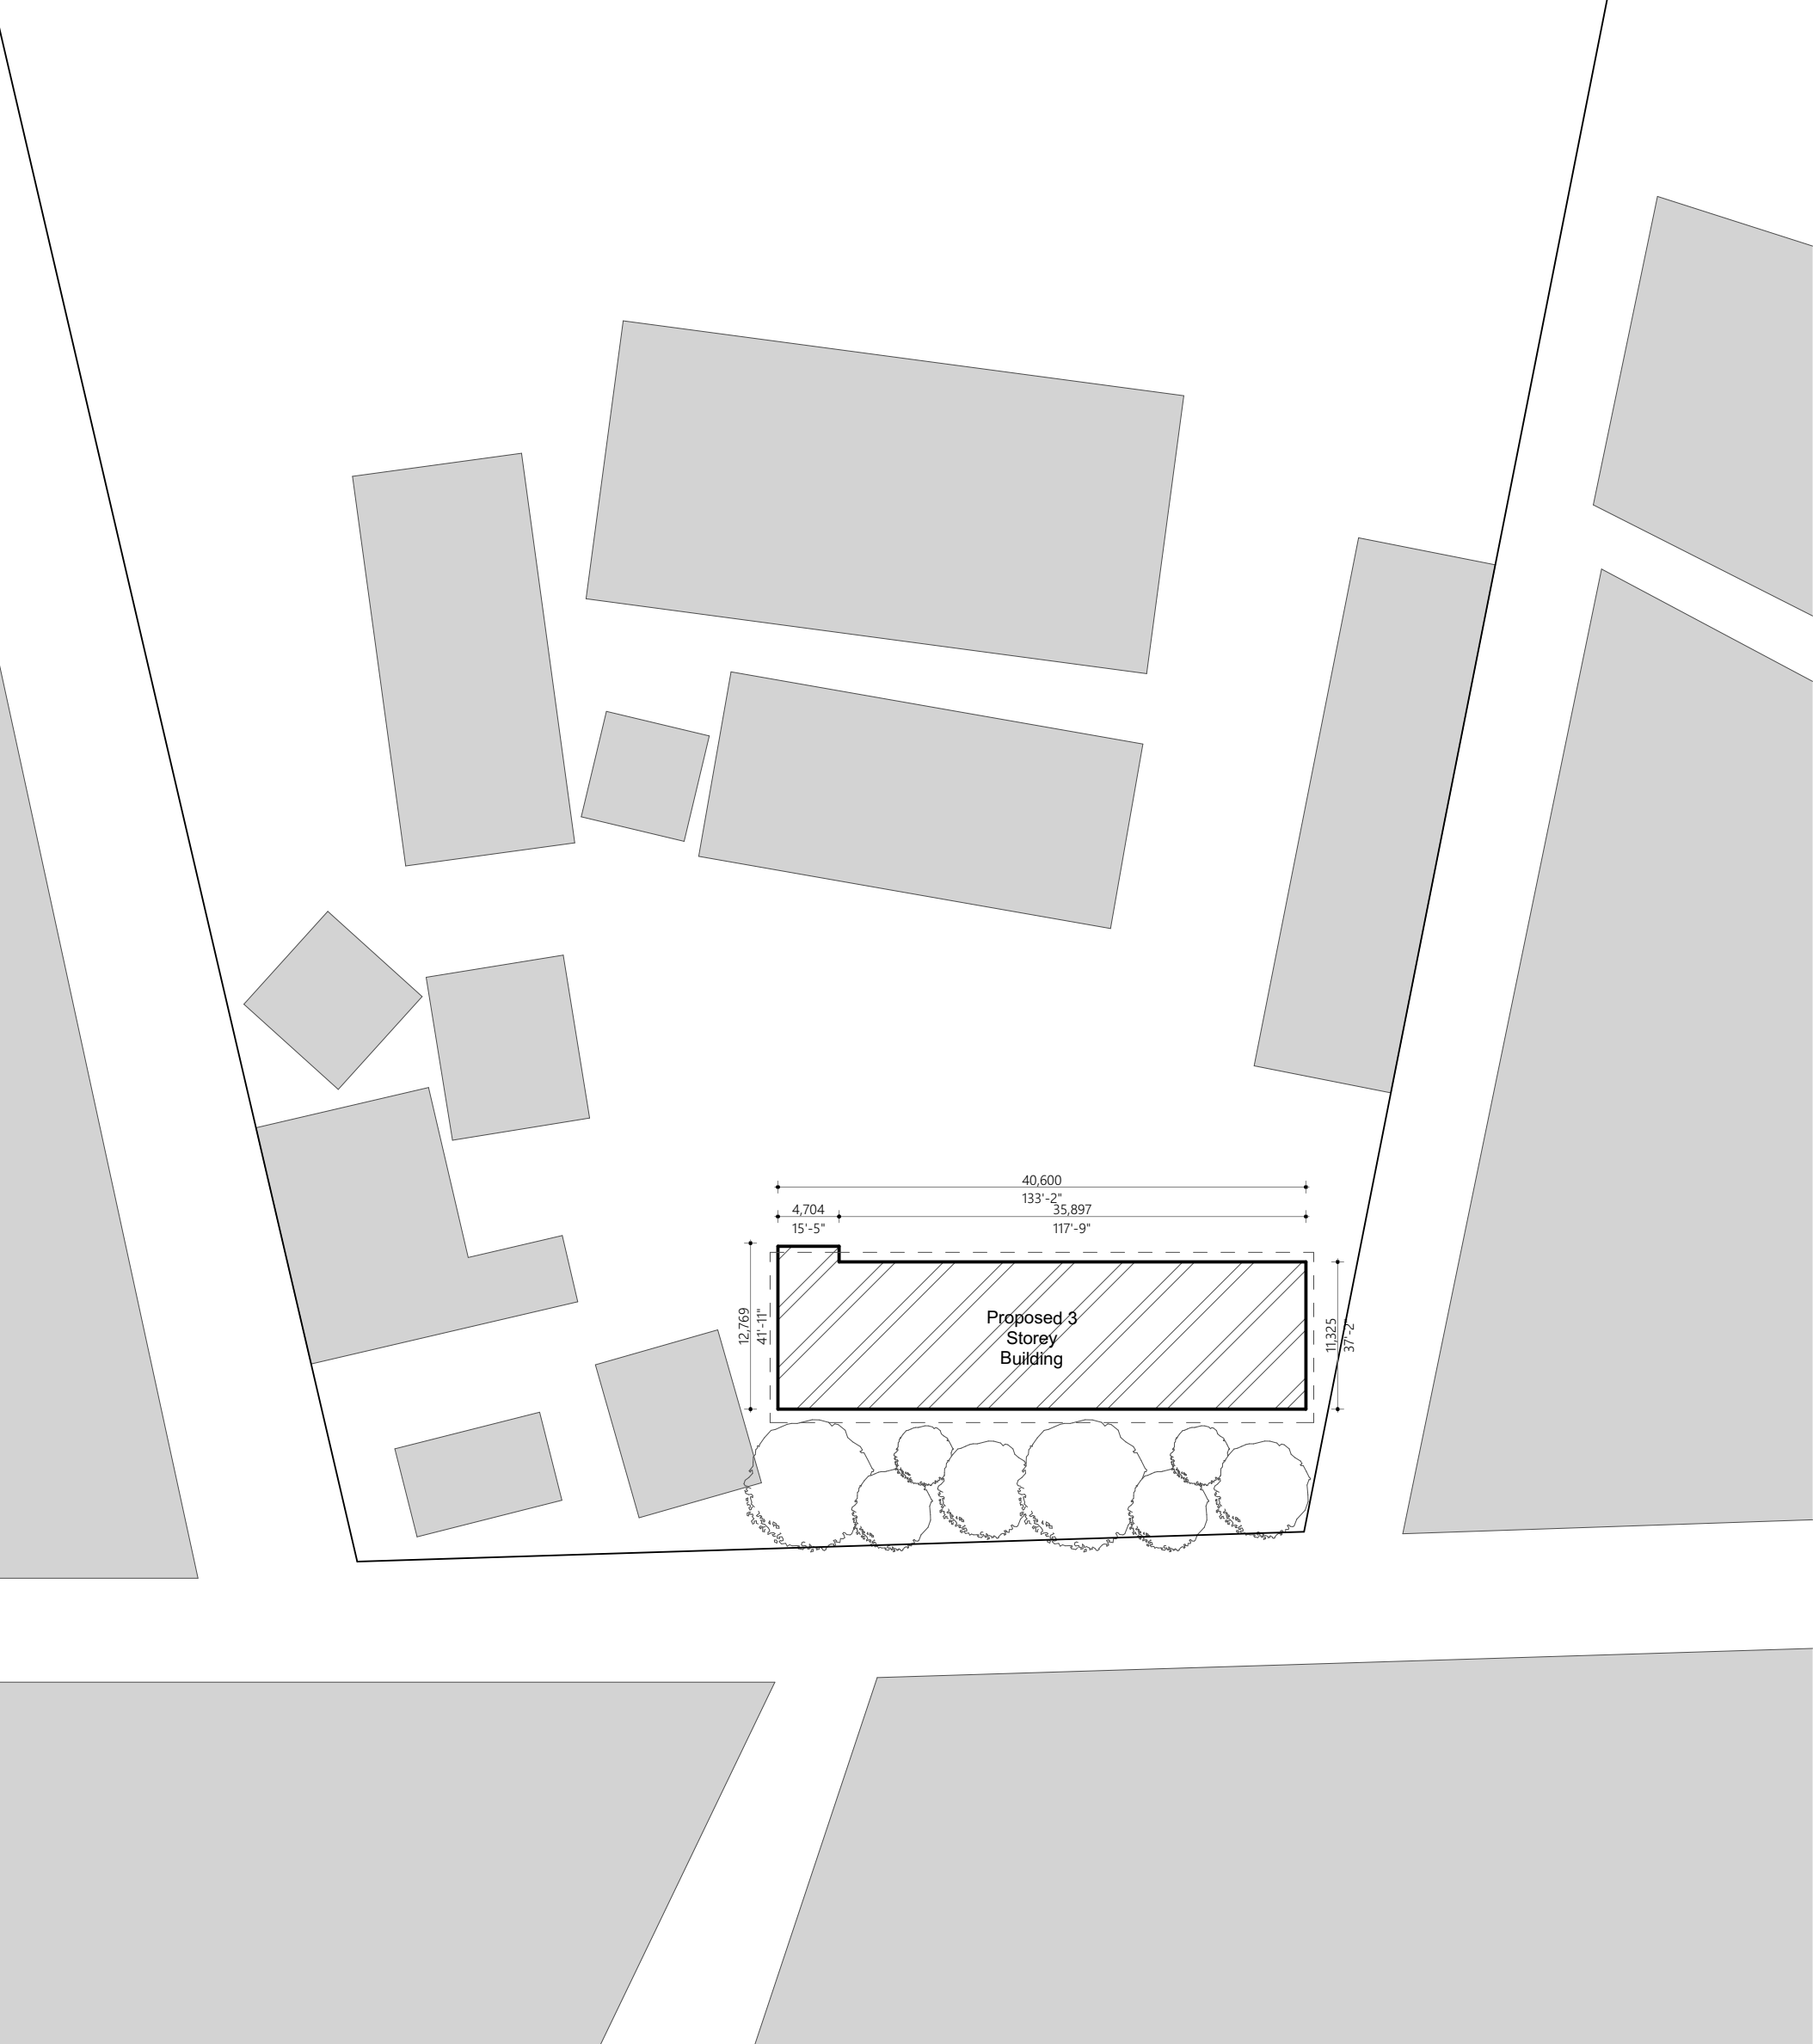

Site Plan (source: google map)  
1:500



Overview :



Legend :

Notes :

#	REVISION	BY	APP	DATE

**Project :**  
Ha Kelaa 12 Classroom Sen  
Room and Office Building

**Client :**  
Ministry of Education, Maldives

**Prepared by**  


T: +960 333 3528, E: info@epochassociates,  
W: www.epochassociates, A/G Rosary West, 3<sup>rd</sup>  
Floor, Husnuheena Magu, Male', Maldives

DESIGNER: Muaviyath A. Sathar	CHECKED: F. Ihudha Amir
DRAWN: Mohamed Hassan	APPROVED: Ihsaan Waheed


**Page Title**  
Site

**Scale :** 1:500


**Doc No :** EP/BLD-AR/2022/08/AR-104  
**Date :** Wednesday, March 15,  
2023

**Rev No :** **Pg :** A.02.1



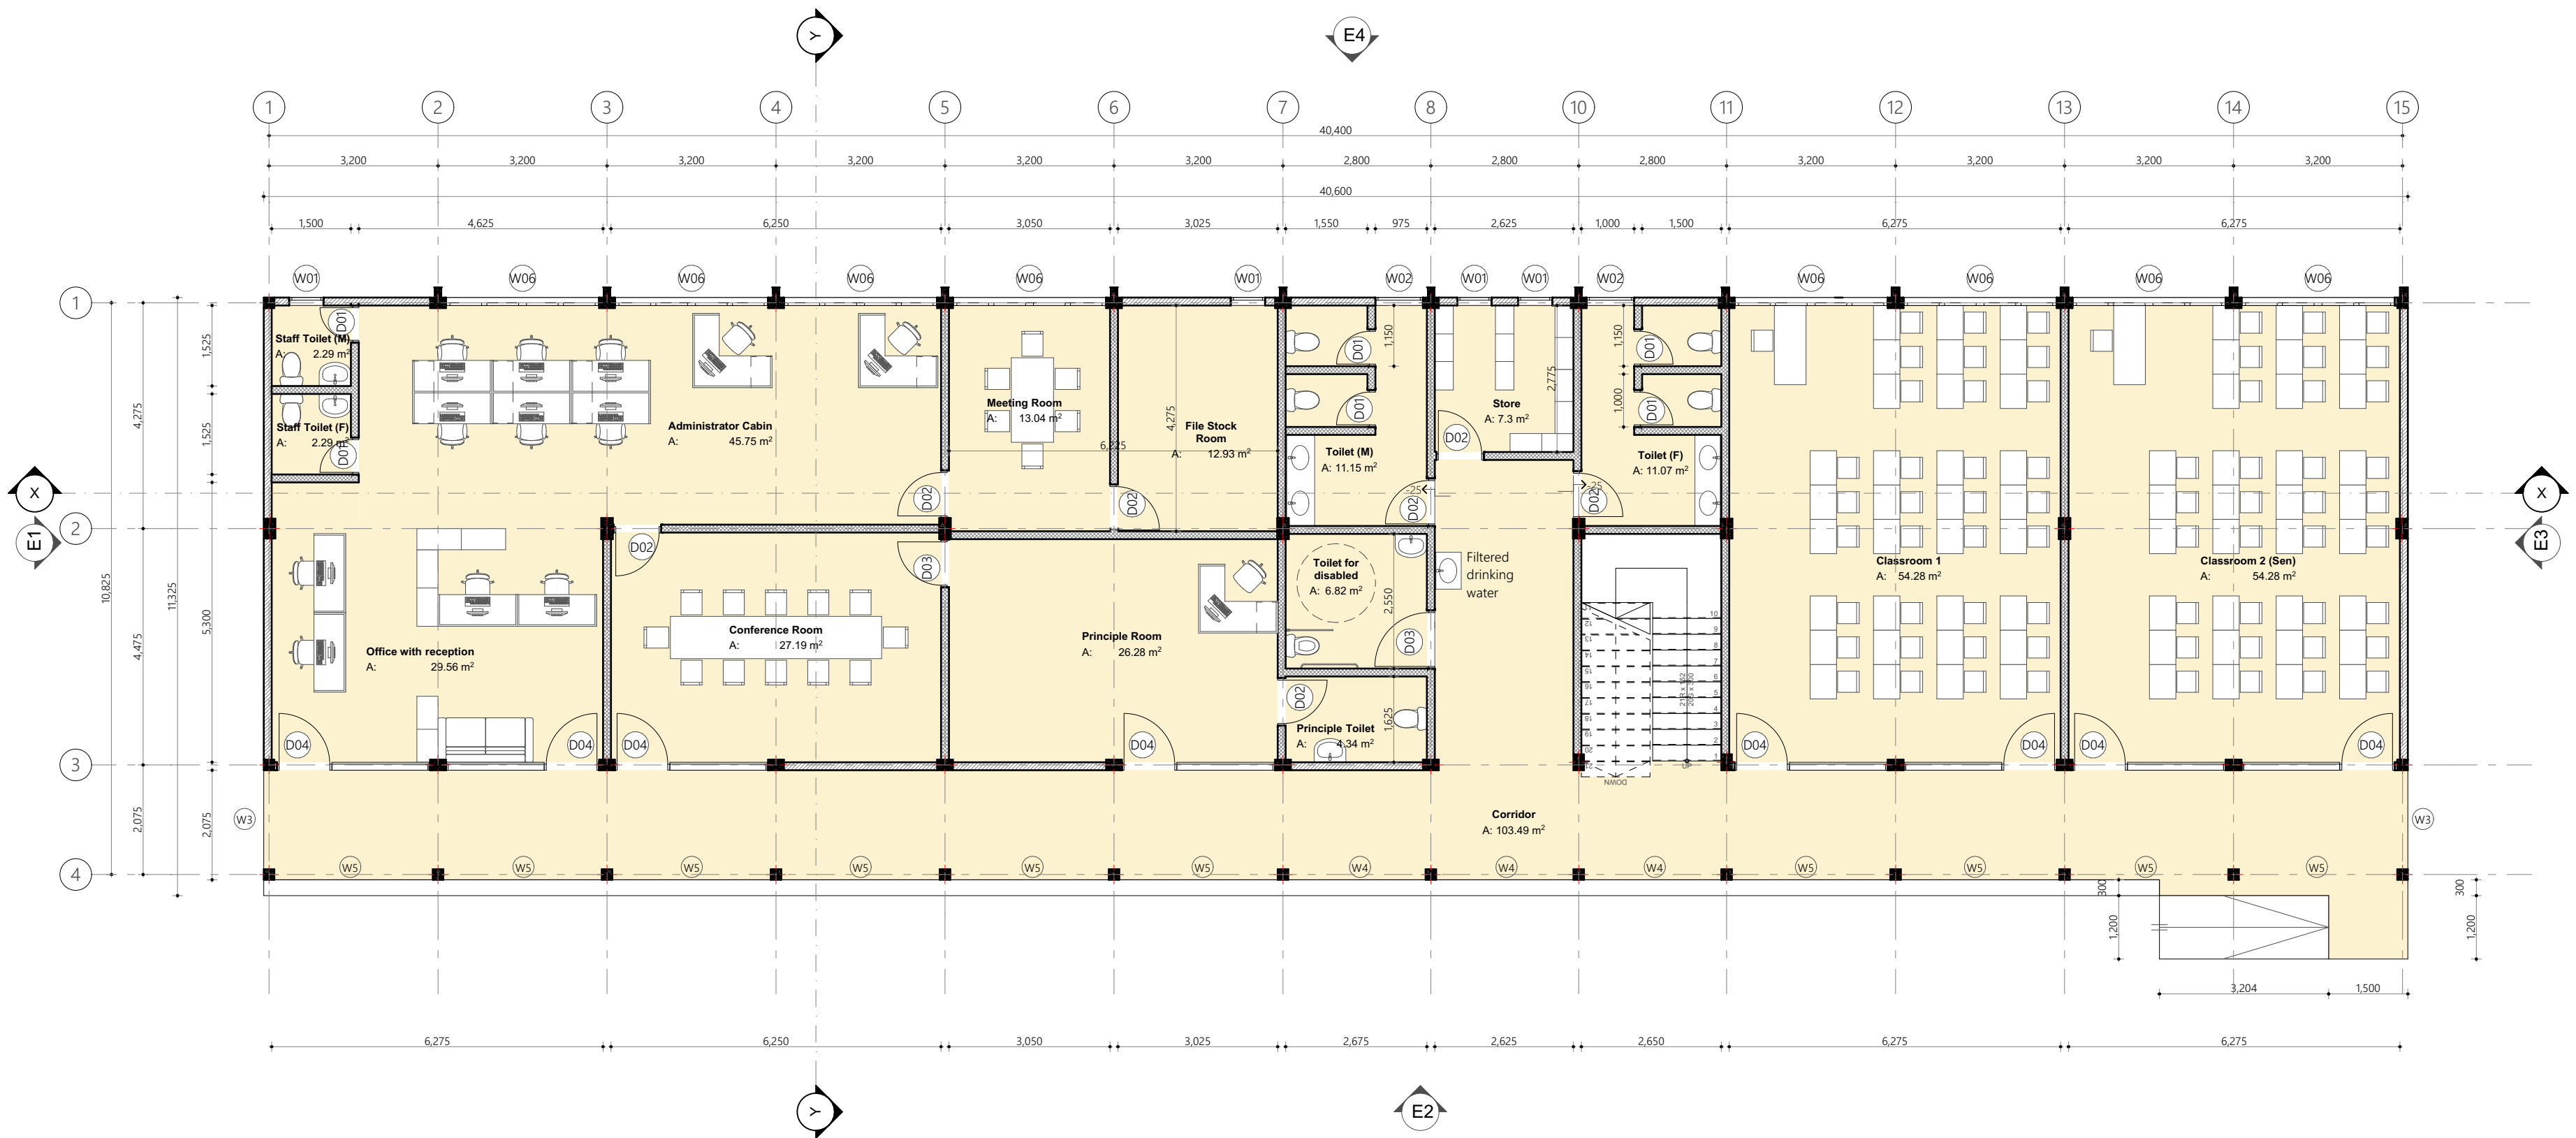

Overview :



Legend :

Notes :

Wall Legend	
2D Plan Preview	Description
	100mm thick reinforced concrete wall per engineers detail, waterproofed with waterproofing agent
	150mm thick solid masonry block exterior wall with 25mm plaster on exterior and 16mm plaster on interior finished with smoothed putty and semi gloss white paint
	150mm thick solid masonry block interior wall with 16mm plaster on both sides finished with smoothed putty and semi gloss white paint

Zone schedule							
Home Story	Zone Name	Area (sqm)	Floor Level	Floor Finishes	Ceiling Level	Ceiling Finishes	Wall Finishes
Ground Floor	Administrator Cabin	45.75	+350	600mm X 600mm Homogenous non-skid tiles on 50mm screed	+3400	Exposed slab soffit to be ground smooth in select paint finish	16mm plaster, applied with ground smooth finished with selected paint
Ground Floor	Classroom 1	54.28	+350	600mm X 600mm Homogenous non-skid tiles on 50mm screed	+3400	Exposed slab soffit to be ground smooth in select paint finish	16mm plaster, applied with ground smooth finished with selected paint
Ground Floor	Classroom 2 (Sen)	54.28	+350	600mm X 600mm Homogenous non-skid tiles on 50mm screed	+3400	Exposed slab soffit to be ground smooth in select paint finish	16mm plaster, applied with ground smooth finished with selected paint
Ground Floor	Conference Room	27.19	+350	600mm X 600mm Homogenous non-skid tiles on 50mm screed	+3400	Exposed slab soffit to be ground smooth in select paint finish	16mm plaster, applied with ground smooth finished with selected paint
Ground Floor	Corridor	103.49	+325	600x600mm homogenous non-skid tiles on 35mm screed	+3400	Exposed slab soffit to be ground smooth in selected paint finish	16mm Plastering, ground smooth in selected paint finish
Ground Floor	File Stock Room	12.93	+350	600mm X 600mm Homogenous non-skid tiles on 50mm screed	+3400	Exposed slab soffit to be ground smooth in select paint finish	16mm plaster, applied with ground smooth finished with selected paint
Ground Floor	Meeting Room	13.04	+350	600mm X 600mm Homogenous non-skid tiles on 50mm screed	+3400	Exposed slab soffit to be ground smooth in select paint finish	16mm plaster, applied with ground smooth finished with selected paint
Ground Floor	Office with reception	29.56	+350	600mm X 600mm Homogenous non-skid tiles on 50mm screed	+3400	Exposed slab soffit to be ground smooth in select paint finish	16mm plaster, applied with ground smooth finished with selected paint
Ground Floor	Principle Room	26.28	+350	600mm X 600mm Homogenous non-skid tiles on 50mm screed	+3400	Exposed slab soffit to be ground smooth in select paint finish	16mm plaster, applied with ground smooth finished with selected paint
Ground Floor	Principle Toilet	4.34	+350	600mm X 600mm Homogenous non-skid tiles on 50mm screed	+3400	Exposed slab soffit to be ground smooth in select paint finish	16mm plaster, applied with ground smooth finished with selected paint
Ground Floor	Staff Toilet (F)	2.29	+325	300mm X 300mm Homogenous non-slip tiles over 50mm screeding	+3050	Cement board ceiling to be ground smooth in select paint finish	300mm X 600mm Homogenous wall tiles
Ground Floor	Staff Toilet (M)	2.29	+325	300mm X 300mm Homogenous non-slip tiles over 50mm screeding	+3050	Cement board ceiling to be ground smooth in select paint finish	300mm X 600mm Homogenous wall tiles
Ground Floor	Store	7.30	+350	600mm X 600mm Homogenous non-skid tiles on 50mm screed	+3050	Exposed slab soffit to be ground smooth in select paint finish	16mm plaster, applied with ground smooth finished with selected paint
Ground Floor	Toilet (F)	11.07	+300	300mm X 300mm Homogenous non-slip tiles over 50mm screeding	+3050	Cement board ceiling to be ground smooth in select paint finish	300mm X 600mm Homogenous wall tiles
Ground Floor	Toilet (M)	11.15	+300	300mm X 300mm Homogenous non-slip tiles over 50mm screeding	+3050	Cement board ceiling to be ground smooth in select paint finish	300mm X 600mm Homogenous wall tiles
Ground Floor	Toilet for disabled	6.82	+325	300mm X 300mm Homogenous non-slip tiles over 50mm screeding	+3050	Cement board ceiling to be ground smooth in select paint finish	300mm X 600mm Homogenous wall tiles
First Floor	Classroom 3	54.28	+3550	600mm X 600mm Homogenous non-skid tiles on 50mm screed	+6600	Exposed slab soffit to be ground smooth in select paint finish	16mm plaster, applied with ground smooth finished with selected paint

Note: All heights are taken from Natural Ground Level +00

Ground Floor  
1:100

#	REVISION	BY	APP	DATE	

Project :

Ha Kelaa 12 Classroom Sen  
Room and Office Building

Client :

Ministry of Education, Maldives

Prepared by



T: +960 333 3528, E: info@epochassociates,  
W: www.epochassociates, A: G.Rosary West, 3<sup>rd</sup>  
Floor, Husnuheena Magu, Male', Maldives

DESIGNER: Muaviyath A. Sathar	CHECKED: F. Ihudha Amir
DRAWN: Mohamed Hassaan	APPROVED: Ihsaan Waheed

Page Title

Ground Floor Plan

Scale : 1:100, 1:1

Doc No : EP/BLD-AR/2022/08/AR-104

Date : Wednesday, March 15,


2023

Rev No :

Pg : A.03.1



Overview :



Legend :

Notes :

First Floor  
1:100

Wall Legend	
2D Plan Preview	Description
	100mm thick reinforced concrete wall per engineers detail, waterproofed with waterproofing agent
	150mm thick solid masonry block exterior wall with 25mm plaster on exterior and 16mm plaster on interior finished with smoothed putty and semi gloss white paint
	150mm thick solid masonry block interior wall with 16mm plaster on both sides finished with smoothed putty and semi gloss white paint

Zone schedule							
Home Story	Zone Name	Area (sqm)	Floor Level	Floor Finishes	Ceiling Level	Ceiling Finishes	Wall Finishes
First Floor	Classroom 4	54.28	+3550	600mm X 600mm Homogenous non-skid tiles on 50mm screed	+6600	Exposed slab soffit to be ground smooth in select paint finish	16mm plaster, applied with ground smooth finished with selected paint
First Floor	Classroom 5	54.28	+3550	600mm X 600mm Homogenous non-skid tiles on 50mm screed	+6600	Exposed slab soffit to be ground smooth in select paint finish	16mm plaster, applied with ground smooth finished with selected paint
First Floor	Classroom 6	54.28	+3550	600mm X 600mm Homogenous non-skid tiles on 50mm screed	+6600	Exposed slab soffit to be ground smooth in select paint finish	16mm plaster, applied with ground smooth finished with selected paint
First Floor	Classroom 7	54.28	+3550	600mm X 600mm Homogenous non-skid tiles on 50mm screed	+6600	Exposed slab soffit to be ground smooth in select paint finish	16mm plaster, applied with ground smooth finished with selected paint
First Floor	Cleaner closet	2.79	+3550	600mm X 600mm Homogenous non-skid tiles on 50mm screed	+6600	Exposed slab soffit to be ground smooth in select paint finish	16mm plaster, applied with ground smooth finished with selected paint
First Floor	Corridor	101.02	+3525	600x600mm homogenous non-skid tiles on 35mm screed	+6600	Cement board ceiling to be ground smooth in selected paint finish	16mm Plastering, ground smooth in selected paint finish
First Floor	File Stock/ Marking Room	8.37	+3550	600mm X 600mm Homogenous non-skid tiles on 50mm screed	+6600	Exposed slab soffit to be ground smooth in select paint finish	16mm plaster, applied with ground smooth finished with selected paint
First Floor	Store	7.30	+3550	600mm X 600mm Homogenous non-skid tiles on 50mm screed	+6600	Exposed slab soffit to be ground smooth in select paint finish	16mm plaster, applied with ground smooth finished with selected paint
First Floor	Toilet (F)	11.07	+3500	300mm X 300mm Homogenous non-slip tiles over 50mm screeding	+6250	Cement board ceiling to be ground smooth in select paint finish	300mm X 600mm Homogenous wall tiles
First Floor	Toilet (M)	11.15	+3500	300mm X 300mm Homogenous non-slip tiles over 50mm screeding	+6250	Cement board ceiling to be ground smooth in select paint finish	300mm X 600mm Homogenous wall tiles

Note: All heights are taken from Natural Ground Level +00

#	REVISION	BY	APP	DATE

Project :

Ha Kelaa 12 Classroom Sen  
Room and Office Building

Client :

Ministry of Education, Maldives

Prepared by



T: +960 333 3528, E: info@epochassociates,  
W: www.epochassociates, A: G.Rosary West, 3<sup>rd</sup>  
Floor, Husnuheena Magu, Male', Maldives

DESIGNER: Muaviyath A. Sathar	CHECKED: F. Ihudha Amir
DRAWN: Mohamed Hassan	APPROVED: Ihsaan Waheed

Page Title

First Floor Plan

Scale : 1:100, 1:1

Doc No : EP/BLD-AR/2022/08/AR-104  
Date : Wednesday, March 15,  
2023

Rev No :

Pg : A.03.2




Second Floor  
1:100

Wall Legend	
2D Plan Preview	Description
	100mm thick reinforced concrete wall per engineers detail, waterproofed with waterproofing agent
	150mm thick solid masonry block exterior wall with 25mm plaster on exterior and 16mm plaster on interior finished with smoothed putty and semi gloss white paint
	150mm thick solid masonry block interior wall with 16mm plaster on both sides finished with smoothed putty and semi gloss white paint

Zone schedule							
Home Story	Zone Name	Area (sqm)	Floor Level	Floor Finishes	Ceiling Level	Ceiling Finishes	Wall Finishes
Second Floor	Classroom 10	53.84	+6730	600mm X 600mm Homogenous non-skid tiles on 50mm screed	+9600	Gypsum board with timber frames	16mm plaster, applied with ground smooth finished with selected paint
Second Floor	Classroom 11	54.28	+6730	600mm X 600mm Homogenous non-skid tiles on 50mm screed	+9600	Gypsum board with timber frames	16mm plaster, applied with ground smooth finished with selected paint
Second Floor	Classroom 12	54.28	+6730	600mm X 600mm Homogenous non-skid tiles on 50mm screed	+9600	Gypsum board with timber frames	16mm plaster, applied with ground smooth finished with selected paint
Second Floor	Classroom 8	53.84	+6730	600mm X 600mm Homogenous non-skid tiles on 50mm screed	+9600	Gypsum board with timber frames	16mm plaster, applied with ground smooth finished with selected paint
Second Floor	Classroom 9	53.84	+6730	600mm X 600mm Homogenous non-skid tiles on 50mm screed	+9600	Gypsum board with timber frames	16mm plaster, applied with ground smooth finished with selected paint
Second Floor	Cleaner closet	2.79	+3550	600mm X 600mm Homogenous non-skid tiles on 50mm screed	+6600	Exposed slab soffit to be ground smooth in select paint finish	16mm plaster, applied with ground smooth finished with selected paint
Second Floor	Corridor	101.02	+6725	600x600mm homogenous non-skid tiles on 35mm screed	+9600	Cement board ceiling to be ground smooth in selected paint finish	16mm Plastering, ground smooth in selected paint finish
Second Floor	File Stock/ Marking Room	8.37	+3550	600mm X 600mm Homogenous non-skid tiles on 50mm screed	+6600	Exposed slab soffit to be ground smooth in select paint finish	16mm plaster, applied with ground smooth finished with selected paint
Second Floor	Store	7.30	+6730	600mm X 600mm Homogenous non-skid tiles on 50mm screed	+9600	Cement board ceiling to be ground smooth in select paint finish	16mm plaster, applied with ground smooth finished with selected paint
Second Floor	Toilet (F)	11.07	+6700	300mm X 300mm Homogenous non-slip tiles over 50mm screeding	+9600	Cement board ceiling to be ground smooth in select paint finish	300mm X 600mm Homogenous wall tiles

Note: All heights are taken from Natural Ground Level +00

Overview :



Legend :

Notes :

#	REVISION	BY	APP	DATE

Project :

Ha Kelaa 12 Classroom Sen  
Room and Office Building

Client :

Ministry of Education, Maldives

Prepared by



T: +960 333 3528, E: info@epochassociates,  
W: www.epochassociates, A/G: Rosary West, 3<sup>rd</sup>  
Floor, Husnuheena Magu, Male', Maldives

DESIGNER: Muaviyath A. Sathar	CHECKED: F. Ihudha Amir
DRAWN: Mohamed Hassan	APPROVED: Ihsaan Waheed

Page Title

Second Floor Plan

Scale : 1:1, 1:100


Doc No : EP/BLD-AR/2022/08/AR-104

Date : Wednesday, March 15,

2023


Rev No :

Pg : A.03.3

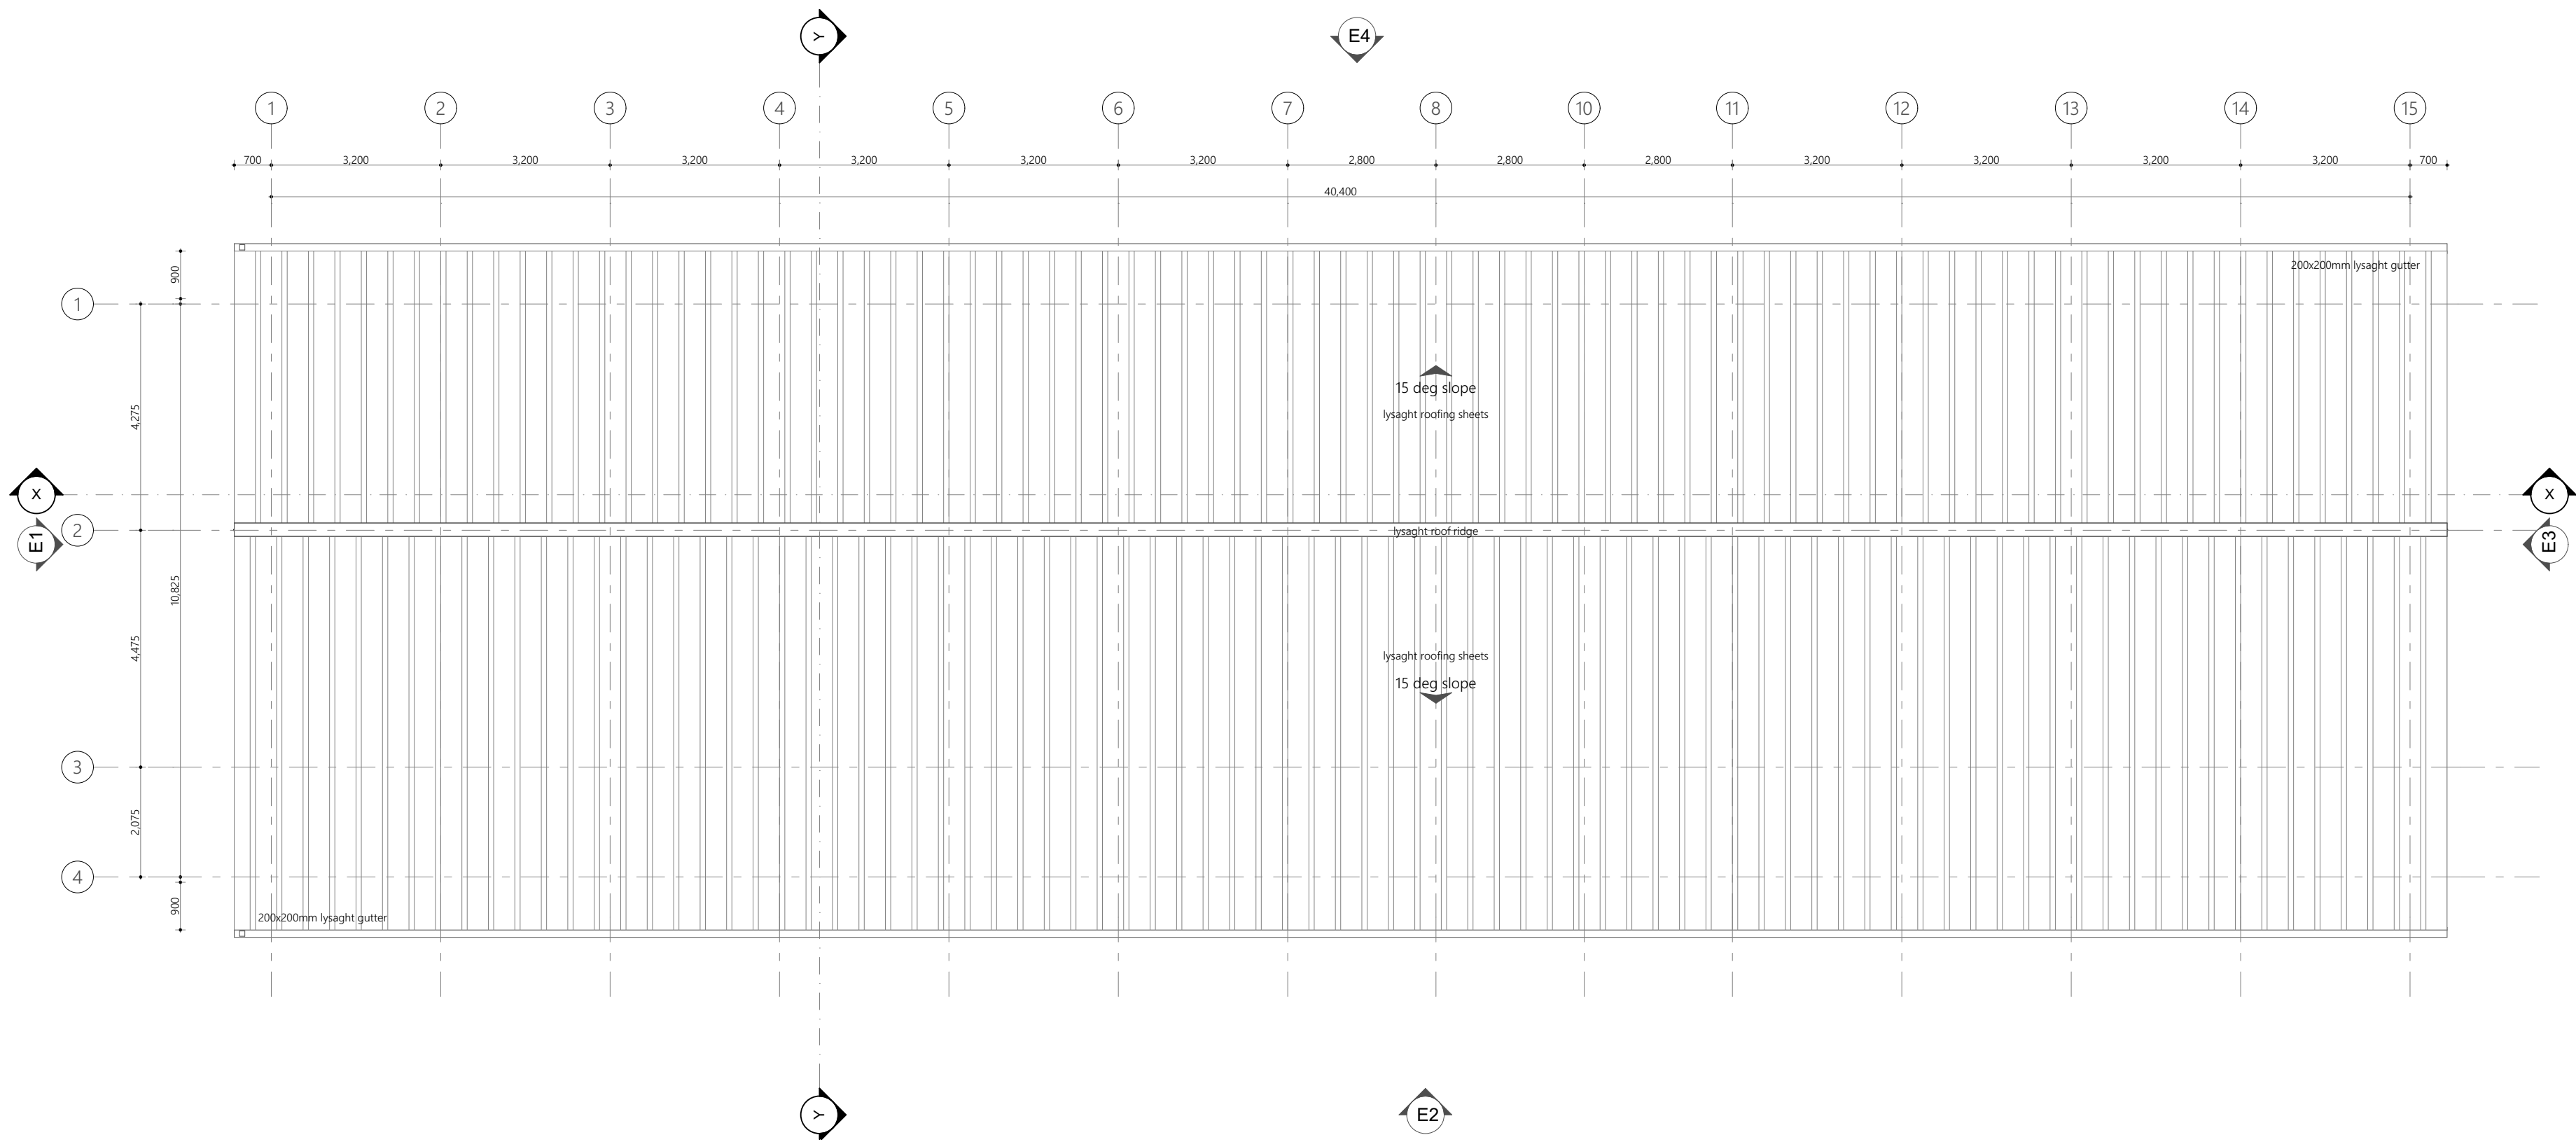

Roof Plan  
1:100

Overview :



Legend :

Notes :

#	REVISION	BY	APP	DATE

**Project :**  
Ha Kelaa 12 Classroom Sen  
Room and Office Building

**Client :**  
Ministry of Education, Maldives

**Prepared by**



T: +960 333 3528, E: info@epochassociates,  
W: www.epochassociates, A/G Rosary West, 3<sup>rd</sup>  
Floor, Husnuheena Magu, Male', Maldives

DESIGNER: Muaviyath A. Sathar	CHECKED: F. Ihudha Amir
DRAWN: Mohamed Hassan	APPROVED: Ihsaan Waheed


**Page Title**  
Roof Plan

**Scale :** 1:100

**Doc No :** EP/BLD-AR/2022/08/AR-104  
**Date :** Wednesday, March 15,  
2023


**Rev No :** **Pg :** A.03.4



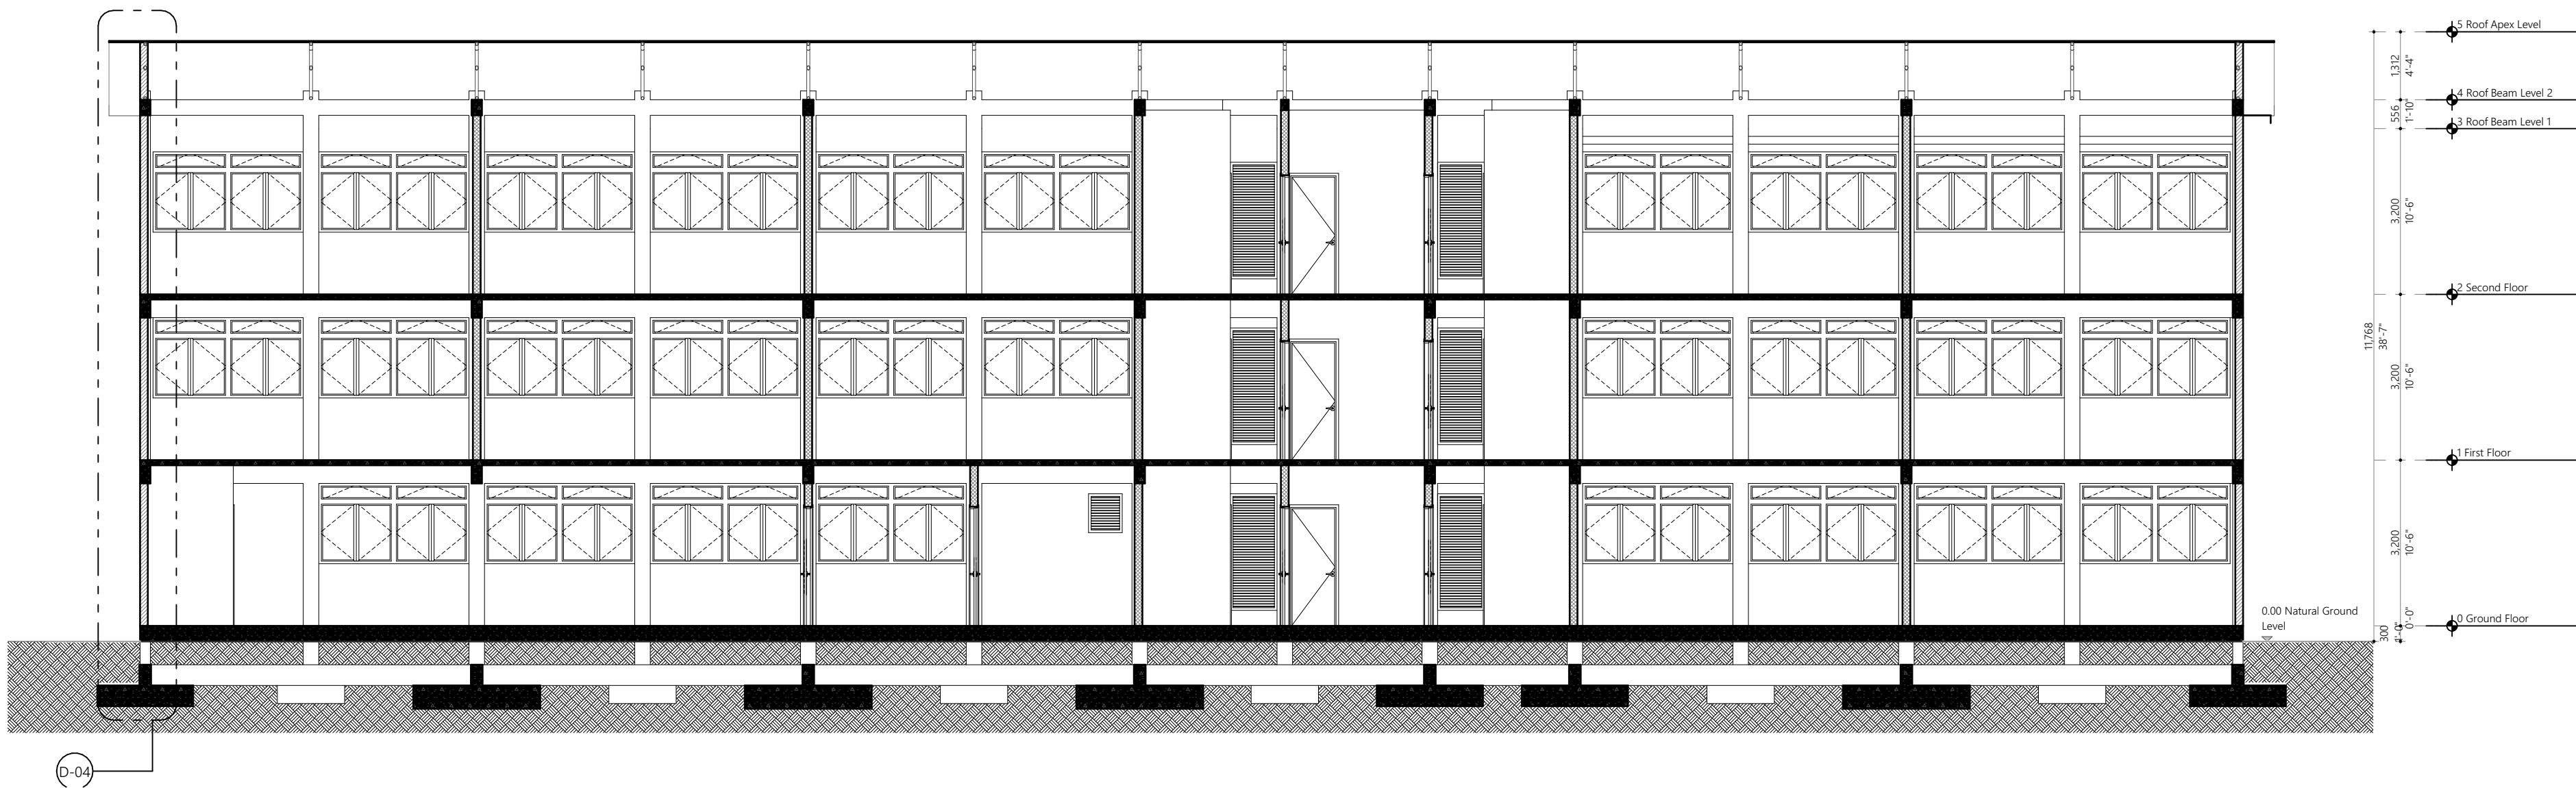


Building Section X-X  
1:100

Overview :



Legend :

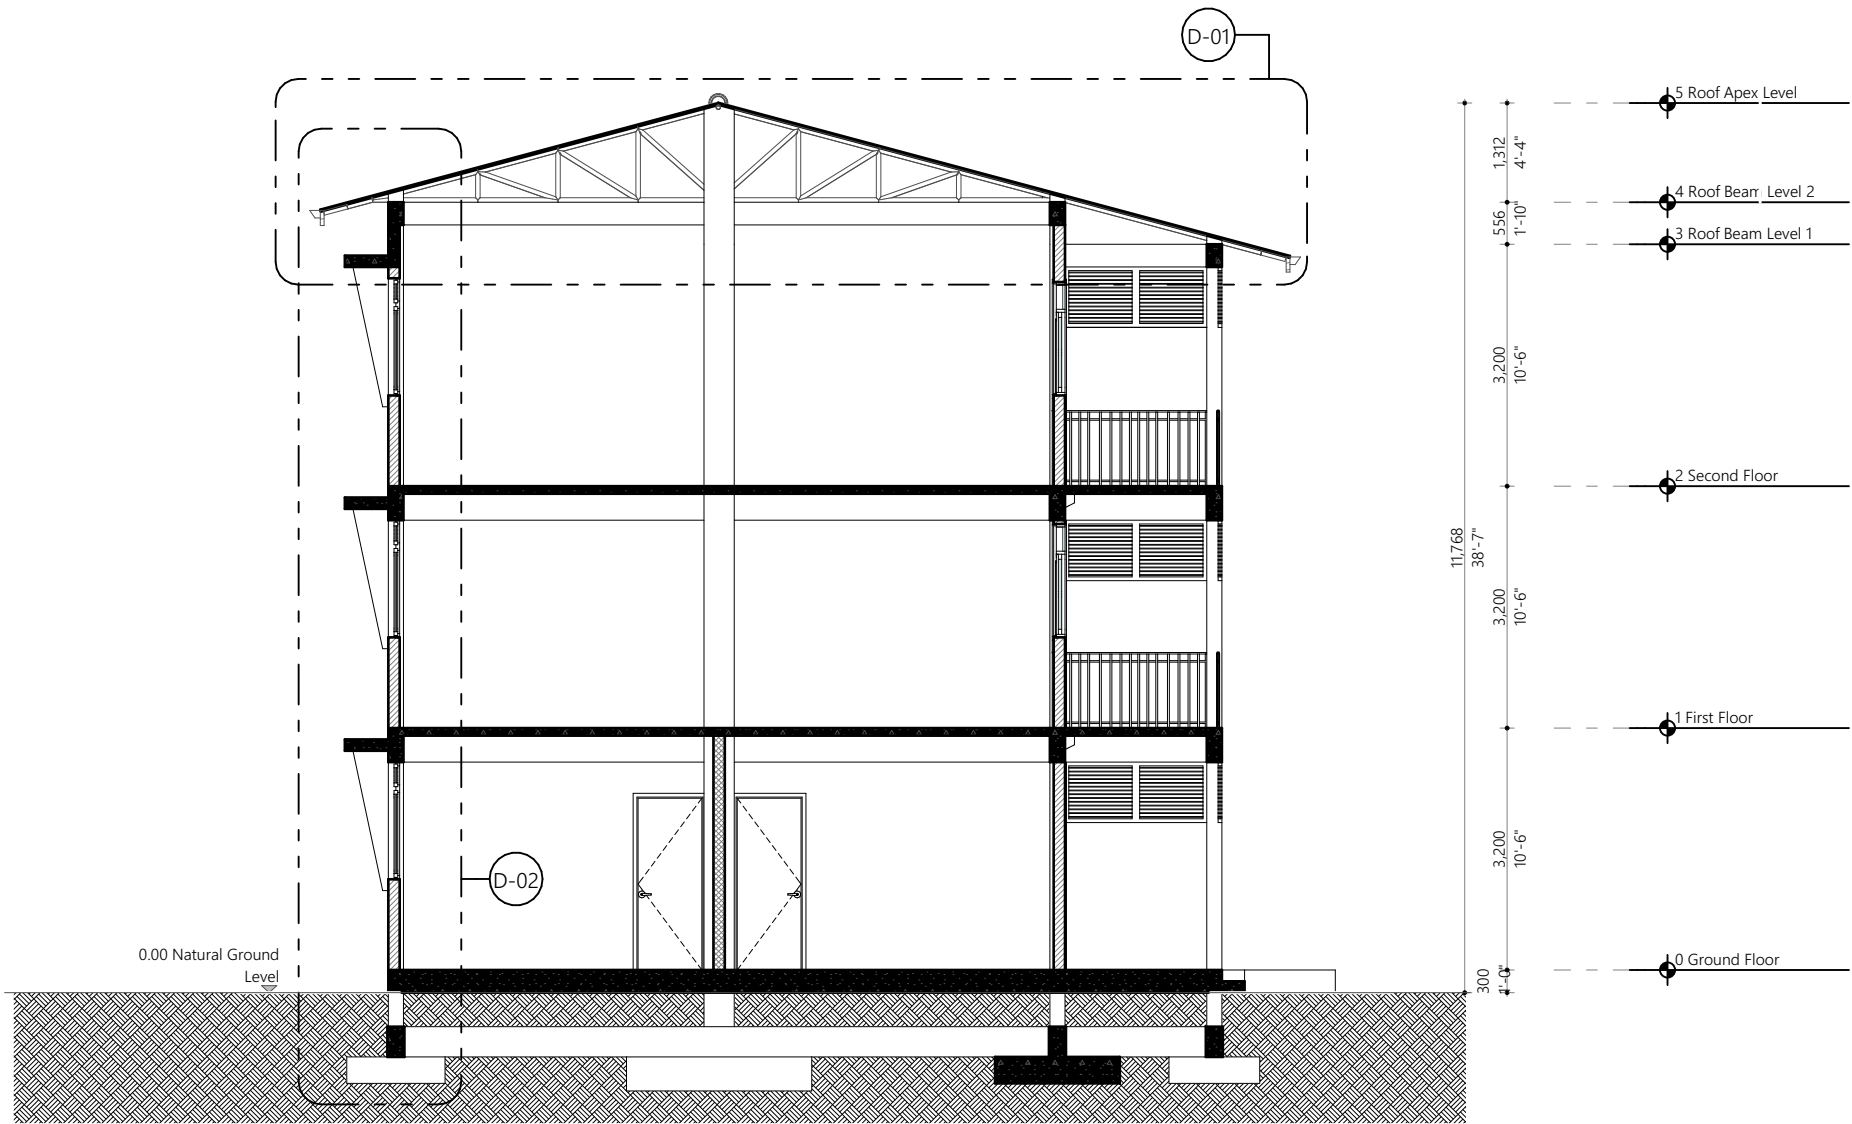

Building Section Y-Y  
1:100

Notes :

#	REVISION	BY	APP	DATE

**Project :**  
Ha Kelaa 12 Classroom Sen  
Room and Office Building

**Client :**  
Ministry of Education, Maldives

**Prepared by**

**EPOCH**  
T: +960 333 3528, E: info@epochassociates,  
W: www.epochassociates, A/G Rosary West, 3<sup>rd</sup>  
Floor, Husnuheena Magu, Male', Maldives

DESIGNER: Muaviyath A. Sathar	CHECKED: F. Ihudha Amir
DRAWN: Mohamed Hassan	APPROVED: Ihsaan Waheed


**Page Title**  
Sections X-X and Y-Y

**Scale :** 1:100

**Doc No :** EP/BLD-AR/2022/08/AR-104  
**Date :** Wednesday, March 15,  
2023


**Rev No :** **Pg :** A.02.1



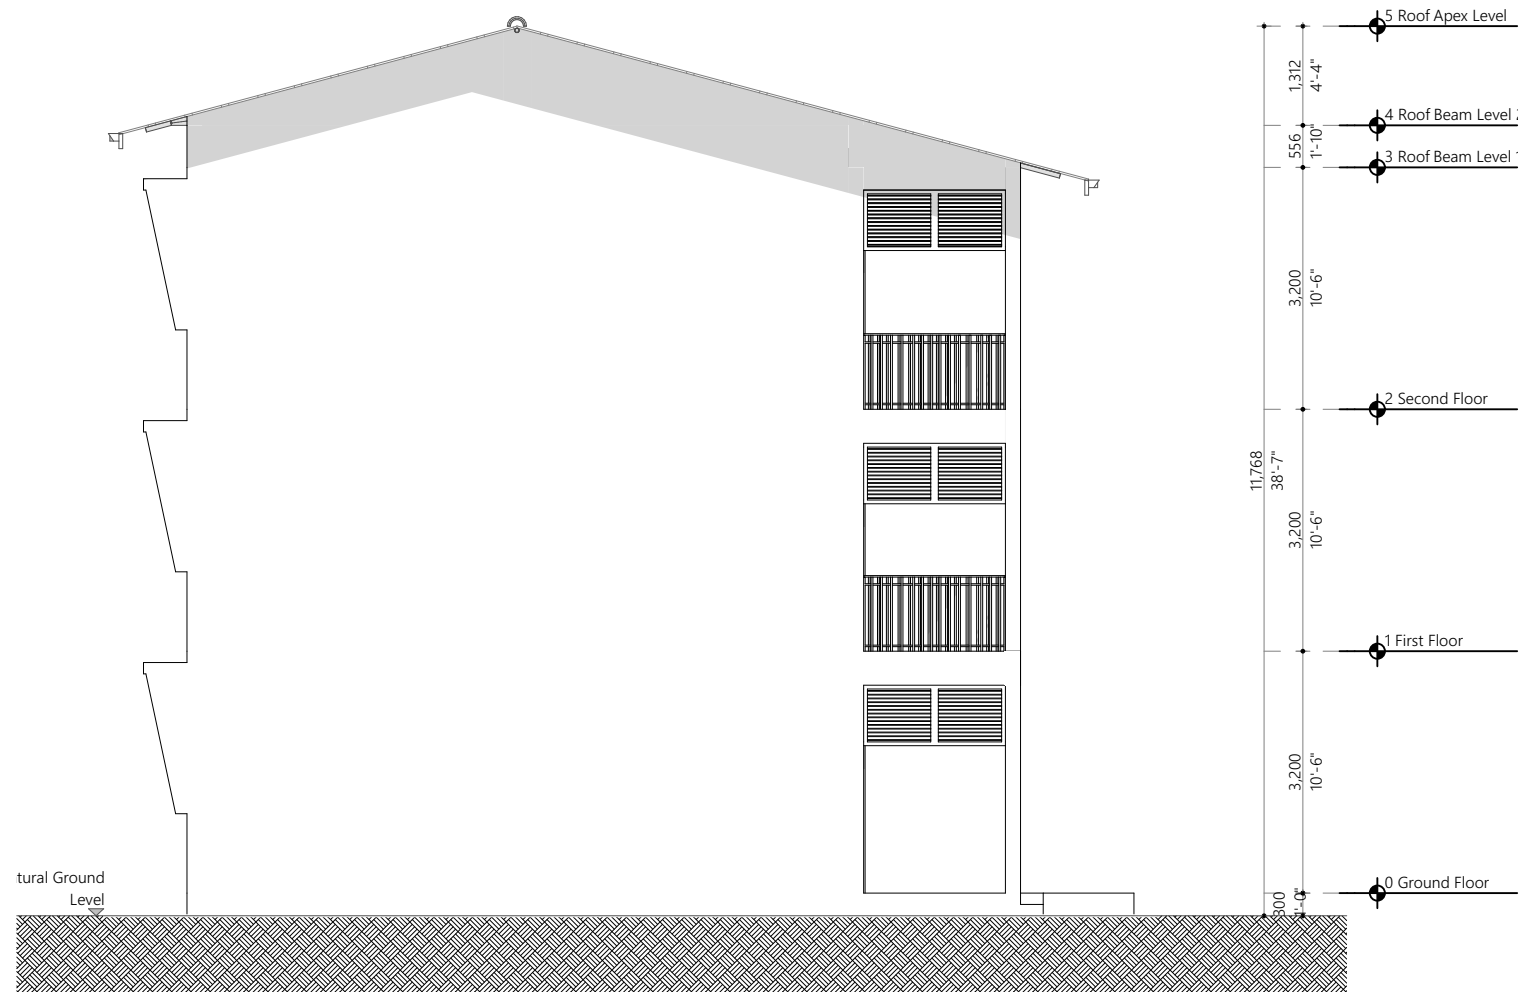


Elevation E1  
1:100

Overview :



Legend :

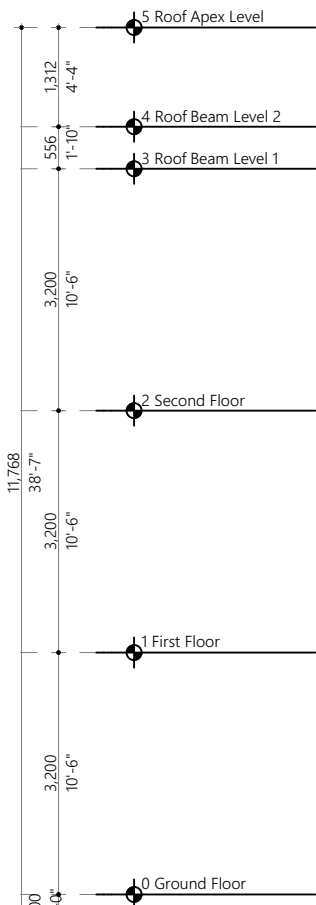

Notes :

#	REVISION	BY	APP	DATE

**Project :**  
Ha Kelaa 12 Classroom Sen  
Room and Office Building

**Client :**  
Ministry of Education, Maldives

**Prepared by**



T: +960 333 3528, E: info@epochassociates,  
W: www.epochassociates, A/G Rosary West, 3<sup>rd</sup>  
Floor, Husnuheena Magu, Male', Maldives


DESIGNER: Muaviyath A. Sathar	CHECKED: F. Ihudha Amir
DRAWN: Mohamed Hassan	APPROVED: Ihsaan Waheed

Elevation E2  
1:100

Scale : 1:100


**Doc No :** EP/BLD-AR/2022/08/AR-104  
**Date :** Wednesday, March 15,  
2023

**Rev No :** **Pg : A.05.1**

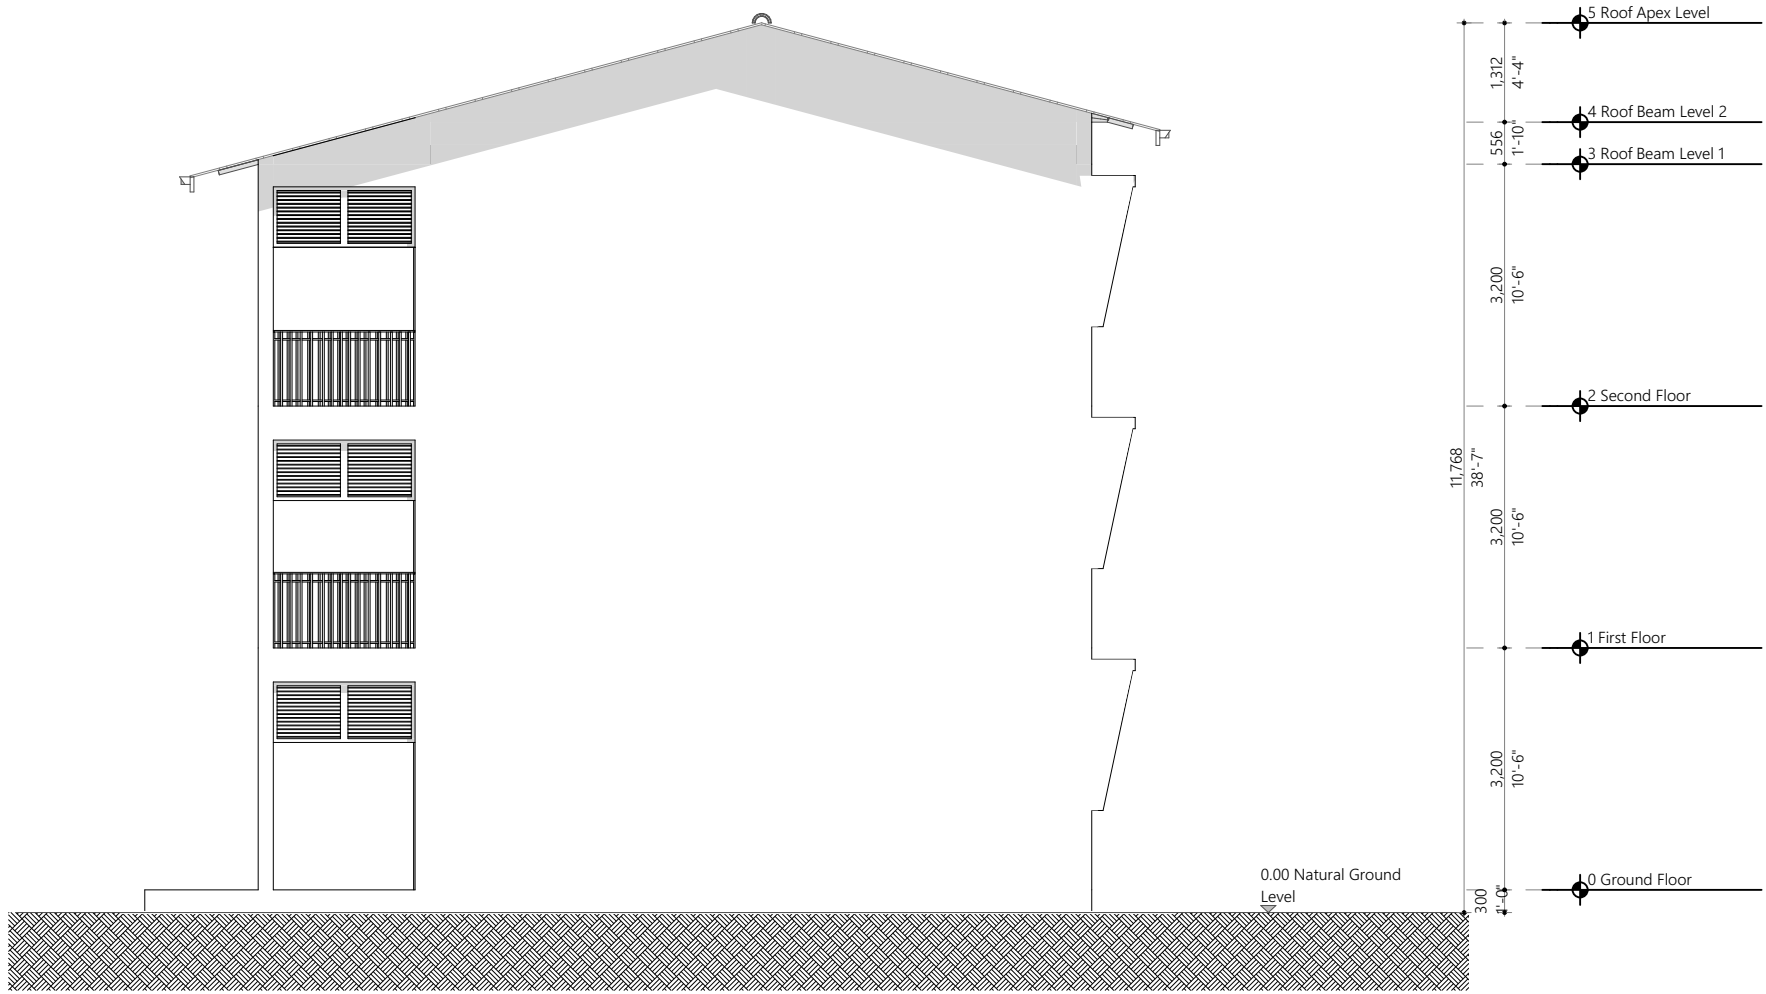


Elevation E3  
1:100

Overview :



Legend :

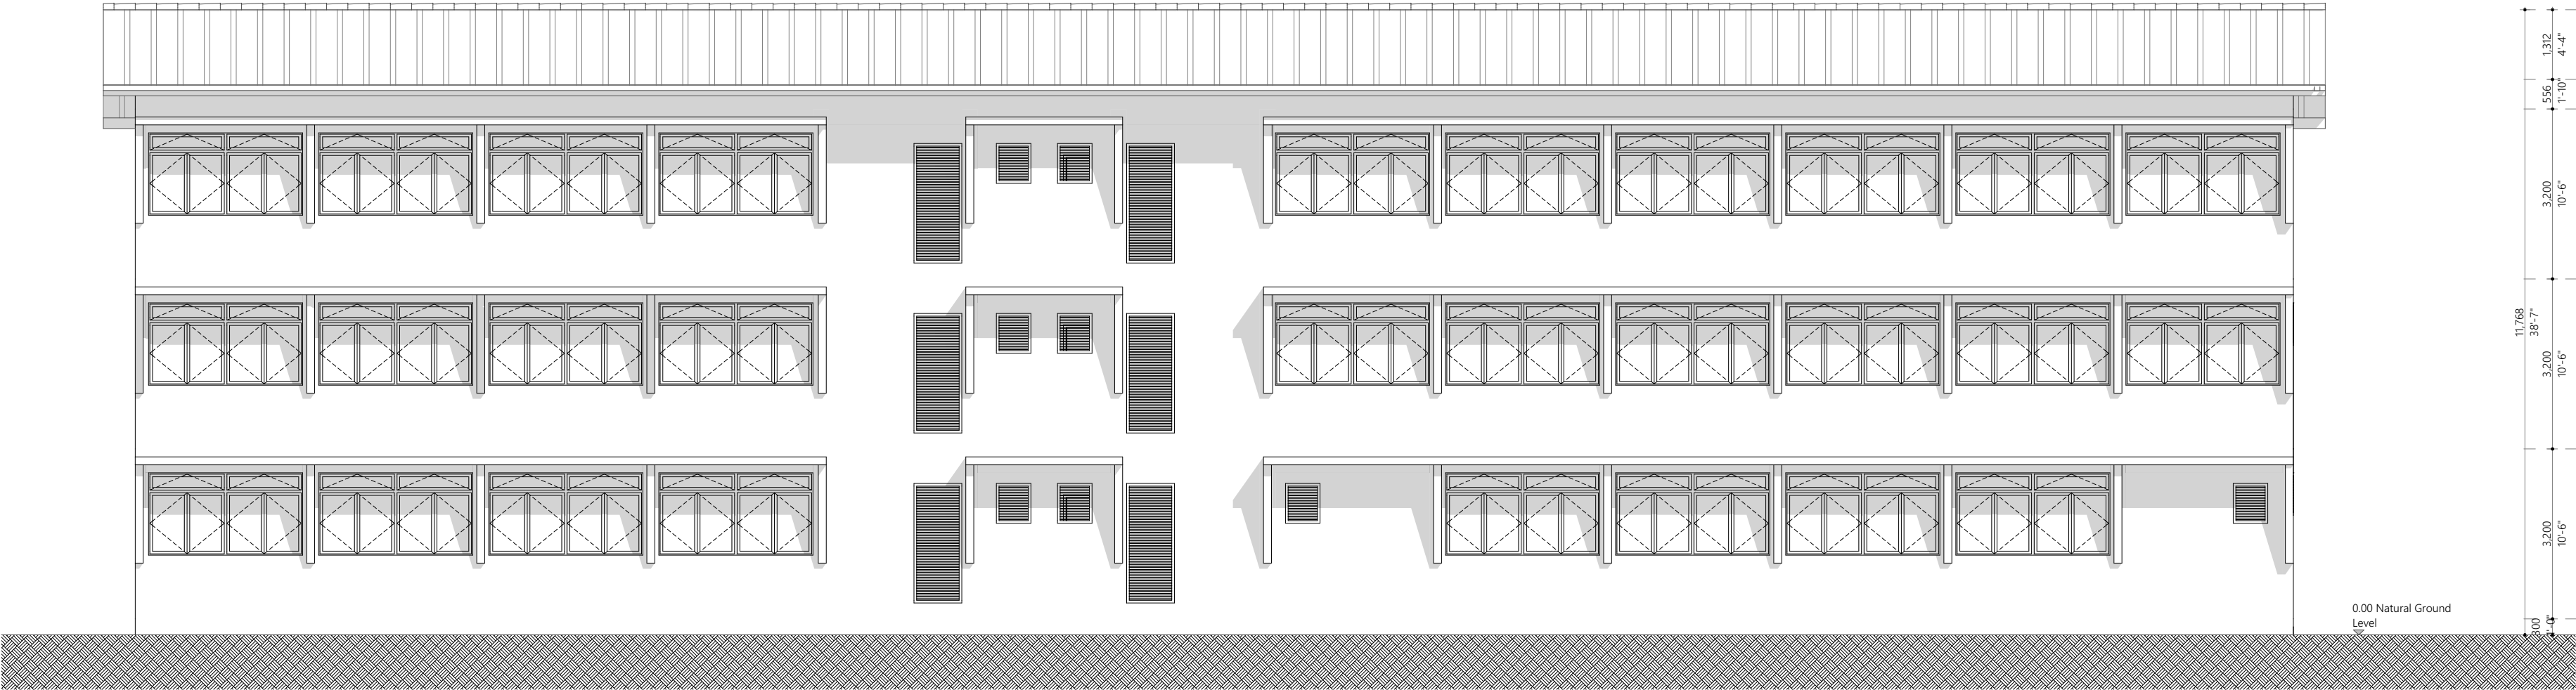

Elevation E4  
1:100

Notes :

#	REVISION	BY	APP	DATE

**Project :**  
Ha Kelaa 12 Classroom Sen  
Room and Office Building

**Client :**  
Ministry of Education, Maldives

**Prepared by**

**EPOCH**  
T: +960 333 3528, E: info@epochassociates,  
W: www.epochassociates, A: G Rosory West, 3<sup>rd</sup>  
Floor, Husnuheena Magu, Male', Maldives

DESIGNER: Muaviyath A. Sathar	CHECKED: F. Ihudha Amir
DRAWN: Mohamed Hassan	APPROVED: Ihsaan Waheed

**Page Title**  
Elevation E3 and E4

**Scale :** 1:100

**Doc No :** EP/BLD-AR/2022/08/AR-104  
**Date :** Wednesday, March 15,  
2023

**Rev No :** **Pg :** A.05.2

All Openings Schedule								
Element ID	D01	D02	D03	D03	D04	W01	W02	W03
Quantity	14	17	1	1	28	8	6	6
W x H Size	700×2,300	900×2,300	1,100×2,300	900×2,300	2,900×2,700	650×750	900×2,250	1,875×800
2D Symbol								
View from Side Opposite to Opening Side								
Frame Outside	50x100x2mm Thick powder coated (60 microns) Aluminum frame of selected colour	50x100x2mm Thick powder coated (60 microns) Aluminum frame of selected colour	50x100x2mm Thick powder coated (60 microns) Aluminum frame of selected colour	50x100x2mm Thick powder coated (60 microns) Aluminum frame of selected colour	50x100x2mm Thick powder coated (60 microns) Aluminum frame of selected colour	50x100x2mm Thick powder coated (60 microns) Aluminum frame of selected colour	50x100x2mm Thick powder coated (60 microns) Aluminum frame of selected colour	50x100x2mm Thick powder coated (60 microns) Aluminum frame of selected colour
Leaf Outside	50mm Thick powder coated (60 microns) Aluminum panel of selected colour	50mm Thick powder coated (60 microns) Aluminum panel of selected colour	50mm Thick powder coated (60 microns) Aluminum panel of selected colour	50mm Thick powder coated (60 microns) Aluminum panel of selected colour	50mm Thick powder coated (60 microns) Aluminum panel of selected colour	---	---	---
Glass	(No Glazing)	(No Glazing)	(No Glazing)	(No Glazing)	Clear Glass	---	---	---
Sash Outside	---	---	---	---	---	50mm Thick powder coated (60 microns) Aluminum louvers of selected colour	50mm Thick powder coated (60 microns) Aluminum louvers of selected colour	50mm Thick powder coated (60 microns) Aluminum louvers of selected colour

All Openings Schedule			
Element ID	W04	W05	W06
Quantity	9	30	28
W x H Size	2,600×800	3,000×800	2,900×1,550
2D Symbol			
View from Side Opposite to Opening Side			
Frame Outside	50x100x2mm Thick powder coated (60 microns) Aluminum frame of selected colour	50x100x2mm Thick powder coated (60 microns) Aluminum frame of selected colour	50x100x2mm Thick powder coated (60 microns) Aluminum frame of selected colour
Leaf Outside	---	---	---
Glass	---	---	---
Sash Outside	50mm Thick powder coated (60 microns) Aluminum louvers of selected colour	50mm Thick powder coated (60 microns) Aluminum louvers of selected colour	50mm Thick powder coated (60 microns) Aluminum louvers of selected colour

### Door and Window Notes

Dimensions shown on DWG indicate effective openings of frame  
All measurements to be verified by manufacturer

#### All aluminium Doors / Windows

Aluminium frame profiles shall be 35-50mm x 100mm (minimum 1.6mm thick)

Aluminium panels should be a minimum 6mm thick single sheet within an aluminium profile of 35-50mm x 100mm (minimum 1.6mm thick)

#### All Timber Doors / Windows

Timber Door frame shall be 50mm x 100mm hardwood.

All door panel thicknesses are 40mm thick solid core.

All frame edges shall be trimmed 3mm

All wooden components should be wood stained finish

All glazing should be of 6mm unless specified

External units must comply the following weather conditions:-  
Wind pressure: 200 kg/sqm  
Water tightness: 25 kg/sqm

All external frames / wall joints must be sealed with silicon sealant and the wedges trimmed with 12 X 12mm hardwood beading fixed to frames by brass nails


All hardware should be provided for the performance of all functions of the units

- Hinges shall confirm to
- Door size more than 700X900mm  
WD: 125mm X 2 sets  
SD: 150mm X 3 sets
  - Door size less than 700 X 1900mm  
WD: 100mm X 2 sets  
SD: 125mm X 2 sets

Locks shall be cylindrical with master key sets

Door knobs shall be 1000mm above FFL

#### Overview :



#### Legend :

#### Notes :

#	REVISION	BY	APP'D DATE

#### Project :

Ha Kelaa 12 Classroom Sen Room and Office Building

#### Client :

Ministry of Education, Maldives

#### Prepared by



T: +960 333 3528, E: info@epochassociates,  
W: www.epochassociates, A/G Rensay West, 3<sup>rd</sup> Floor, Husnuheena Magu, Male', Maldives

DESIGNER: Muaviyath A. Sathar	CHECKED: F. Ihudha Amir
DRAWN: Mohamed Hassan	APPROVED: Ihsaan Waheed

#### Page Title

All Openings Schedule

Scale : 1:1, 1:100

Doc No : EP/BLD-AR/2022/08/AR-104  
Date : Wednesday, March 15, 2023


#### Rev No :

Pg : A.05.1

Ventilation Schedule						
Home Story	Zone Name	Area (sqm)	Opening	Required Opening	Designed Opening	Opening %
Ground Floor	Office with reception	29.56	D04 X 2	2.956	6.5	21.99
	Conference Room	27.19	D04 X 1	2.719	3.25	11.95
	Meeting Room	13.04	W06 X 1	1.304	4.06	31.13
	Corridor	103.49	Open			
	Staff Toilet (F)	2.29	Mechanical			
	Staff Toilet (M)	2.29	Mechanical			
	Principle Room	26.28	D04 X 1	2.628	3.25	12.37
	Principle Toilet	4.34	Mechanical			
	File and Stock Room	12.93	Mechanical			
	Administrator Cabin	45.75	W06 X 3	4.575	12.18	26.62
	Toilet (F)	11.07	W02 X 1	1.107	1.72	15.54
	Toilet (M)	11.15	W02 X 1	1.115	1.72	15.43
	Store	7.3	Mechanical			
	Classroom 1	54.28	D04 X 2, W06 X 2	5.428	14.62	26.93
	Classroom 2 (Sen)	54.28	D04 X 2, W06 X 2	5.428	14.62	26.93
	Toilet for disabled	6.82	Mechanical			
First Floor	Classroom 3	54.28	D04 X 2, W06 X 2	5.428	14.62	26.93
	Classroom 4	54.28	D04 X 2, W06 X 2	5.428	14.62	26.93
	Classroom 5	54.28	D04 X 2, W06 X 2	5.428	14.62	26.93
	Cleaner closet	2.79	Mechanical			
	Toilet (M)	11.15	W02 X 1	1.115	1.72	15.43
	Toilet (F)	11.07	W02 X 1	1.107	1.72	15.54
	File Stock/ Marking Room	8.37	Mechanical			
	Store	7.30	Mechanical			
	Classroom 6	54.28	D04 X 2, W06 X 2	5.428	14.62	26.93
	Classroom 7	54.28	D04 X 2, W06 X 2	5.428	14.62	26.93
	Corridor	101.02	Open			
Second Floor	Classroom 8	54.28	D04 X 2, W06 X 2	5.428	14.62	26.93
	Classroom 9	54.28	D04 X 2, W06 X 2	5.428	14.62	26.93
	Classroom 10	54.28	D04 X 2, W06 X 2	5.428	14.62	26.93
	Cleaner closet	2.79	Mechanical			
	Toilet (M)	11.15	W02 X 1	1.115	1.72	15.43
	Toilet (F)	11.07	W02 X 1	1.107	1.72	15.54
	File Stock/ Marking Room	8.37	Mechanical			
	Store	7.30	Mechanical			
	Classroom 11	54.28	D04 X 2, W06 X 2	5.428	14.62	26.93
	Classroom 12	54.28	D04 X 2, W06 X 2	5.428	14.62	26.93
	Corridor	101.02	Open			

Ventilation Schedule  
1:47.57

Overview :



Legend :

Notes :

#	REVISION	BY	APP	DATE

Project :

Ha Kelaa 12 Classroom Sen  
Room and Office Building

Client :

Ministry of Education, Maldives

Prepared by



T: +960 333 3528, E: info@epochassociates,  
W: www.epochassociates, A/G Rosary West, 3<sup>rd</sup>  
Floor, Husnuheena Magu, Male', Maldives

DESIGNER: Muaviyath A. Sathar	CHECKED: F. Ihudha Amir
DRAWN: Mohamed Hassan	APPROVED: Ihsaan Waheed

Page Title

Ventilation Schedule

Scale : 1:47.57

Doc No : EP/BLD-AR/2022/08/AR-104  
Date : Wednesday, March 15,  
2023

Rev No :

Pg : A.05.2



1. General notes

1.1.Do not scale the drawingsAll dimensions shall be read from the drawing or computed.Elevations are in millimeters distances and reinforcement bar sizes are in millimeters

1.2. In the interpretation of these drawings, indicated dimensions shall govern and distances or sizes shall not be scaled for construction purposes

1.3. The contractor shall coordinate with the arse, ee and other utility and equipment plans for the exact size number and locations of all sleeves or openings through floor slabs, beams and walls. Any discrepancies or conflict in the setting out lines levels, details, locations,sizes, reinforcement etc. Of the structural member shall be brought to the attention of the engineer prior to commencement of work.

1.4. All reinforced concrete work shall be done in accordance with the british structural code bs 8110 or ec-en2 building code

1.5. All structural steel work shall be done in accordance with the british structural code bs 5950 parts 1to 9 and ec-en3 in so far as they do not conflict with the local building code requirements

1.6. All slabs, beams and other structural elements which are not indicated, detailed, designated or inadvertently omitted but are necessary to be coordinated with architectural and other allied engineering plans as well as to complete the structural works in accordance with the intent of the plans and specifications shall be brought up during pre-bids/meetings/negotiations.It is understood that the contractor has provided and included all these items in his bid.

1.7. The contractor shall produce shop drawings and schedules as required for completion of the works and record drawings of the as-built and builder works for the consultant's approval.

1.8. Contractor shall do full coordination between structuralarchitectural and mep drawings in wet areas to allow for drainage pipes

1.9. All discrepancies shall be brought to the attention of the consultant engineer proceeding with the work on site

1.10. All materials to be used in conjunctions shall comply with the requirements of the specified codes, standards and ordinance of relevant building authorities unless noted otherwise in the project specification and /or drawings.

1.11. All dimensions and levels shown on the drawings shall be verified by the contractor . Any discrepancies shall be brought to consultants attention prior to construction

1.12. The contractor shall ensure that during constructionno part of the structure is overstressed by excessive construction loads until their completion. Temporary bracing and propping to be provided were required

1.13. Once the excavation is done to a specified depththe bearing capacity of the soil shall be confirmed by relevant test, if the value is less than the design bearing capacity the engineer is to be informed immediately

1.14. The contractor shall submit a method statement for all elements of work and shall not proceed until consultant's written approval is given The method statement shall provide the contractor's preferable options where such options are available.

1.15. The contractor shall comply with all requirements of the local regulations and requirements of all concerned authorities

1.16. Quality of concrete finish for all nonplastered columns and beams is to be in accordance with fair faced concrete as reflected on the architectural drawings and specifications.

1.17. Any structural requirements specified by relevant authorities, which are not covered in notes and specifications are assumed to be duly considered by the contractor.

1.18. All typical details and notes shown on drawings shall apply unless noted otherwise. Typical detail may not necessary be indicated on the plans but shall still apply as shown or described in the details where particular details are noted on the drawings the specified details shall be used.

1.19. The design life of the structure of this project shall maintain a minimum of 50 years life period The primary structural components are to be designed and detailed to satisfy this requirement. Concrete mix supplier shall submit a life cycle analysis which reflect a 50 years design life without maintenanceinspection and repair requirement during this period.

2. Concrete

2.1. All concrete works shall conform to the bs8110 or ec-en, a grade of c25/30 indicates that concrete shall have a fcu compressive strength of 30n/mm2 established from test cubes at 28 days equivalent to a compressive strength of 25n/mm2 established from cylinder tests at 28 days.  
concrete mix design shall comply with bs8500-1:2006 as follows:

Miz Number	1	2	3	4
Grade	C30/37	C25/30	C25/30	C16/20
Min cement content (kg/m³)	380	340	340	300
Cement Type	SRC	SRC / OPC	OPC	SRC
Max free W/C ratio	0.4	0.45	0.45	0.55
Slump	75 ± 25	75 ± 25	75 ± 25	100 ± 25
Aggregate	20	20	20	20

mix 1 - used in reinforced concrete works for structures at sea/exposed to sea, water retaining structures and tank structures.

mix 2 - used in reinforced concrete works for ground level and below (sub-structutre) or any reinforced concrete works in contact with soil or water.

mix 3 - used in reinforced concrete works above ground flr lvl (superstructure) for horizontal members (beams/slabs) and vertical members (columns/walls).

mix 4 - used for plain concrete blinding and mass fill.

2.2. Contractor shall implement a trial mix in accordance with the project specifications & authority requirements. Trial mix results shall be submitted for engineer's review & approval prior to commencing concreting.

2.3. Contractor shall submit the details of additives, plasticizers, micro silica, curing compounds, waterproofing agents, etc. Application should follow strictly the manufacturer recommendation. It is contractors responsibility to ensure that all constituents of concrete are compatible to each other.

2.4. Maximum percentage (by weight) of salt contents permissible in aggregates used for concrete, hollow blocks & hourdi blocks, etc, shall be as follows:  
a) acid soluble chlorides in aggregate - (fine 0.03%, coarse 0.02%)  
b) acid soluble sulphate in aggregate - (fine 0.3%, coarse 0.2%)

2.5. Concrete shall be cured by an approved means in accordance with the specifications.

2.6. Aggregates shall be from approved source and in accordance with the specifications.

2.7. Openings, sleeves:  
a) no holes, sleeves or penetrations be placed vertically or horizontally through beams unless approved by the engineer.  
b) no holes to be made in slabs unless approved by the engineer.

2.8. Construction joints:  
a) the contractor shall submit to the engineer for approval a plan marked up showing the location of all construction joints  
b) horizontal construction joints shall not be made in beams, unless approved by the consultant or engineers.  
c) vertical construction joints may be located at midspan of slabs or beams after reviewed and approved by the engineers.  
d) contractor shall submit shear friction and the additional required reinforcement calculation of construction joint  
at any location) for engineers review and approval.

3. Reinforcement

3.1. The reinforcement used in the reinforced concrete shall be round, deformed type 2 bars marked as (t) to indicate high yield strength of 460n/mm2 to bs4449 or type 500b to ec-en. The carbon equivalent of rebars should not exceed 0.51 for grade 460.

3.2. Reinforcement details shown are indicative. The contractor shall prepare detailed shop drawings & full bar schedules in accordance with the design drawings and shall be cut and bent in accordance with bs 8666 and aci 315-09 for the engineer's approval at least four weeks prior to commencement of reinforced concrete work and after coordinating with all concerned parties.

3.3. Lap lengths and anchorage lengths of reinforcement shall be as per bs 8110 and ec en. Additional lapping if required to be provided with engineer's approval. The minimum lap length of reinforcement shall be the maximum of (45 bar dia in general and 50 dia for tension) or the values of the table a.

Table a : schedule of lap splices

Bar dia	lap splices length (mm)
10	500
12	600
16	800
20	1000
25	1250

3.4. Spacer bars in beams shall be a minimum t25 or the size of bar if greater at 1000mm c/c; chairs in slabs shall be a minimum t12@1000mm c/c; and minimum ties in walls shall be t8@1000mm c/c.

3.5. Clear cover to reinforcement including links, stirrups, and ties shall be as follows:

- A) structure in contact with ground
- Footings = 55mm
- Wall and column = 50mm
- Ground beam = 50mm
- Slab at ground level = 50mm
- B) super structure
- Columns = 40mm
- Beams = 35mm
- Slabs = 30mm
- Walls = 40mm
- All concrete elements in contact with water/splash zone = 50mm

3.6. Reinforcement bars to be cut, bent or adjusted to clear all openings and interfering structures to suit at site to the approval of the consultant or engineer.

3.7. For holes in slabs up to 300x300 sq., reinforcement is to be cut and replacement bars fixed adjacent to the hole extending 50x bar diameter beyond the hole.

4. Fire resistance

4.1. All structural concrete members between units on boundaries are designed to maintain fire resistance of 2 hours.

Ha Kelaa 12 Classroom Sen Room and Office Building

Client: Ministry of Education, Maldives

3/15/2023

Architect: Fathmath Ihudha Amir  
Engineer: Ihsaan Waheed  
Drawn By: Fathmath Ihudha Amir



**EPOCH**

**T** +960 333 3528 **E** info@epoch.associates  
**W** www.epoch.associates, **A** M. Ahigasdhoshuge,  
Fareedhee Magu Male' Republic of Maldives

Rev: --- --- ---	Page: <b>B.01.1</b>
---------------------------	------------------------

5. Cracking

5.1. The cracking of the structural concrete in general is restricted to 0.30mm.

6. Earthwork & foundations

6.1. Foundation detail design is based on the assumed safe allowable bearing capacity has been taken as 150kpa. The actual requirement for the foundation design is to be verified based on final geotechnical report for the project.

6.2. Excavations for foundations down to formation level shall be carried out by mechanical means, except for the last 100mm of excavation which is to be carried out by manual methods and recommended by geotechnical consultant.

6.3. The formation level of foundation is to be inspected and approved by the geotechnical engineer before commencement of the work.

6.4. Engineering fill (unless specified otherwise as a higher quality material) shall be selected well graded granular material approved by the engineer with a minimum soaked cbr of 15% compacted not exceeding 250mm in layers to 95% maximum dry density as per geotechnical investigation report recommendations in accordance with the specification. However, a minimum cover of 250mm back fill material shall be provided at the top of foundations below the blinding to cast against.

6.5. Efficient site drainage during and after construction of the project should be provided by the contractor.

6.6. Site inspection by a qualified engineer should be carried out after completion of the excavation works and after preparation of the proposed foundation level to ensure that the contact surface is free from any loose/soft layer and properly prepared for the foundation.

7. Concrete workmanship

7.1. All concrete without plaster shall be fair finish unless noted otherwise.

7.2. All concrete surface to have plaster are to be hacked to have an adequate surface key.

7.3. All concrete is to be cured by an approved method-water pounding or curing compound.

7.4. All types of construction joints in concrete shall be at a specified locations and approved by the engineers.

7.5. All substructure concrete works shall be protected with water proofing as per standard details & specifications.

7.6. All concrete shall be compacted using a mechanical vibration process.

7.7. 25x25mm chamfers to external corners and edges shall be provided in accordance with specifications and directed by the engineer.

8. Structural steel

8.1. All structural steel works shall be in accordance with bs 5950 parts 1 to 9 or ec-en3.

8.2. Maximum dimension of holes shall be in accordance with bs 5950 : part 1 : 2000 table 35, unless indicated otherwise.

8.3. The contractor shall provide whatever temporary ties or bracing necessary for a safe and proper erection of the steel structures.

8.4. Welding shall comply with bs en 1011-1: 2009, bs en 1011-2 : 2001 and bs bs en 1011-8 : 2004.

8.5. Contractor shall do a detailed design for aluminum shades and to submit full design calculations and detailed shop drawings for all steel sections and connections to the engineer for approval prior to commencement of fabrication.

8.6. All rolled products and plates shall conform to bs en 10025-2. Cold form welded structural hollow sections shall conform to bs en 10219-1. Hot finish hollow sections shall conform to bs 10210-1 unless noted otherwise on drawings.

8.7. All connections shall be made with minimum 2nos. Galvanized grade 8.8 to bs 3692 with a minimum diameter of 20mm and minimum yield strength of 627mpa and minimum ultimate strength of 765mpa and electrodes to bsd 639, unless noted otherwise.

8.8. Unless noted otherwise on the drawings, all connections shall be in accordance with the following minimum requirements:

- A) all welds shall be at least 6mm continuous fillet welds all around.
- B) all structural bolted connections should be galvanized minimum 85 micron and with a minimum of 2 bolts per connection. Purlin bolts shall be in accordance with the suppliers recommendations.
- C) all gusset plates shall be at least 4mm thick.
- D) all cap plates shall be at least 4mm thick.
- E) all base plates shall be at least 4mm thick.

8.9. As minimum all structural steel members shall be shot blasted to sa 2.5, galvanized, primed & painted as below unless noted otherwise:

- A) hot galvanization (dft 200micron)
- B) primer coat to contain 2 coats of zinc rich epoxy primer (dft 75 micron)
- C) top coat to contain 2 coats of polyurethane enamel paint (dft 125 micron)

8.10. All structural steel work shall be corrosion protected in accordance with the structural specifications.

8.11. All steel should conform to the following:

- A) shs, rhs and chs sections bsen 10210 s275 fy=275mpa
- B) all angles and channels u.n.o bsen 10025 s275 fy=275mpa

8.12. All steel columns to be central on grids or equally spaced between grids unless noted otherwise.

8.13. All steel beams to be central on grids or equally spaced between grids unless noted otherwise.

8.14. All steel dimensions are to center line of section unless noted otherwise.

8.15. All bracing is to be set out on the centroids of bracing members and on the center line of beams and columns unless noted otherwise.

8.16. Where bracing is shown offset from center of members the contractor shall design and provide all necessary stiffeners.

8.17. Contractor to provide all leader railing as required to support free edges not trimmed with cold formed or mild steel work. To be provided in accordance with architect’s drawings.

8.18. Location of any connections, splices not shown in the drawings shall be submitted with design for engineer’s approval. No splices shall be made unless shown in the drawings and as approved by the engineers.

8.19. Contractor shall do a full coordination between architecture and structural drawings for the steel support for shade elements, locations and sizing connections with structural concrete elements and sections. Care shall be taken to prevent dissimilar metal corrosion.

9. Masonry blocks

9.1. Design and construction of all blocks shall comply with bs 5628 : parts 1.2 & 3 : 1992 or en-ec6. The contractor shall submit a construction method statement prior to commencing the works.

9.2. Wall ties in accordance with bs 1248 - cp 121 part 1.73.

9.3. All block wall joints to manufacturers specifications.

9.4. All block work walls are to be considered as non-load bearing partitions unless noted otherwise in drawings

9.5. Block walls shall be reinforced horizontally and vertically as per manufacturers requirements.

9.6. Masonry wall mechanical properties

- young’s modulus = 3.5e+006 kn/m<sup>2</sup>
- poisson’s ratio = 0.25
- density = 20kn/m<sup>3</sup>
- min.compressive strength = 3.5 mpa

10. Design & loading

10.1. Consultant design design and construction of reinforced concrete structural members, shall be in accordance with bs8110 & ec-en2 and the structural steel members to bs 5950 & ec-en3.

10.2. Contractor design the contractor is responsible for the design of all temporary works. (shoring for excavation, signage... Etc) and the following items of permanent secondary works. (subjected to engineers review and approval)

- a) precast concrete elements
- b) architectural facade and support steelwork
- c) non load bearing feature columns
- d) all secondary steel works
- e) structural steelwork connections
- f) structural support for mep services
- g) shade structures
- h) balustrade and crash barrier
- i) structural glass
- j) interior signage

the design of the primary structure is considering the interfaces with these structures) loading reactions, opening...etc.) And were detailed to accommodate these elements into the design.

the contractor shall submit a full detail design for the wall and boundary wall foundation, also the contractor to do

full coordination between the structural foundation for villas (including the water tanks, and the boundary wall for clashes, the contractor shall produce shop drawings for the boundary walls for engineer’s approval.

10.3. Loading

- a) superimposed (dead loads & live loads) as per bs 6399 or en-ec1.
- b) self-weight & densities as per bs 648 or en-ec1.
- c) wind loads as per bs 6399 or en-ec1 (mean wind speed = 25m/s).

11. Timber

11.1. All timbers shall be in accordance with bs 5268 or ec-en5

11.2. All timber members sizes are indicative. Contractor shall coordinate with supplier and submit detail designs for all prefab timber structure for approval.

Ha Kelaa 12 Classroom Sen Room and Office Building

Client: Ministry of Education, Maldives

3/15/2023

Architect: Fathmath Ihudha Amir  
Engineer: Ihsaan Waheed  
Drawn By: Fathmath Ihudha Amir



EPOCH

T: +960 333 3528 E: info@epoch.associates  
W: www.epoch.associates, A. M. Ahigadshoshuge,  
Fareedhee Magu Male' Republic of Maldives

Rev:  
---  
---  
---

Page:


B.01.2

Notes:

1. First stirrups location shall be  $s/2$  from the face of the column/ support.
2. Place one b bar in each bottom corner and one t bar in each top corner of the stirrup cage.
3. Condition shown is at columns. Where beams and girder intersect, use typical interior girder section.
4. All bottom bars and top bars shall be placed in one layer unless two layers are noted in the beam schedule. Where to layers are noted provide 25 mm clear between layers. If two layers are noted place bar b1 above bar b and bar t above t1.
5. Length of exterior top bars are given only when straight bar occurs otherwise hooked bars are required.
6. Where a member is supported by a column, but has another member running perpendicular to it at the same column, the first stirrup spacing shall start from the face of the column and not from the face of the transverse beam.
7. Top & bottom reinforcement lapping of both main rebars can be ignored if the main rebars at left and right side of lapping location are identical.
8. For 'column width less or equal 2m  $l^* = \text{column width}/2$ . For 'column width' greater than 2m,  $l^* = 1\text{m}$


Supplementary abbreviations:

- B1 - continuous bottom bars.  
B2 - additional bottom bars  
CE - cantilevered end  
D - depth of member, mm  
EE - each end  
EF - each face  
FL - full length  
EW - each way  
H - aci standard hook  
ITB - interior top bar  
LE - left end  
LG - length  
P - paired stirrups  
RE - right end  
REM - remainder  
S - side bars  
T1 - top bars at internal supports  
T2 - top bars at mid-span  
T3 - top bars at end support  
W - width of member, mm

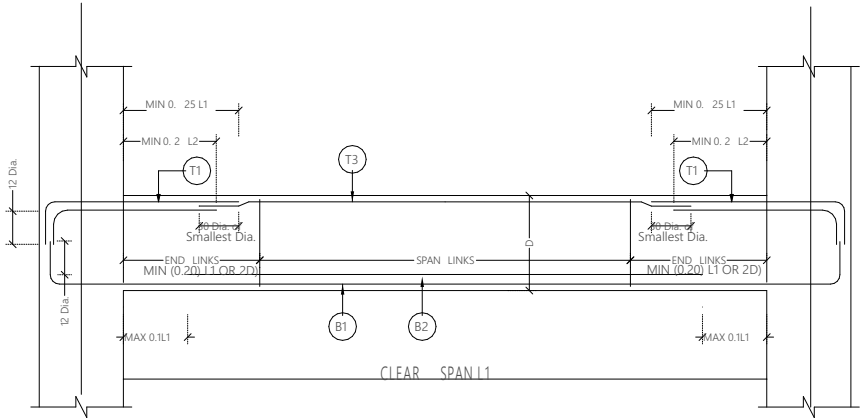


SIMPLE BEAM DETAILS

NTS

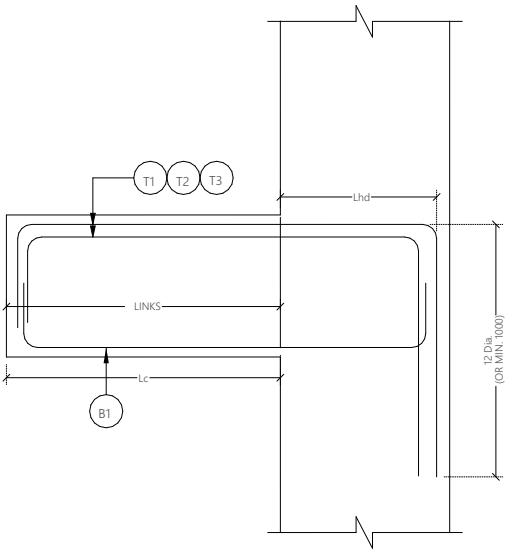


TYPICAL CANTELEVER BEAM FROM COLUMN

NTS

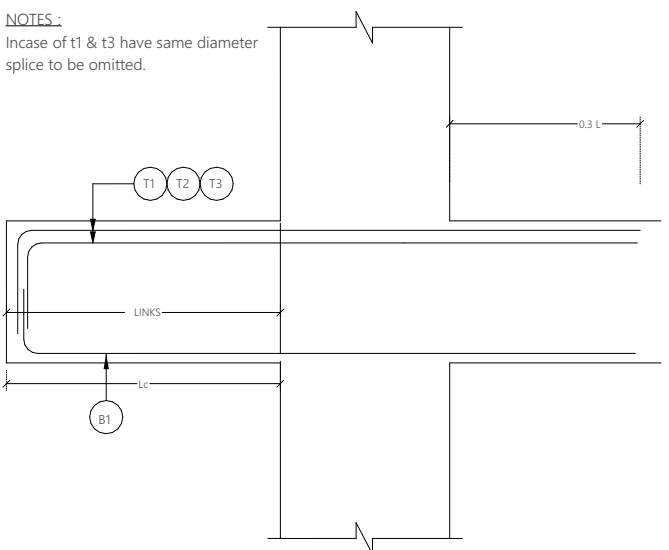

TYPICAL CANTELEVER BEAM CONTINUOUS

NTS

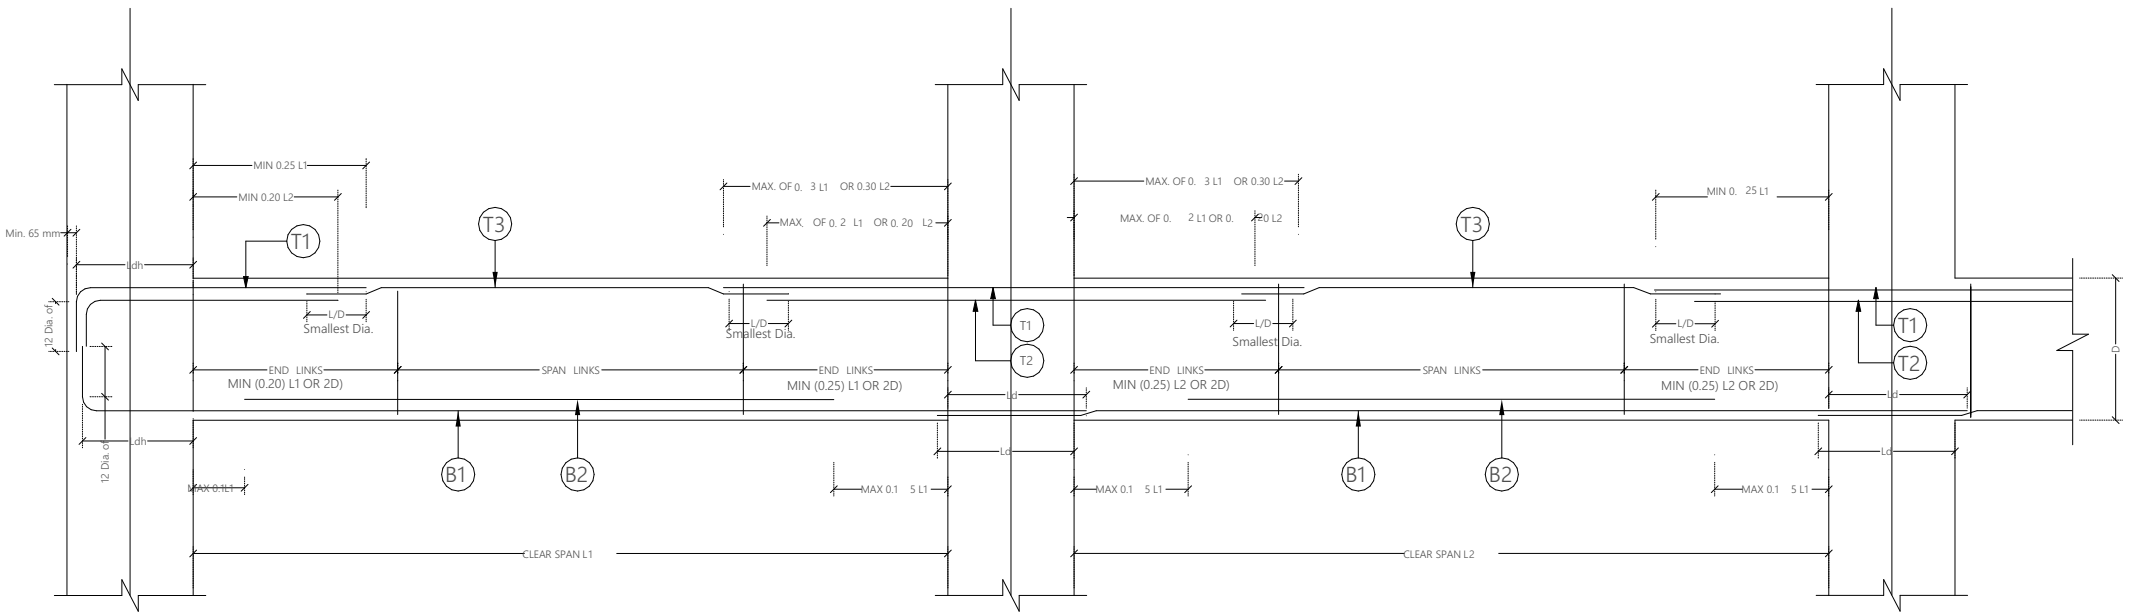

CONTINUOUS BEAM DETAILS

NTS

General Notes 3

1:100

Ha-Kelaa-12  
Classroom Sen  
Room and Office  
Building

Client:  
Ministry of Education,  
Maldives

3/15/2023

Architect: Fathmath Ihudha Amir  
Engineer: Ihsaan Waheed  
Drawn By: Fathmath Ihudha Amir



EPOCH

T: +960 333 3528 E: info@epoch.associates  
W: www.epoch.associates, A. M. Ahigasdhoshuge,  
Fareedhee Magu Male' Republic of Maldives

Rev:

---

---

---


Page:

---


---

---


B.01.3

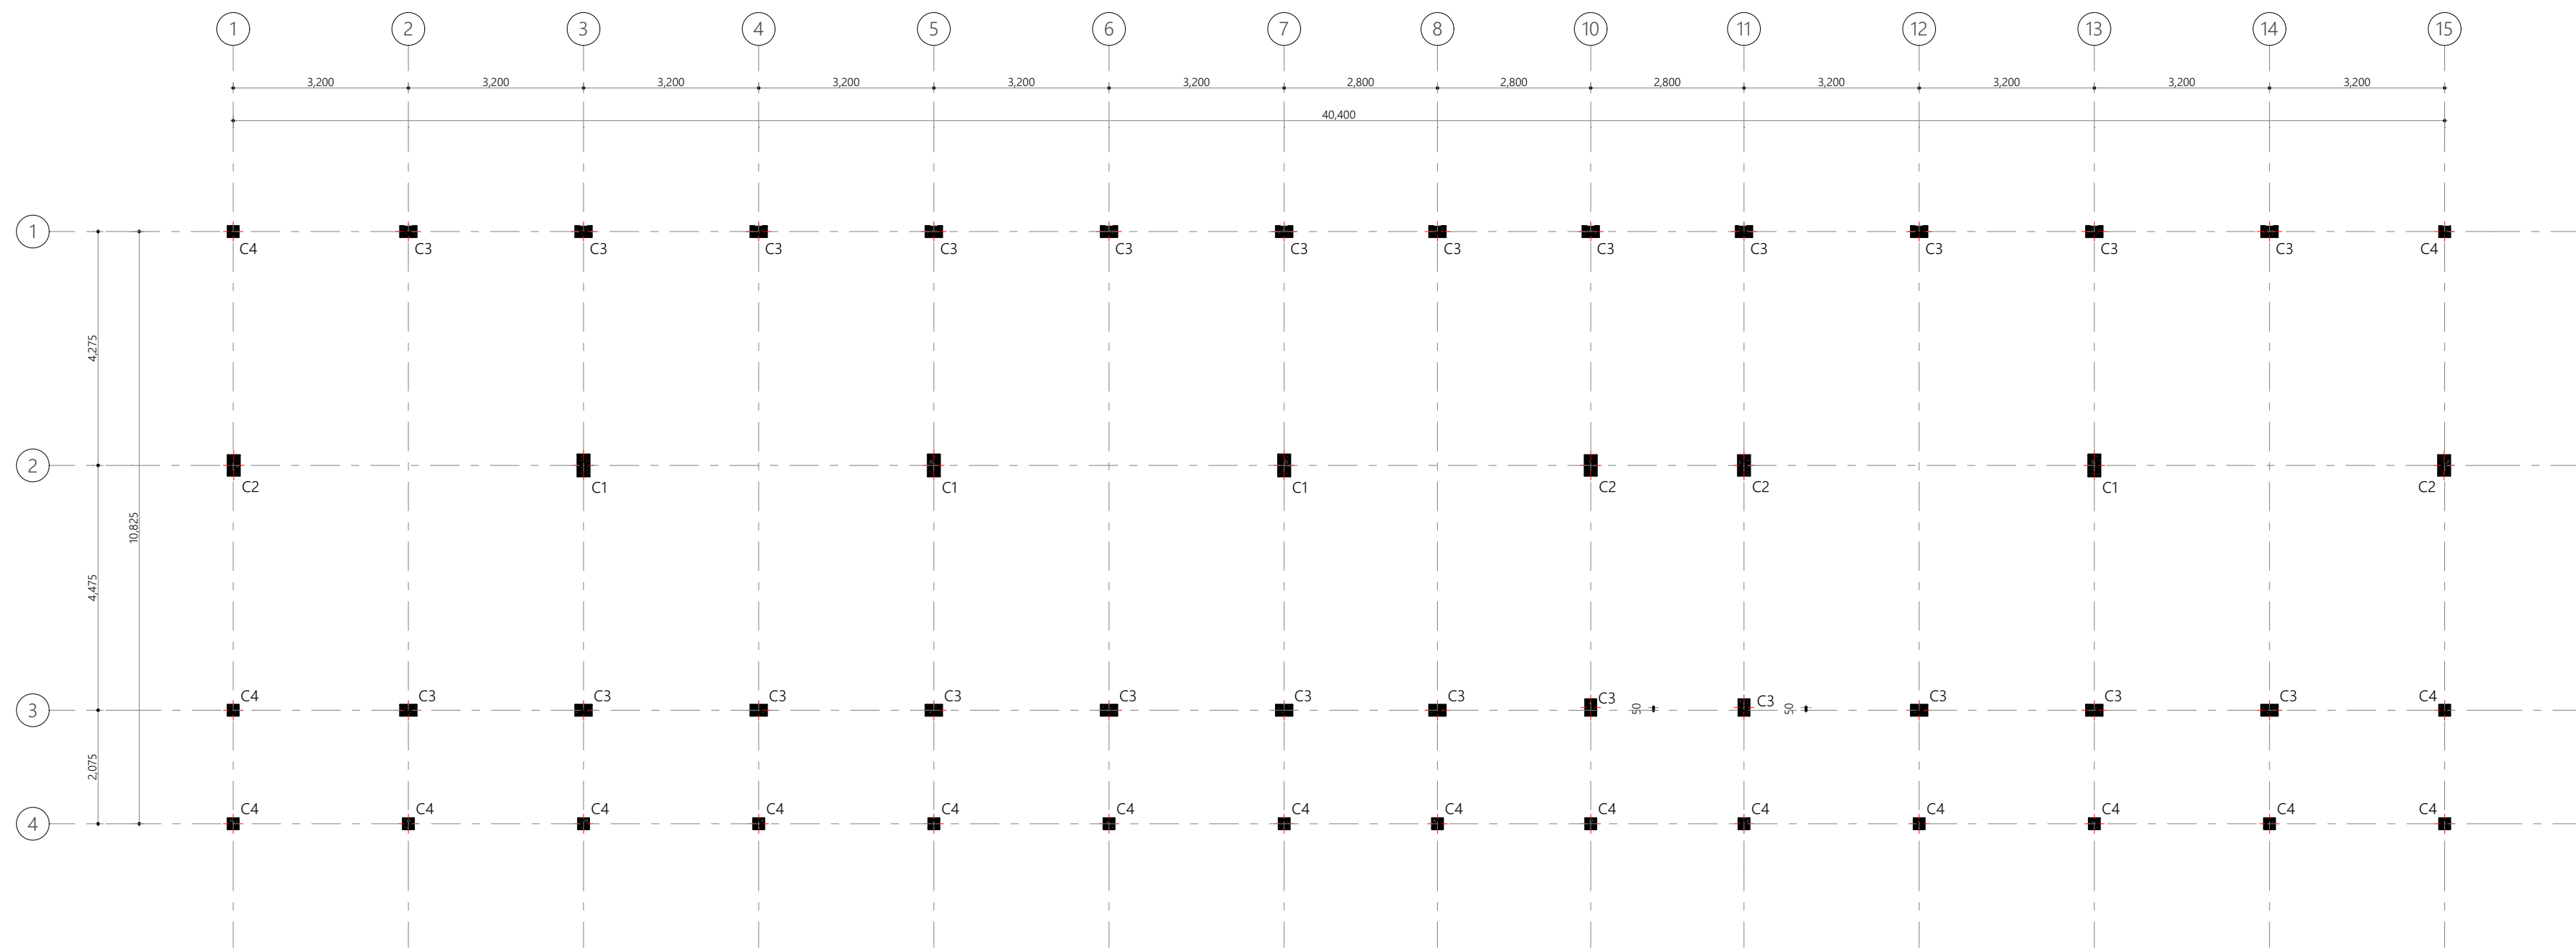

Column Layout  
1:100

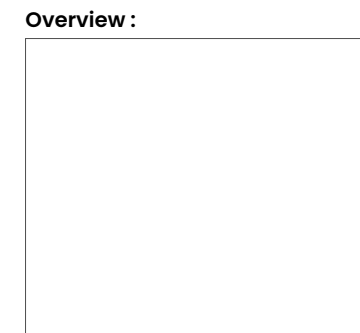

Legend :

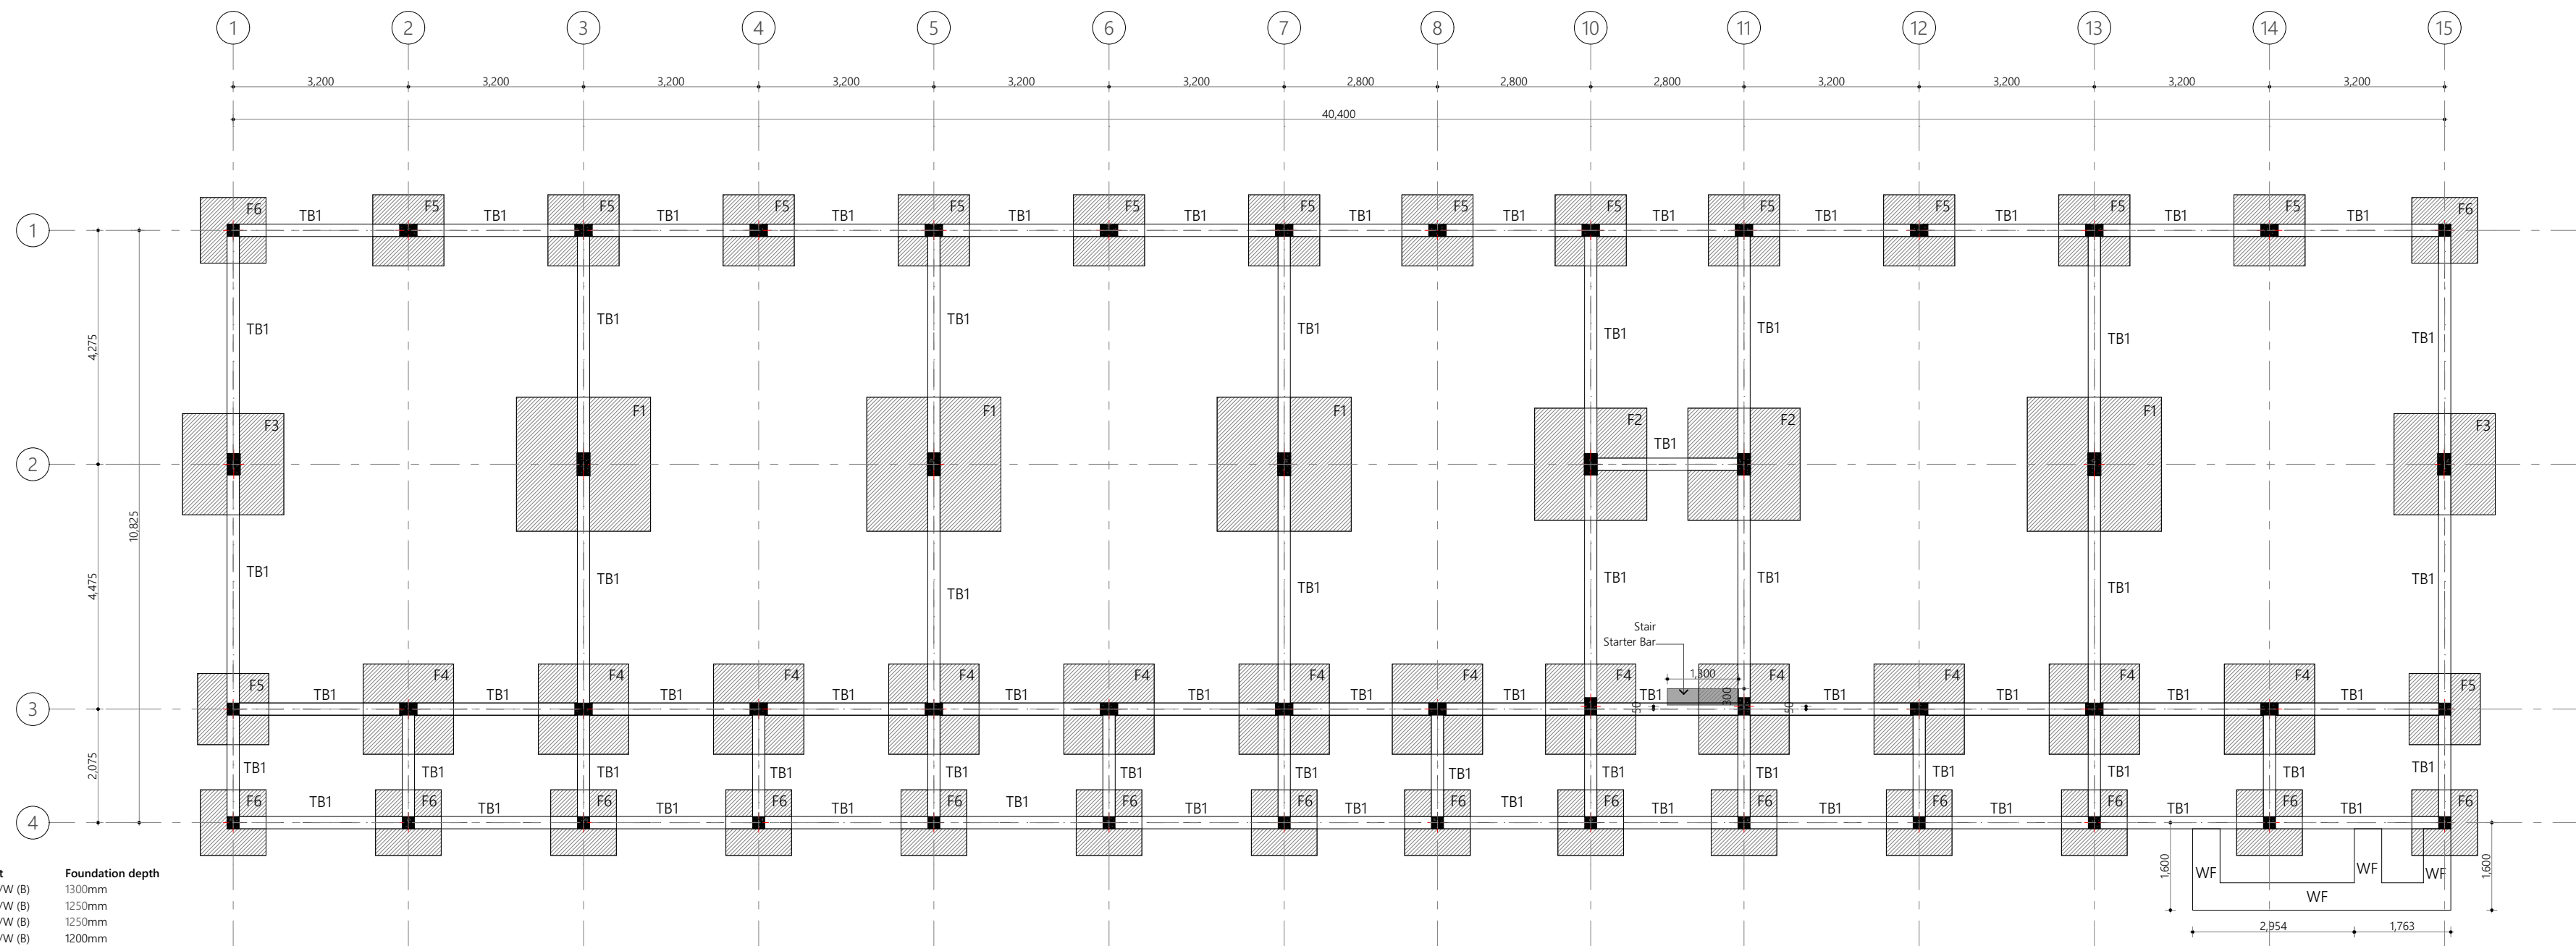

Foundation Details:

	Dimensions	Reinforcement	Foundation depth
F1	2450X2450X450	T12@100C/C B/W (B)	1300mm
F2	2050X2050X400	T12@125C/C B/W (B)	1250mm
F3	1850X1850X400	T12@150C/C B/W (B)	1250mm
F4	1650X1650X350	T12@150C/C B/W (B)	1200mm
F5	1300X1300X350	T12@150C/C B/W (B)	1200mm
F6	1200X1200X350	T12@150C/C B/W (B)	1200mm

Ground Slab = 100mm thick RC slab on fill reinforced with T10@200C/C (B/W)

All Footings are to be laid on top of 50mm thick lean concrete  
Add waterproofing admixture and apply waterproofing to all substructure (below ground elements)

Notes :

#	REVISION	BY	APP	DATE

**Project :**  
Ha Kelaa 12 Classroom Sen  
Room and Office Building

**Client :**  
Ministry of Education, Maldives

**Prepared by**

T: +960 333 3528, E: info@epochassociates,  
W: www.epochassociates, A/G Rosary West, 3<sup>rd</sup>  
Floor, Husnuheena Magu, Male', Maldives

DESIGNER: Muaviyath A. Sathar	CHECKED: F. Ihudha Amir
DRAWN: Mohamed Hassan	APPROVED: Ihsaan Waheed

**Page Title**  
Column Setting out & Foundation Plan


**Scale :** 1:100

**Doc No :** EP/BLD-AR/2022/08/AR-104  
**Date :** Wednesday, March 15,  
2023

**Rev No :** **Pg :** B.01.4


Foundation Plan  
1:100



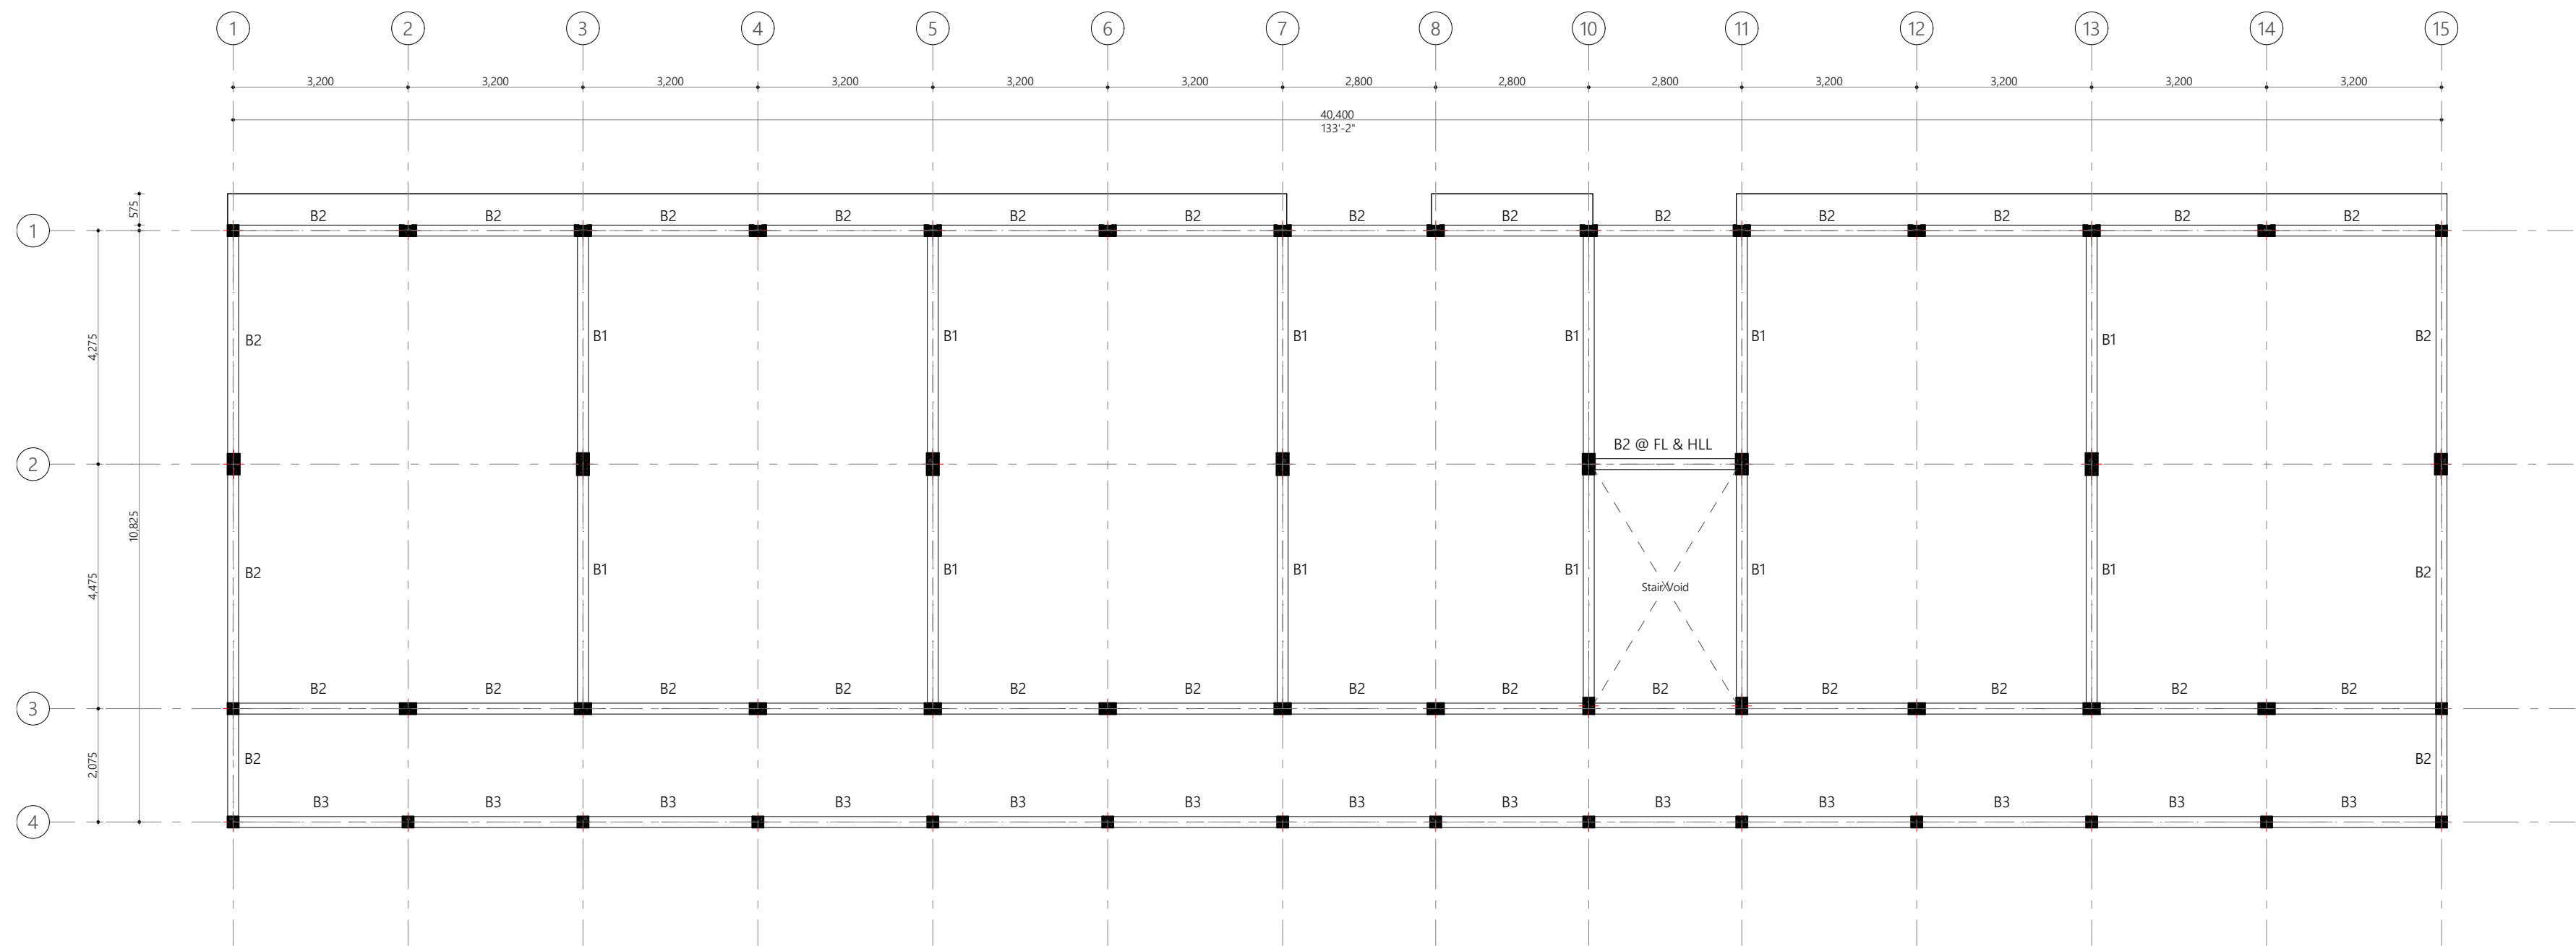


First and Second Floor Beam Plan  
1:100

Overview :



Legend :

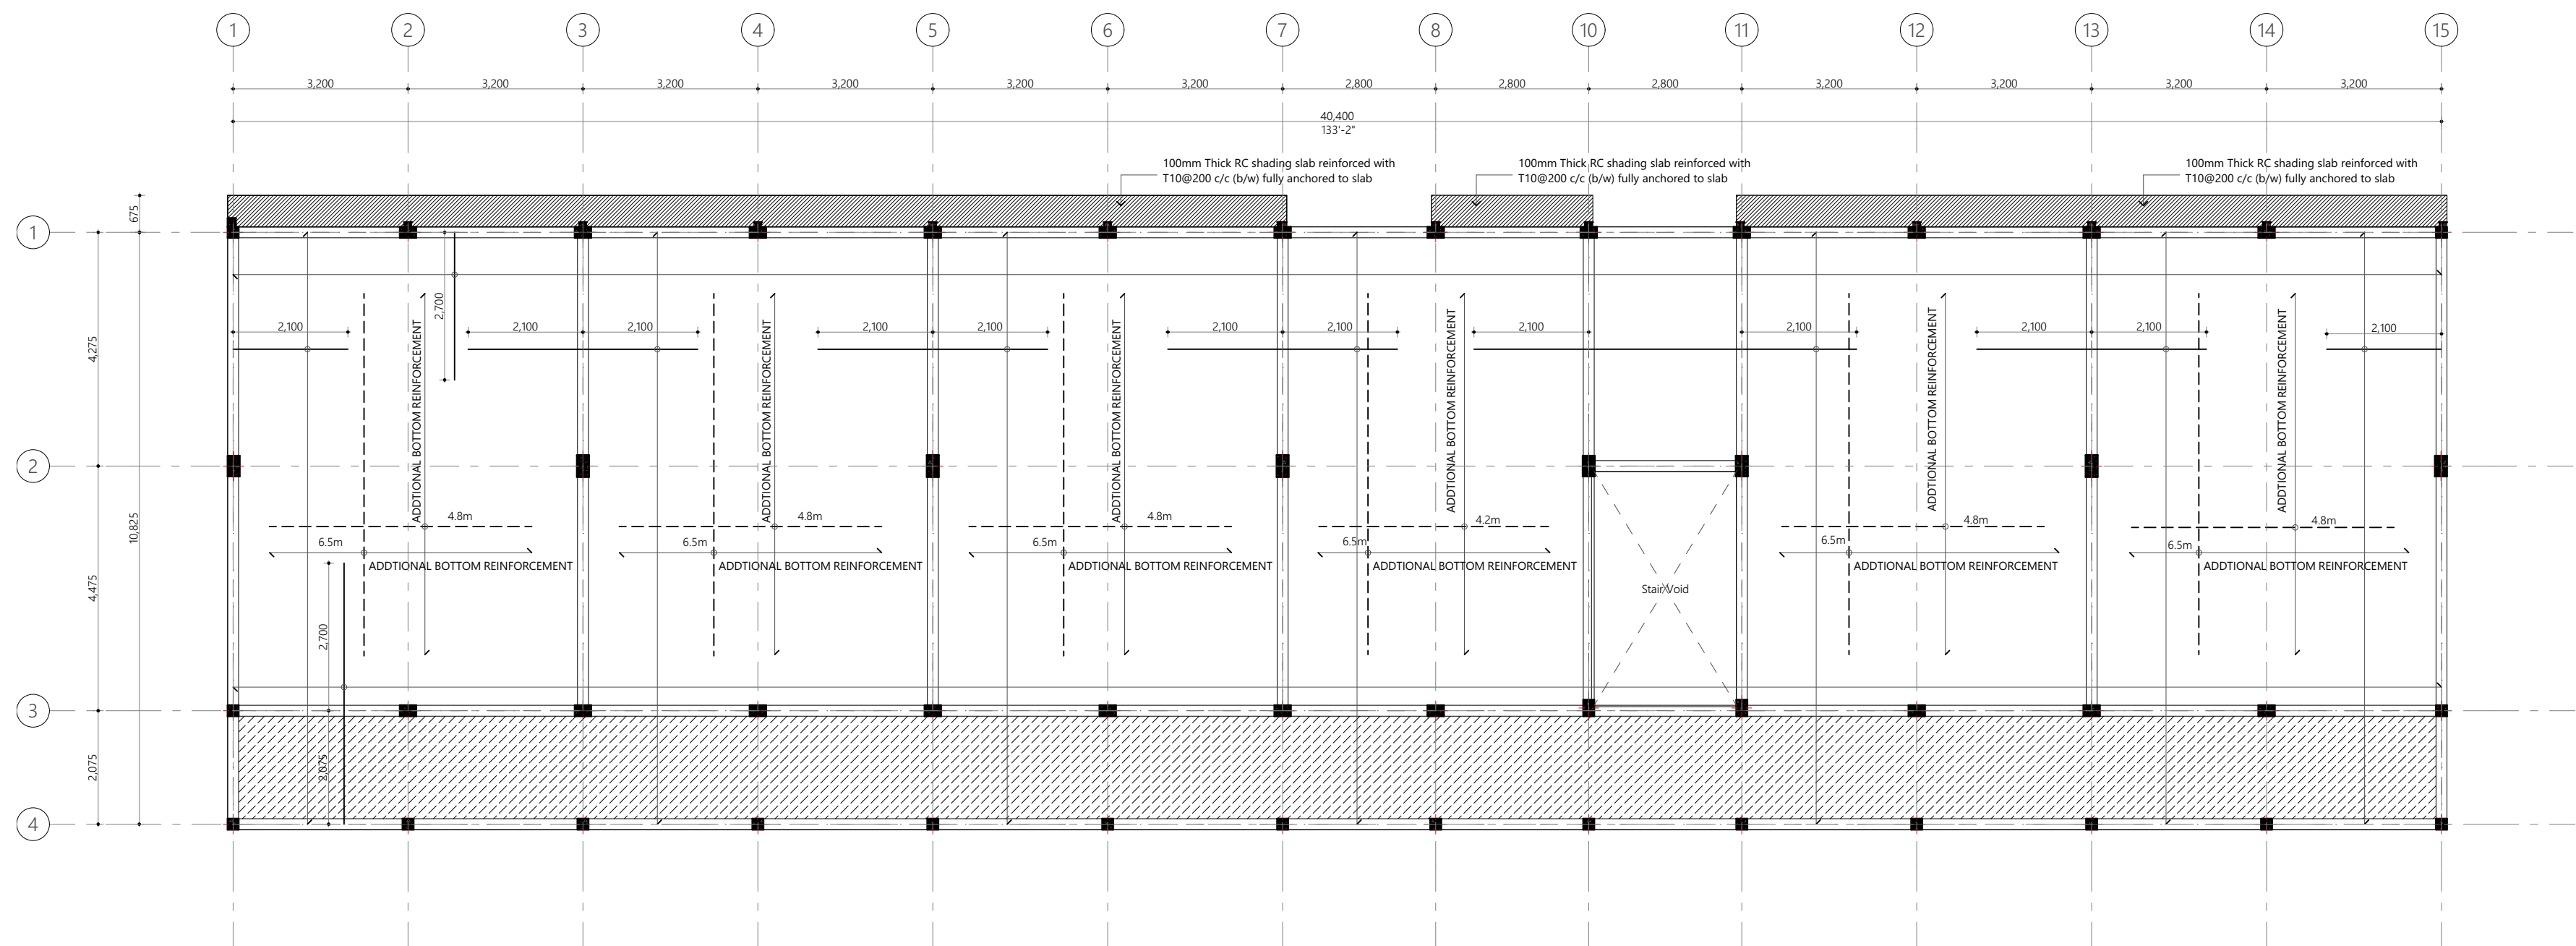

Notes :

#	REVISION	BY	APP	DATE

**Project :**  
Ha Kelaa 12 Classroom Sen  
Room and Office Building

**Client :**  
Ministry of Education, Maldives

**Prepared by**



T: +960 333 3528, E: info@epochassociates,  
W: www.epochassociates, A/G Rosary West, 3<sup>rd</sup>  
Floor, Huseinuheena Magu, Male', Maldives

DESIGNER: Muaviyath A. Sathar	CHECKED: F. Ithudha Amir
DRAWN: Mohamed Hassan	APPROVED: Ihsaan Waheed

**Page Title**  
First to Second Floor Beam & Slab Plan

**Scale :** 1:100


**Doc No :** EP/BLD-AR/2022/08/AR-104  
**Date :** Wednesday, March 15,  
2023

**Rev No :** **Pg :** B.02.1

First and Second Floor Slab Reinforcement Plan  
1:100

Bottom Reinforcement:  
--- Bottom Additional Reinforcement:  
--- Top Reinforcement:  
Top Distribution steel:


T12@150c/c B/W (Not Shown)  
T12@150c/c B/W (As shown)  
T12@150c/c (As shown,  
unless stated)  
T12@150c/c (Unless stated)

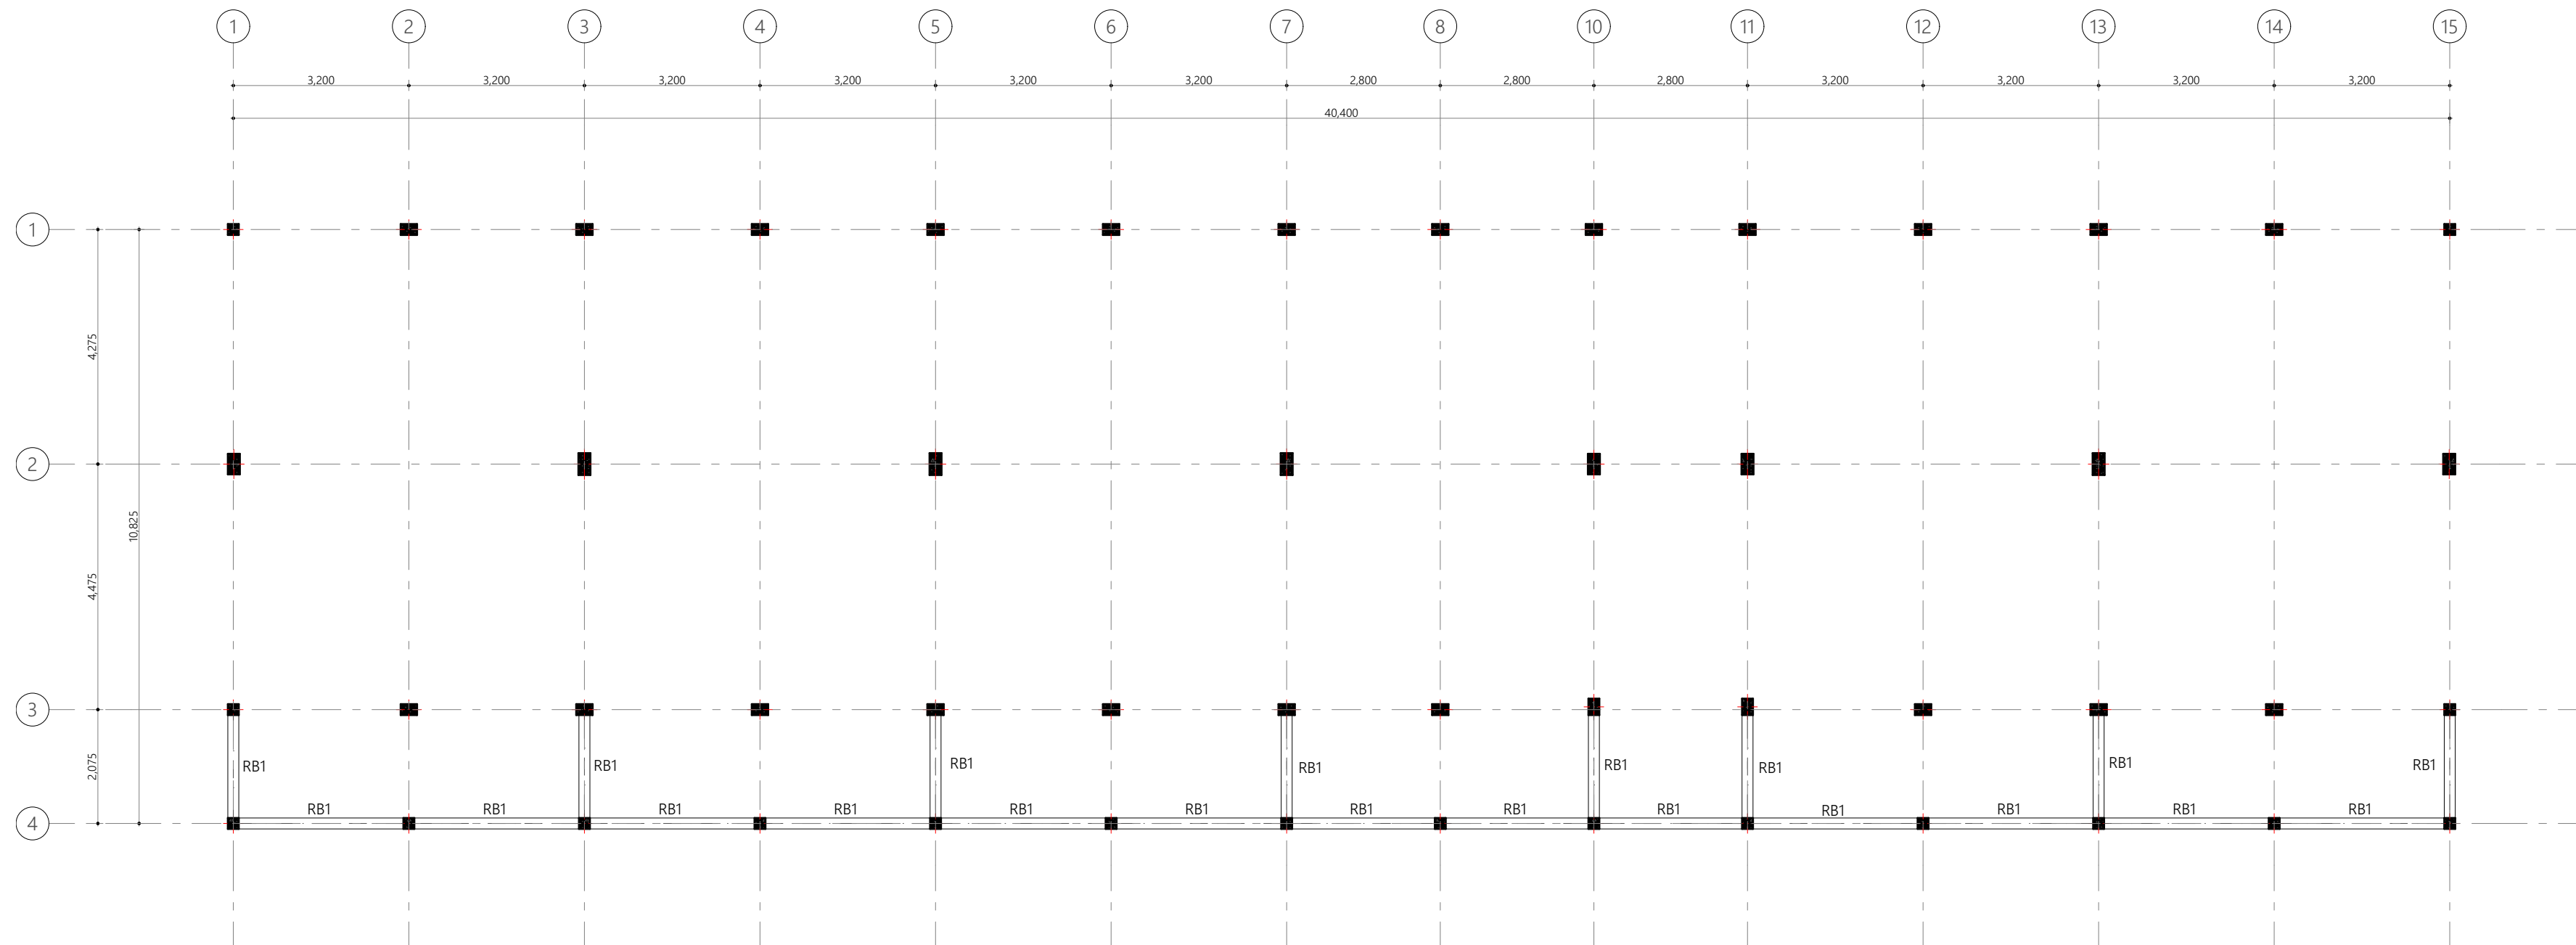

Roof Beam Level 1  
1:100

Overview :

Legend :

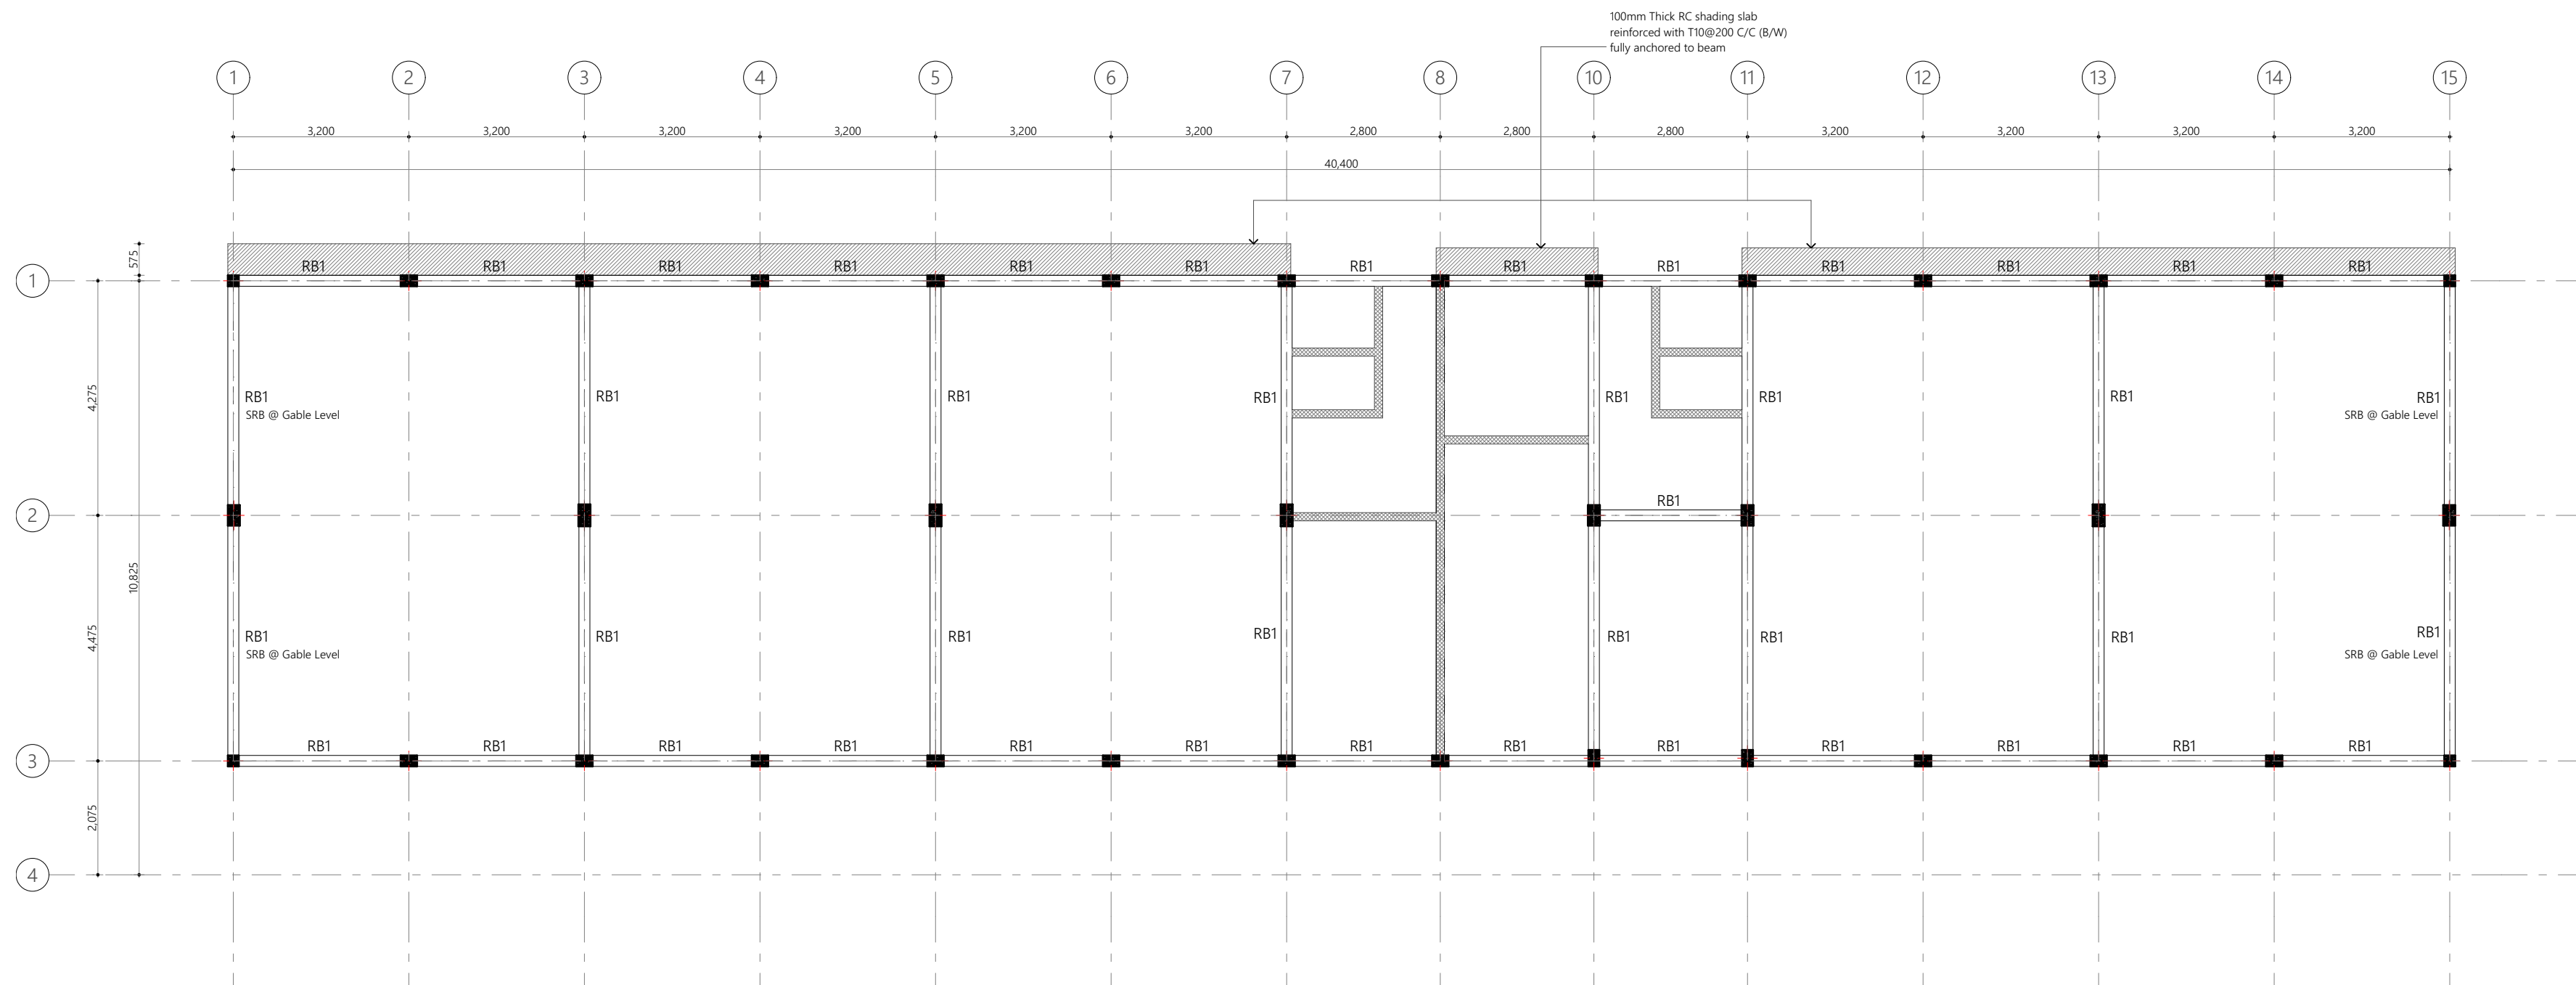

Roof Beam Level 2  
1:100

Notes:

▨ WCB (Wall cast beam cast on to

Notes :

#	REVISION	BY	APP	DATE	

**Project :**  
Ha Kelaa 12 Classroom Sen  
Room and Office Building

**Client :**  
Ministry of Education, Maldives

**Prepared by**



T: +960 333 3528, E: info@epochassociates,  
W: www.epochassociates, A/G Rosary West, 3<sup>rd</sup>  
Floor, Husnuheena Magu, Male', Maldives


DESIGNER: Muaviyath A. Sathar	CHECKED: F. Ihudha Amir
DRAWN: Mohamed Hassan	APPROVED: Ihsaan Waheed

**Page Title**  
Roof Beam Level 1&2

**Scale :** 1:100


**Doc No :** EP/BLD-AR/2022/08/AR-104  
**Date :** Wednesday, March 15,  
2023

**Rev No :** **Pg :** B.02.2

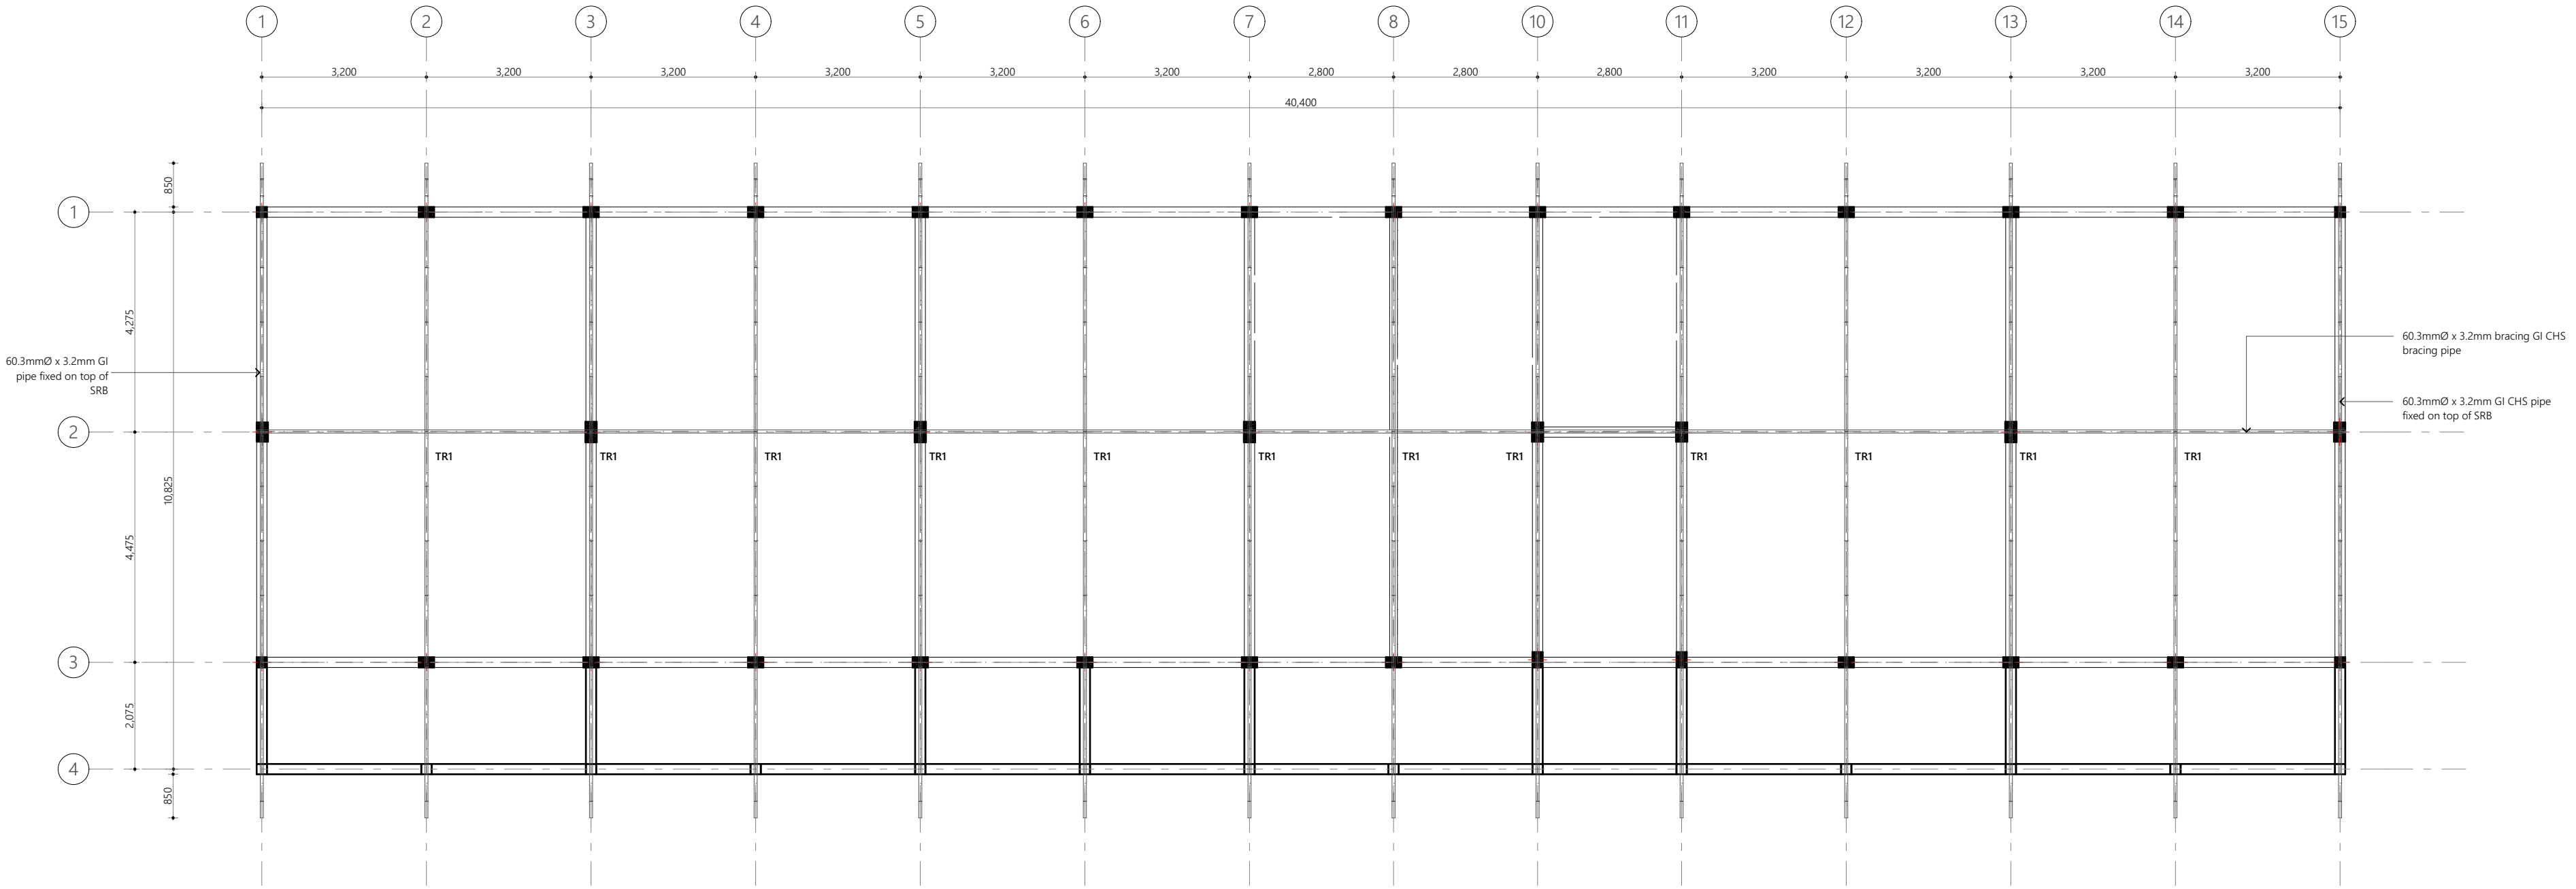


Roof Truss  
1:100

Overview :



Legend :

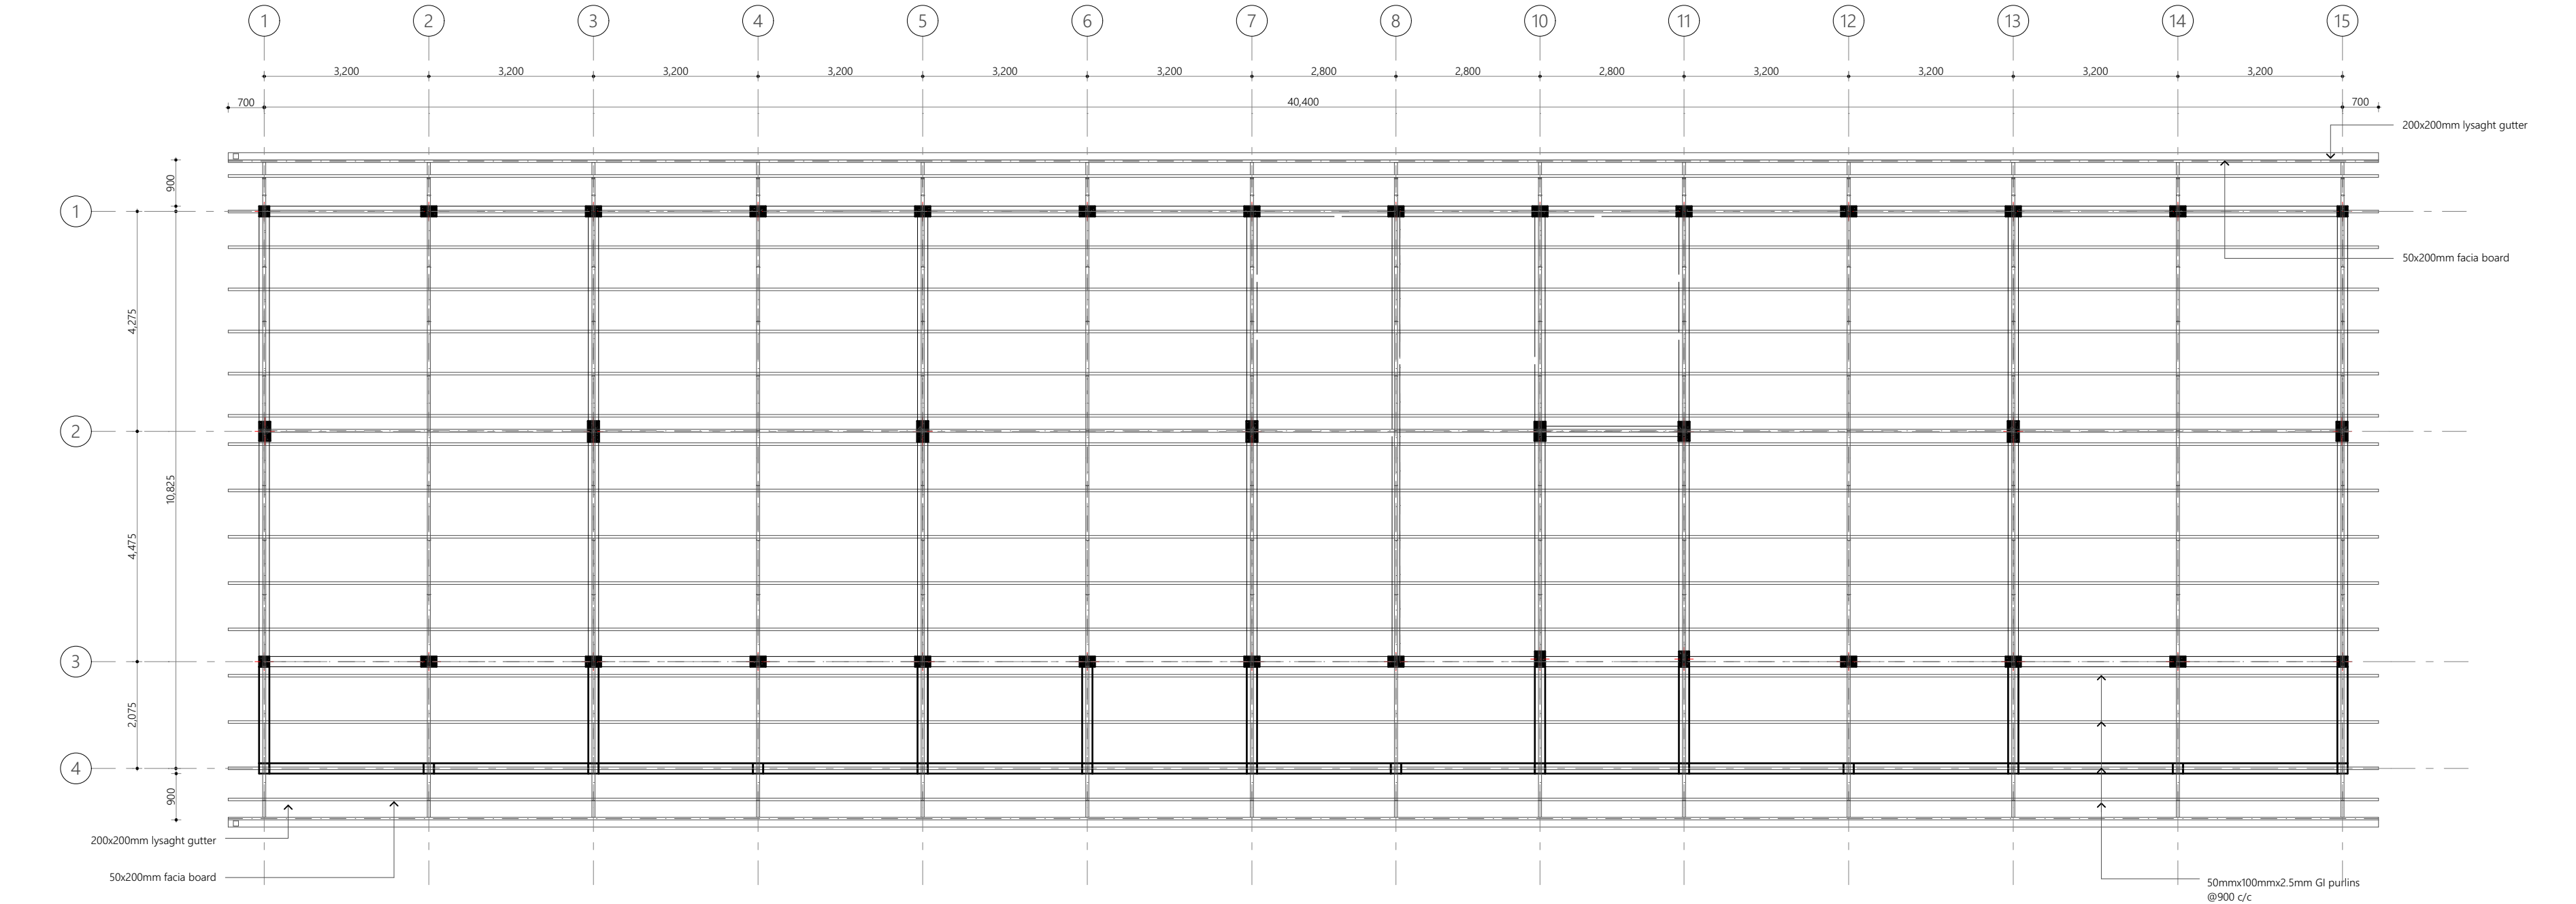

Roof Framing  
1:100

Notes :

#	REVISION	BY	APP	DATE

**Project :**  
Ha Kelaa 12 Classroom Sen  
Room and Office Building

**Client :**  
Ministry of Education, Maldives

**Prepared by**



T: +960 333 3528, E: info@epochassociates,  
W: www.epochassociates, A/G Rosary West, 3<sup>rd</sup>  
Floor, Husnuheena Magu, Male', Maldives

DESIGNER: Muaviyath A. Sathar	CHECKED: F. Ihudha Amir
DRAWN: Mohamed Hassan	APPROVED: Ihsaan Waheed

**Page Title**  
Roof Truss & Framing Plan

**Scale :** 1:100

**Doc No :** EP/BLD-AR/2022/08/AR-104  
**Date :** Wednesday, March 15,  
2023


**Rev No :** **Pg :** B.02.3

Foundation Details:

	Dimensions	Reinforcement	Foundation depth
F1	2450X2450X450	T12@100C/C B/W (8)	1300mm
F2	2050X2050X400	T12@125C/C B/W (8)	1250mm
F3	1850X1850X400	T12@150C/C B/W (8)	1250mm
F4	1650X1650X350	T12@150C/C B/W (8)	1200mm
F5	1300X1300X350	T12@150C/C B/W (8)	1200mm
F6	1200X1200X350	T12@150C/C B/W (8)	1200mm


Ground Slab = 100mm thick RC slab on fill reinforced with T10@200C/C (B/W)

All Footings are to be laid on top of 50mm thick lean concrete  
Add waterproofing admixture and apply waterproofing to all substructure (below ground elements)

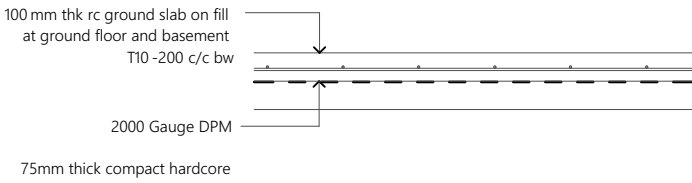


NOTE:  
All cover blocks shall be casted using grade C 25 / 30 concrete with 5-10 mm aggregates

For slab, rebar spacer chairs spacing shall be minimum 1m spacing or 1no. per 1 sqm




TB1

Foundation Details  
1:100

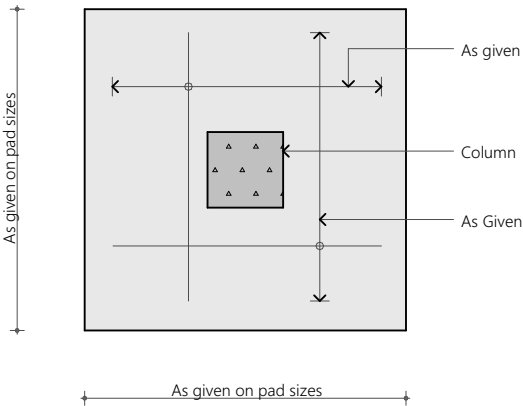


Plan View

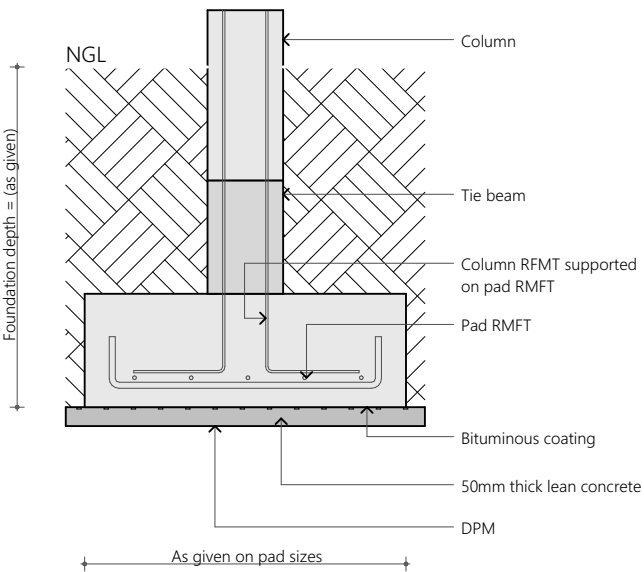


Sectional View

Typical Pad Footing Detail  
1:20


Ground Slab Detail  
1:20

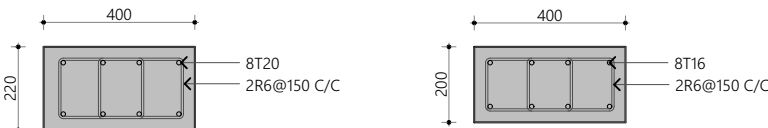


C1

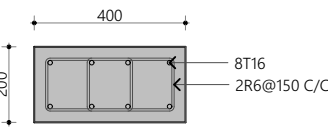

C2

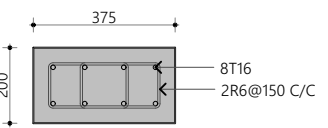

C3

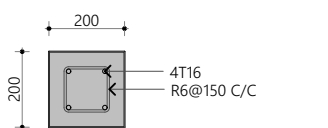


C4



Column Details  
1:20

Notes:  
Cover to foundations = 55mm  
Cover to floor slabs = 30mm  
Cover to floor beams = 35mm  
Cover to columns = 40mm  
Laps = 45Dia (Dia=Bar Diameter)  
Mid bars = 0.85 x Span  
Sup bars = 1/3 x Span  
Concrete mix = 1:2:3 (C:S:A)  
Lean concrete mix = 1:2:5


Tie Beam Details  
1:20

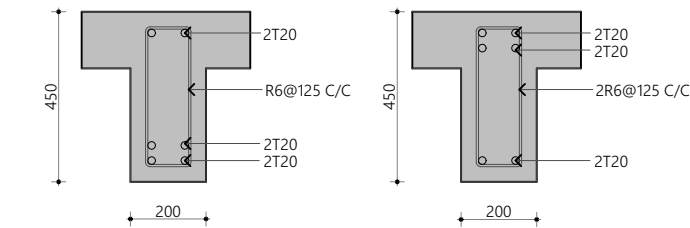


B1

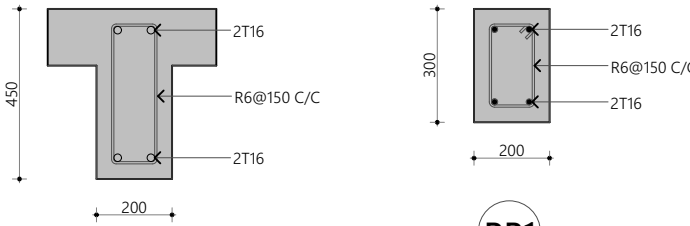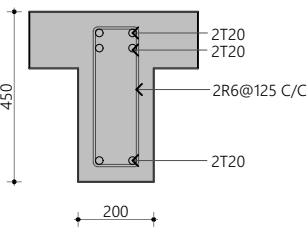



B3



RB1

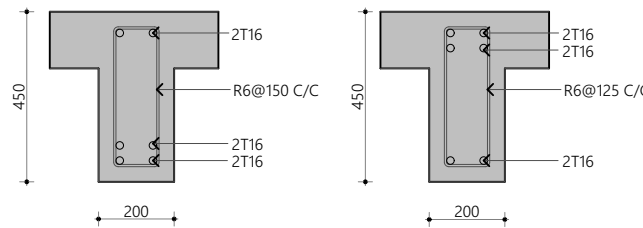


B2

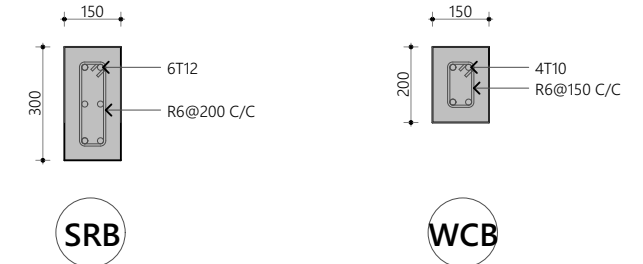

SRB


SRB (Sloping roof beam cast on top of wall at gable level)



WCB

Beam Details  
1:20

Overview :



Legend :

Notes :

#	REVISION	BY	APP	DATE

Project :

Ha Kelaa 12 Classroom Sen Room and Office Building

Client :

Ministry of Education, Maldives

Prepared by



T: +960 333 3528, E: info@epochassociates,  
W: www.epochassociates, A/G Rosary West, 3<sup>rd</sup> Floor, Huseinuheena Magu, Male', Maldives

DESIGNER: Muaviyath A. Sathar	CHECKED: F. Ihudha Amir
DRAWN: Mohamed Hassan	APPROVED: Ihsaan Waheed

Page Title

Structural Details-1

Scale :


1:20, 1:100

Doc No : EP/BLD-AR/2022/08/AR-104  
Date : Wednesday, March 15, 2023

Rev No :

Pg : C.01.1




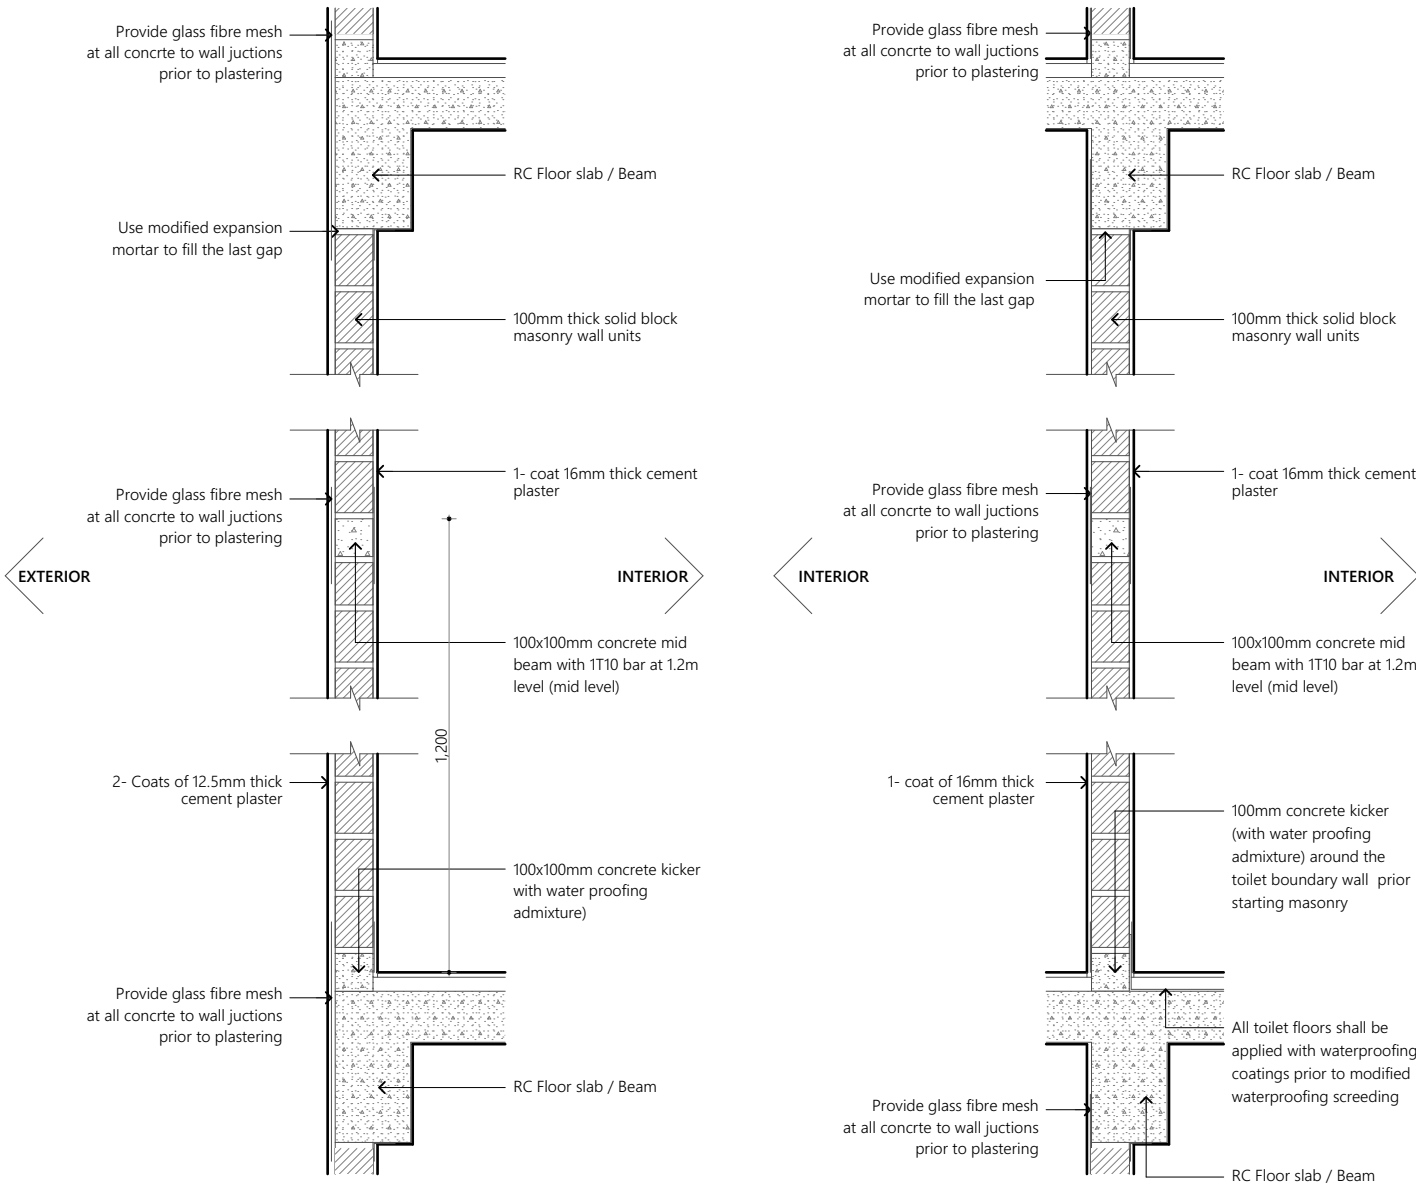


**Note:**

- \* Concrete surfaces shall be thoroughly cleaned with water & applied with mastercast 141 or equivalent bonding mortar prior to plastering.
- \* Plastering mortar mix shall be 1:4 (cement: sand) ratio.
- \* Plaster mix shall be modified using fibre wool & mastercast 141 or equivalent plasticisers as per manufacturer's specification.
- \* Height of placing blocks shall be maximum 1.2m per day.
- \* After initial coat of plastering, water curing shall be provided for minimum 3 days & after final coat water curing shall be provided for 7 days.


**Typical Wall Construction Detail**  
1:20

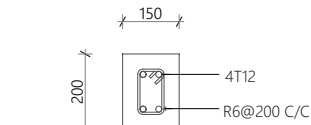

**LT1**  
LINTELS OVER ALL DOORS, WINDOWS  
(THAT DOES NOT RISE TO BEAM LEVEL)  
LT1 FOR WINDOWS < 1.5M




**LT2**  
LINTELS OVER ALL DOORS, WINDOWS  
(THAT DOES NOT RISE TO BEAM LEVEL)  
LT2 FOR WINDOWS > 1.5M & <3.0M




**LT3**  
LINTELS OVER ALL DOORS, WINDOWS  
(THAT DOES NOT RISE TO BEAM LEVEL)  
LT3 FOR WINDOWS > 3.0M & <6.0M

**Lintel Beam Detail**  
1:20



**LB1**


**Sill Beam Detail**  
1:20

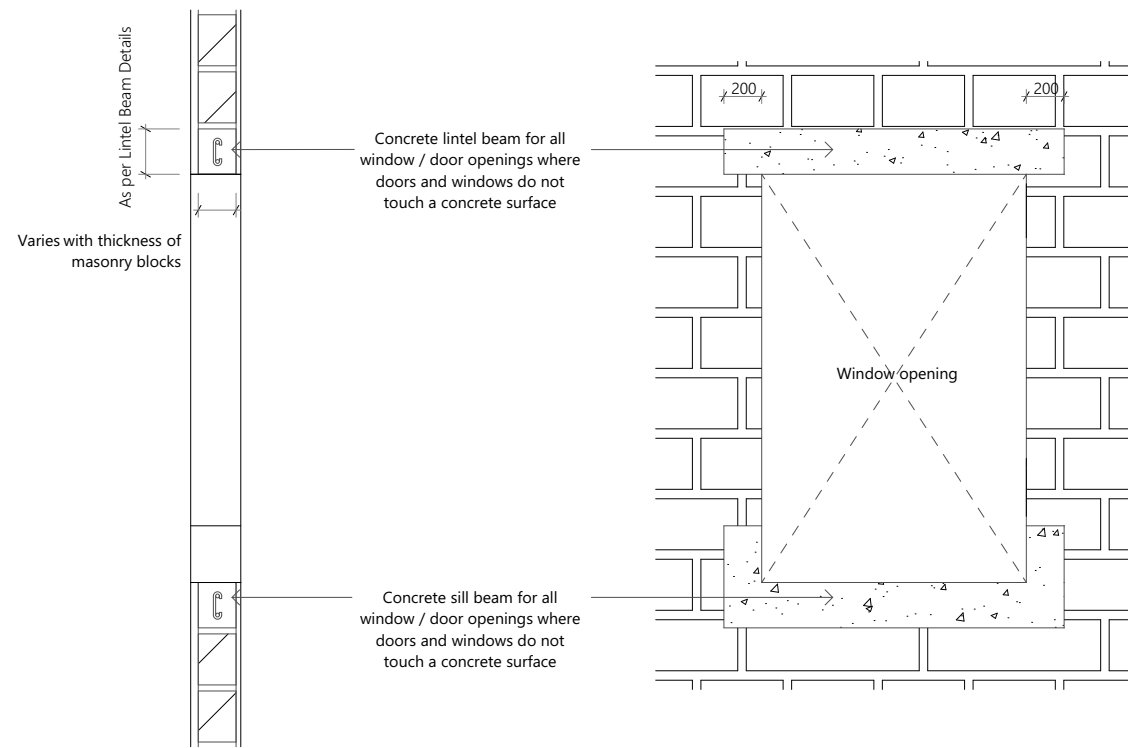

**Typical Window Construction Detail**

**Typical Window Construction Detail**  
1:20

**Overview :**



**Legend :**

**Notes :**

#	REVISION	BY	APP	DATE

**Project :**  
Ha Kelaa 12 Classroom Sen  
Room and Office Building

**Client :**  
Ministry of Education, Maldives

**Prepared by**



T: +960 333 3528, E: info@epochassociates,  
W: www.epochassociates, A/G Rosony West, 3<sup>rd</sup>  
Floor, Husnuheena Magu, Male', Maldives


DESIGNER: Muaviyath A. Sathar	CHECKED: F. Ihudha Amir
DRAWN: Mohamed Hassan	APPROVED: Ihsaan Waheed

**Page Title**  
Wall & Window Construction Detail

**Scale :** 1:20

**Doc No :** EP/BLD-AR/2022/08/AR-104  
**Date :** Wednesday, March 15,  
2023

**Rev No :** **Pg :** C.01.2

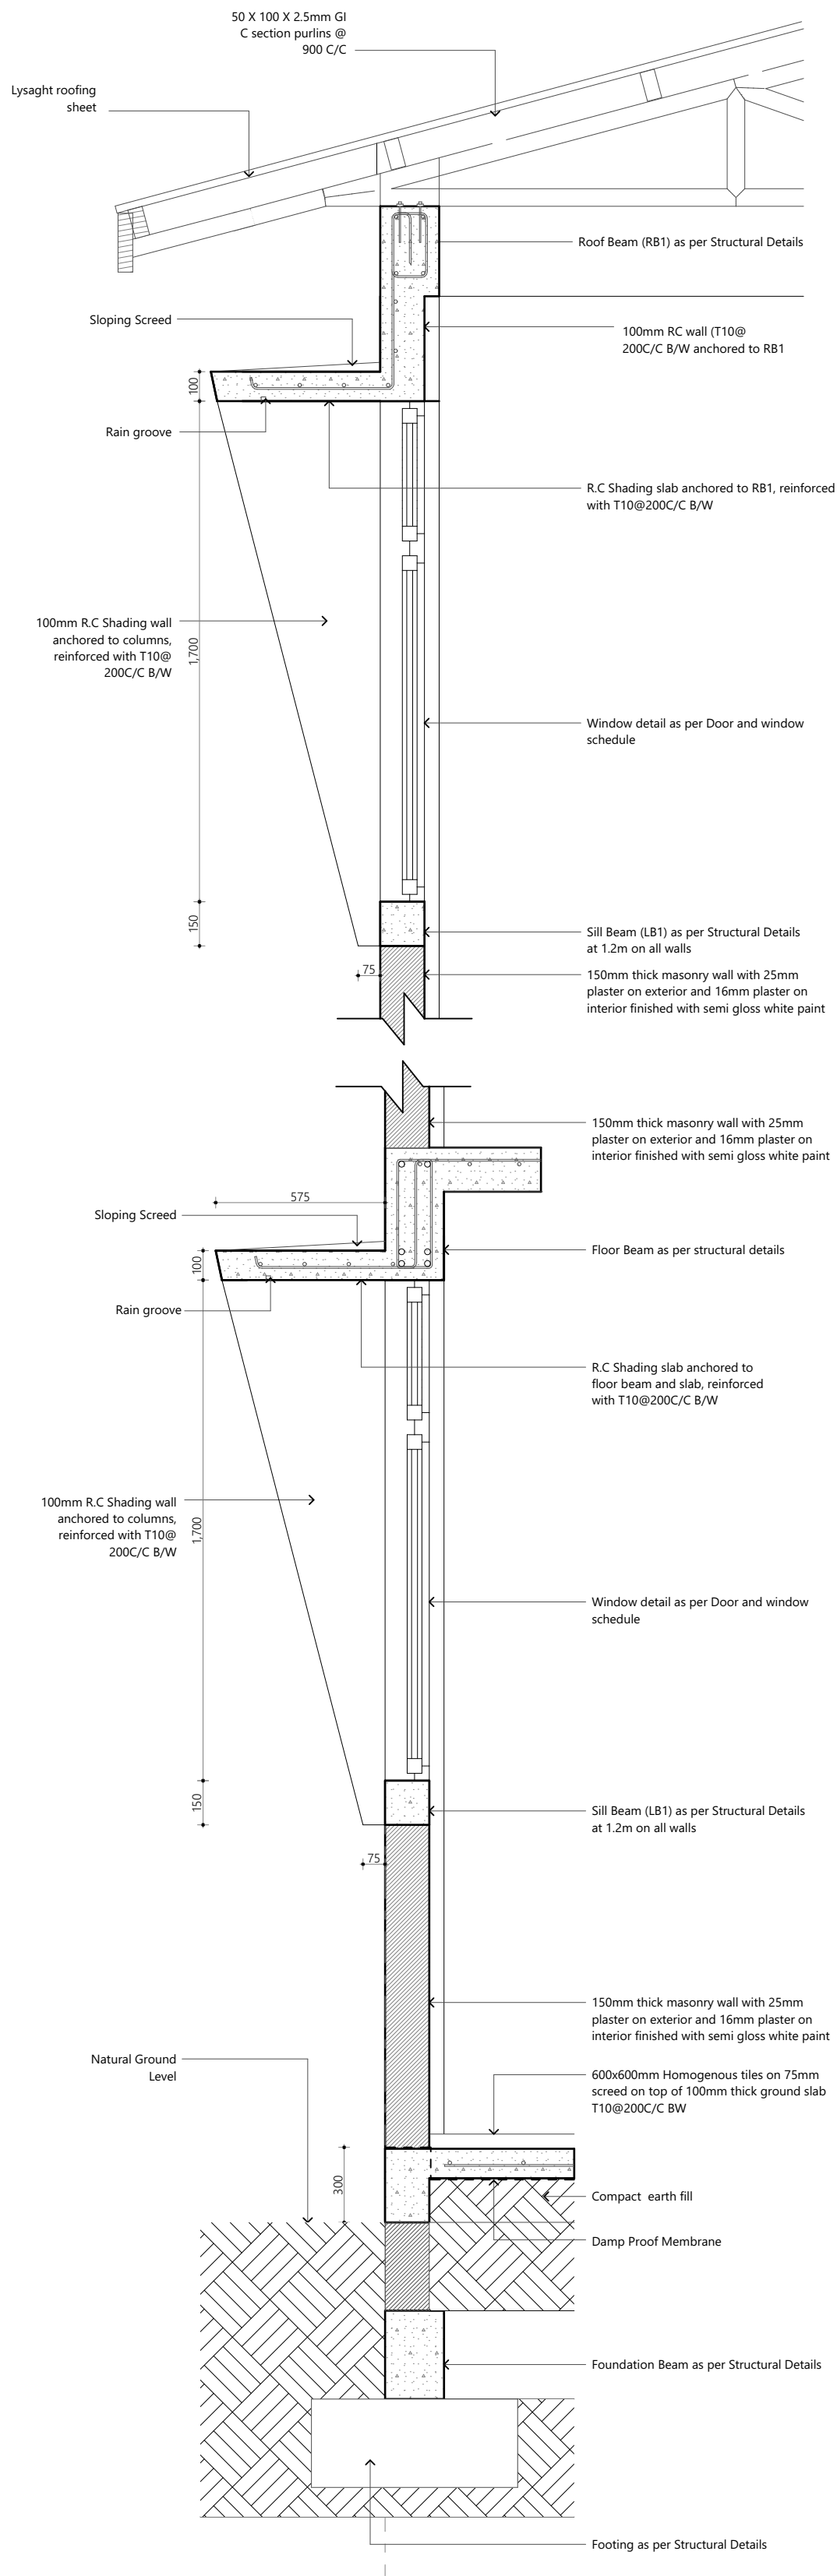

Detail D-02  
1:20

Ha Kelaa 12  
Classroom Sen  
Room and Office  
Building  
Client  
Ministry of Education,  
Maldives


3/15/2023  
Architect: Fathmath Iruudha Amir  
Engineer: Ihsaan Waheed  
Drawn By: Fathmath Iruudha Amir



**EPOCH**


T: +960 333 3520 | info@epoch.associates  
W: www.epoch.associates | M: Atiqadhinshuge,  
Farooqee Maga Maki Republic of Maldives

Rev	Page
...	C.01.3

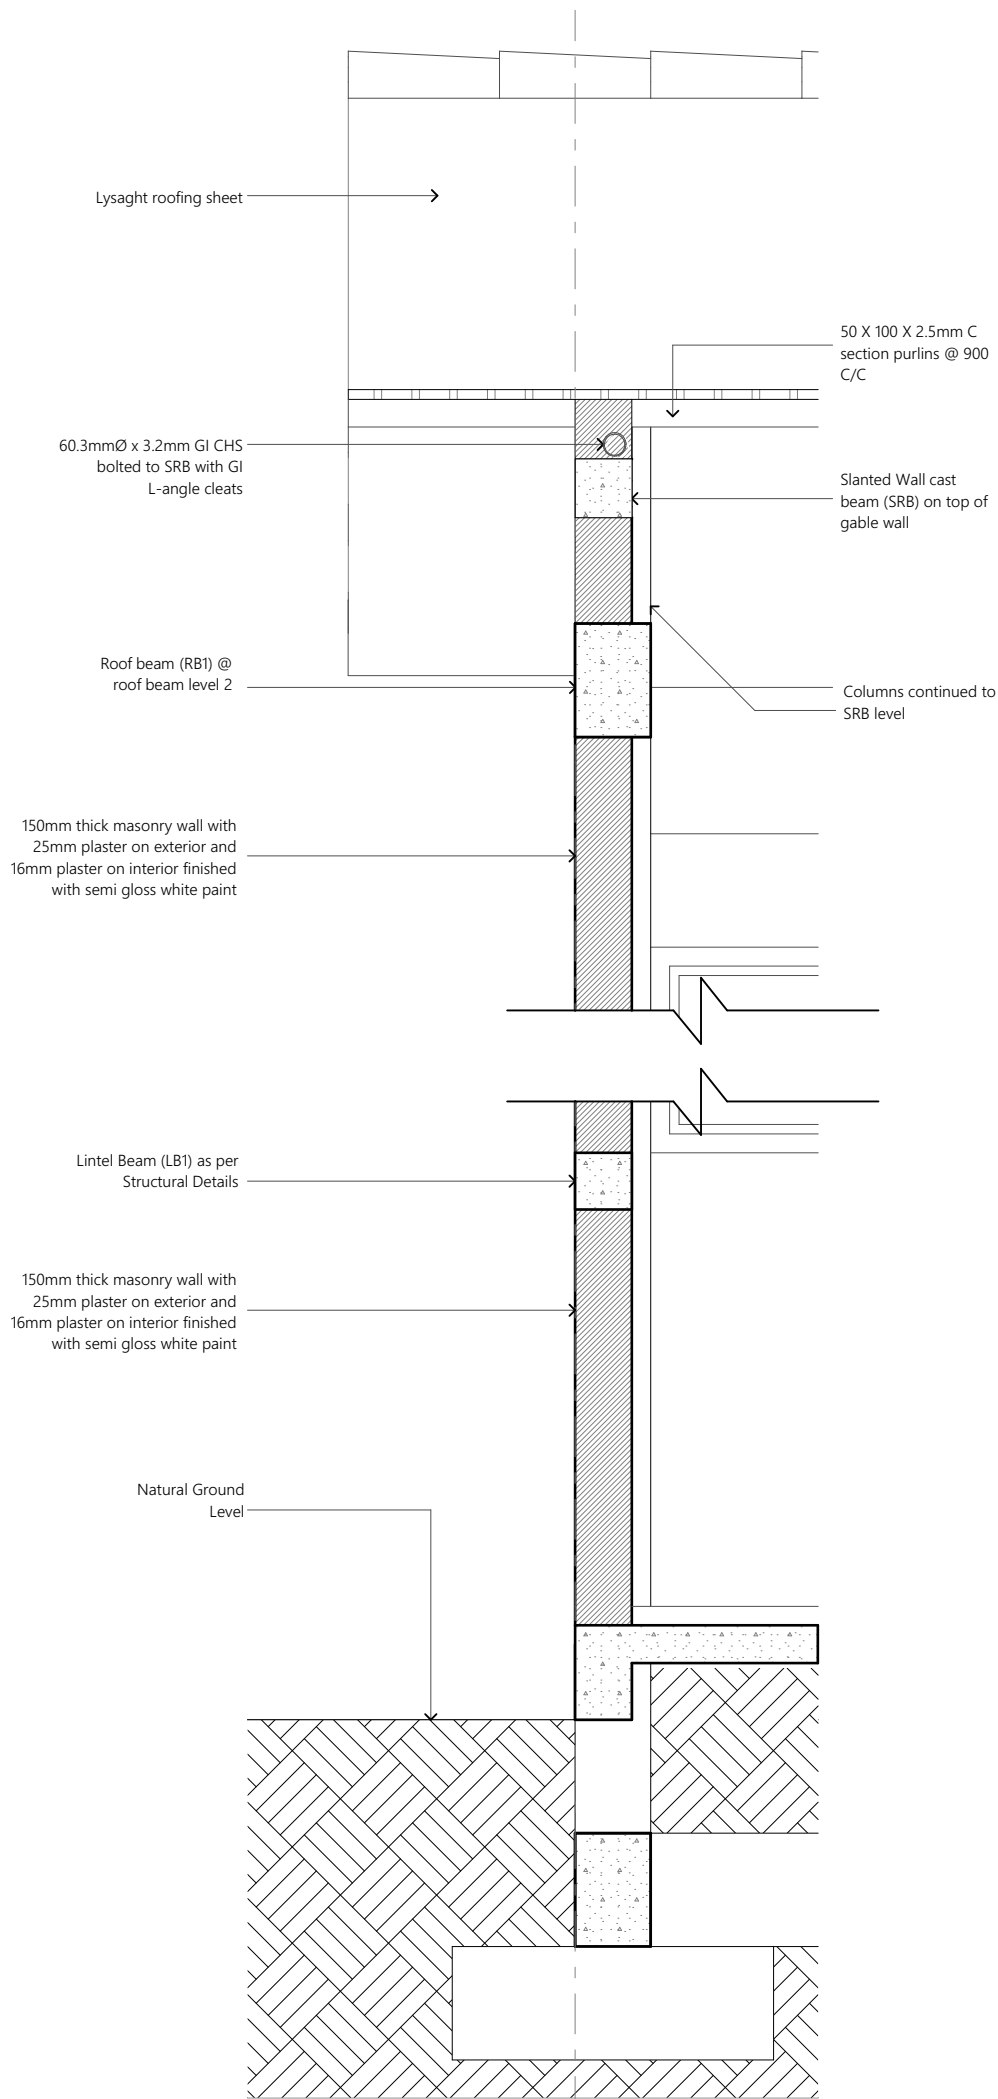

Detail D-04  
1:20

Overview :



Legend :

Notes :

#	REVISION	BY	APP	DATE

Project :

Ha Kelaa 12 Classroom Sen  
Room and Office Building

Client :

Ministry of Education, Maldives

Prepared by



T: +960 333 3528, E: info@epochassociates,  
W: www.epochassociates, A/G Rosony West, 3<sup>rd</sup>  
Floor, Husnuheena Magu, Male', Maldives

DESIGNER: Muaviyath A. Sathar	CHECKED: F. Ihudha Amir
DRAWN: Mohamed Hassan	APPROVED: Ihsaan Waheed

Page Title

Top to Bottom Detail 2

Scale :


1:20

Doc No : EP/BLD-AR/2022/08/AR-104

Date : Wednesday, March 15,  
2023

Rev No :


Pg : C.01.4

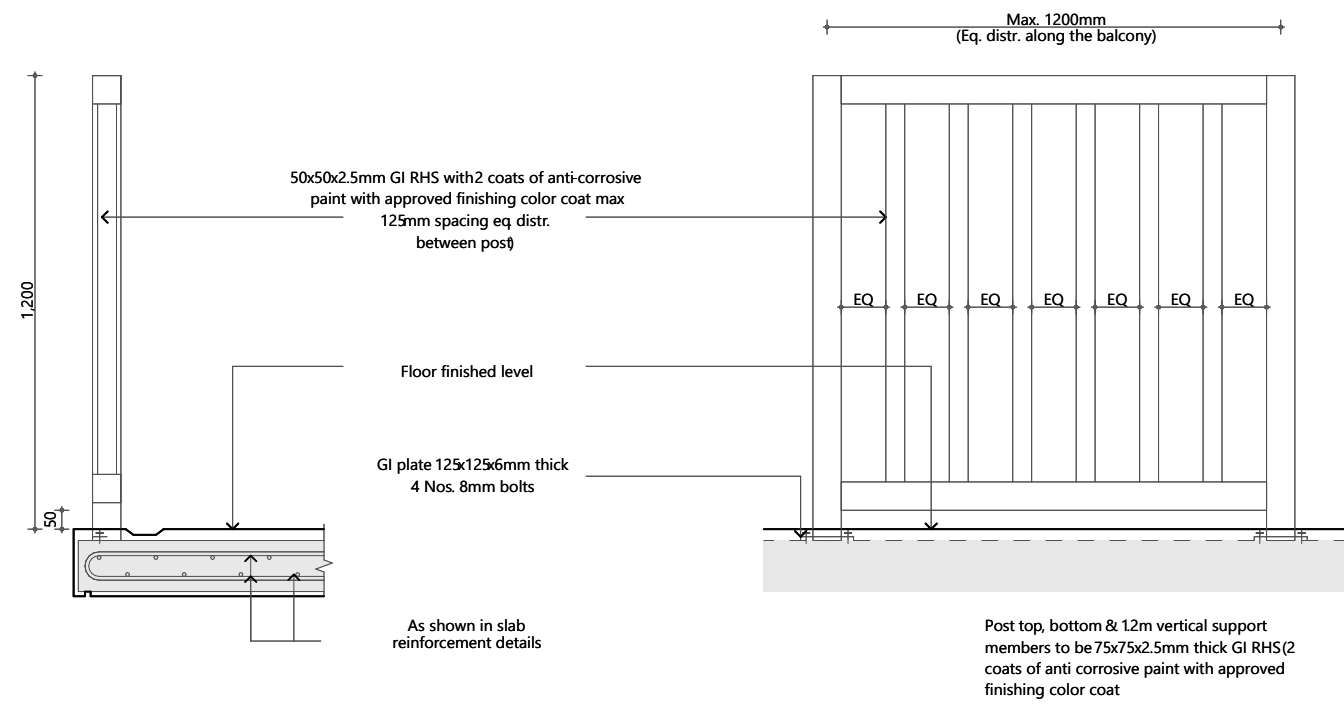


Sectional View

Elevation View


Balcony Detail  
1:20

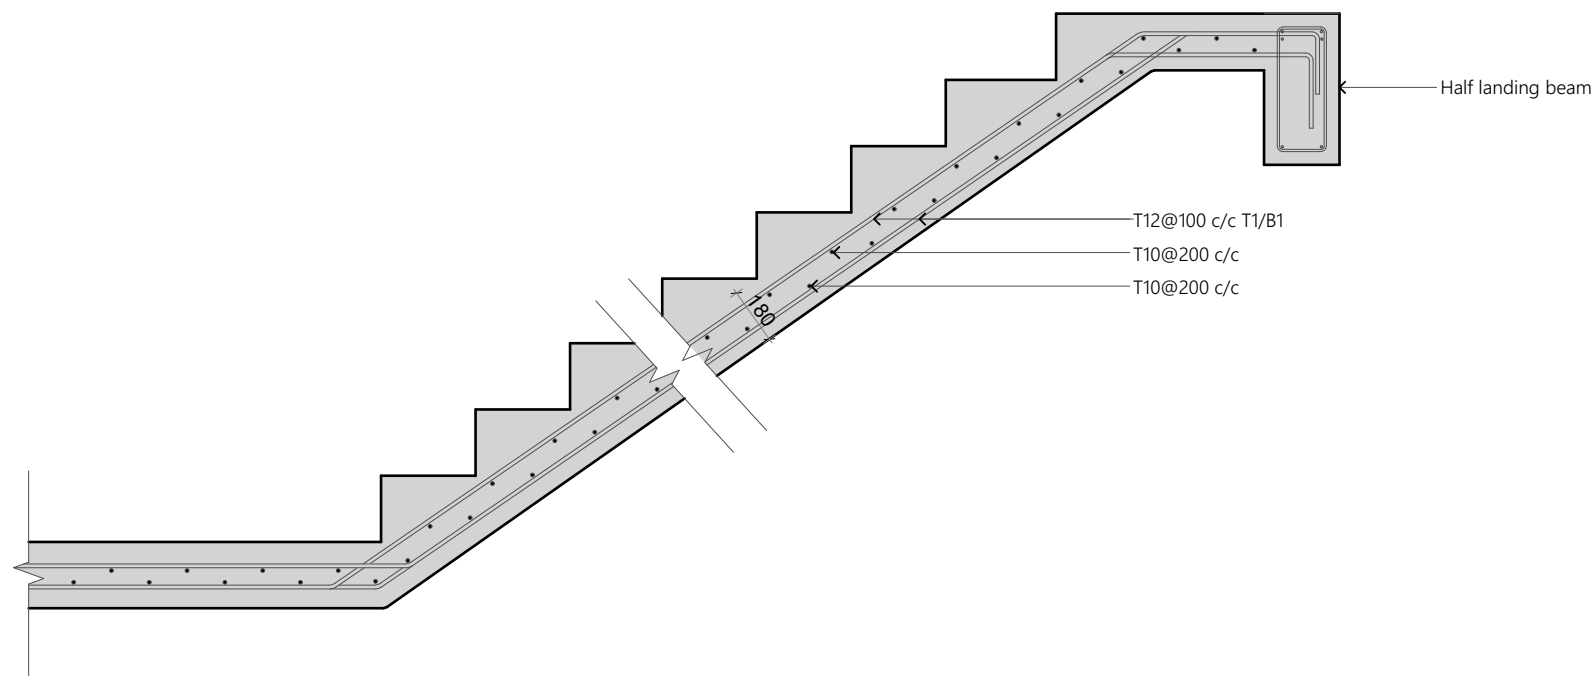


Stair Reinforcement Detail  
1:20

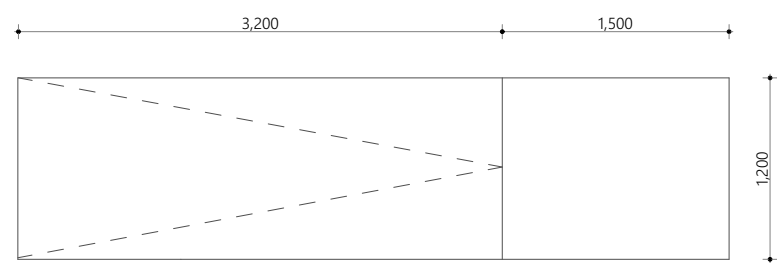

Ground Floor Ramp Plan View

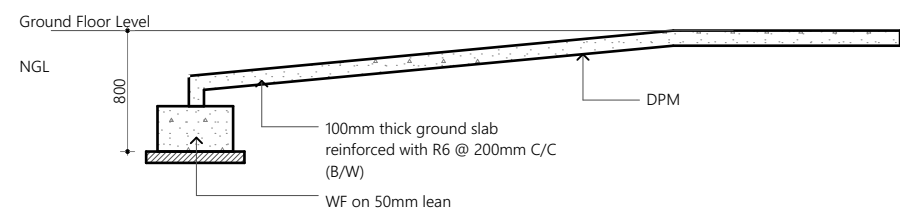


Ground Floor Ramp Elevation View

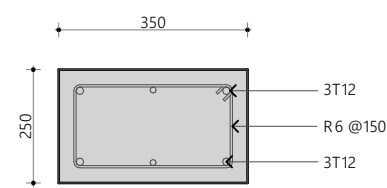


Wall Footing (WF) Detail  
Scale = 1:20

Ramp Detail  
1:50

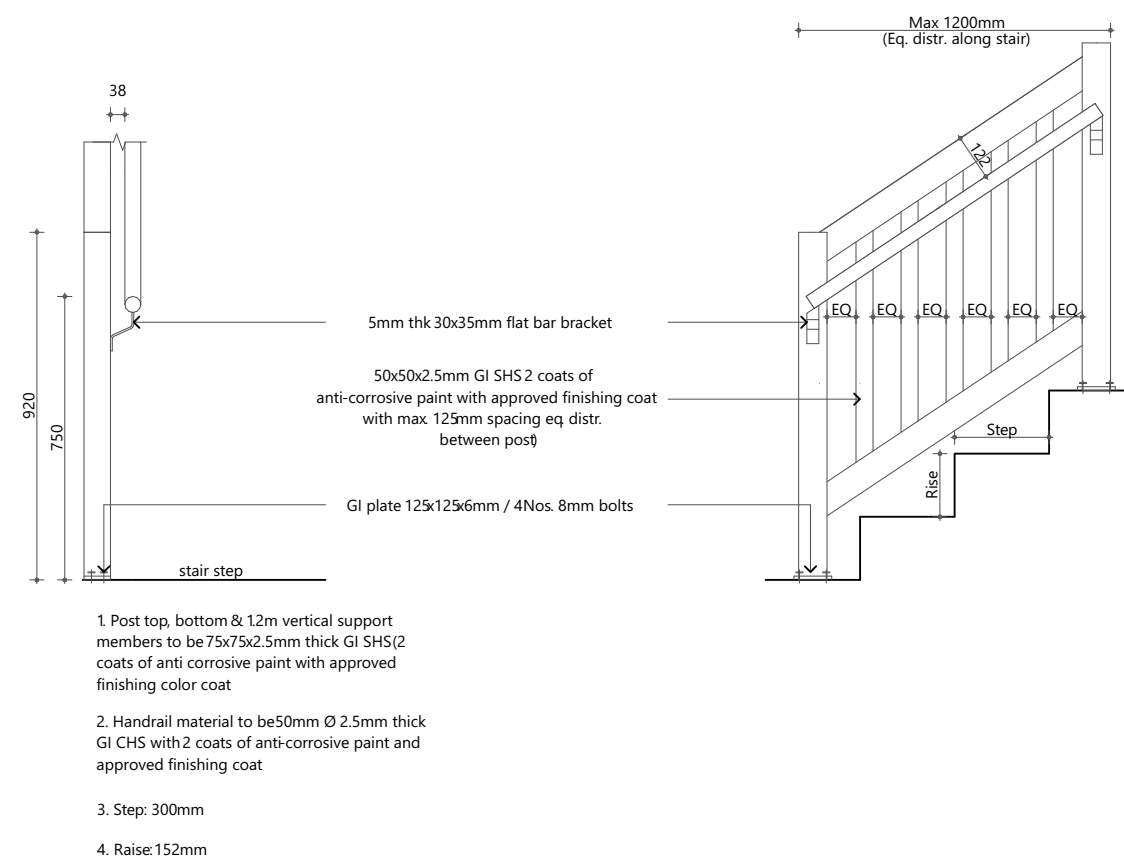

Stair Railing Detail  
1:20

Overview :



Legend :

Notes :

#	REVISION	BY	APP	DATE

Project :

Ha Kelaa 12 Classroom Sen  
Room and Office Building

Client :

Ministry of Education, Maldives

Prepared by



T: +960 333 3528, E: info@epochassociates,  
W: www.epochassociates, A/G Rosony West, 3<sup>rd</sup>  
Floor, Husnuheena Magu, Male', Maldives

DESIGNER: Muaviyath A. Sathar	CHECKED: F. Ihudha Amir
DRAWN: Mohamed Hassan	APPROVED: Ihsaan Waheed

Page Title

Balcony, Stair & Ramp Details

Scale : 1:20, 1:50


Doc No : EP/BLD-AR/2022/08/AR-104

Date : Wednesday, March 15,  
2023


Rev No :

Pg : C.015



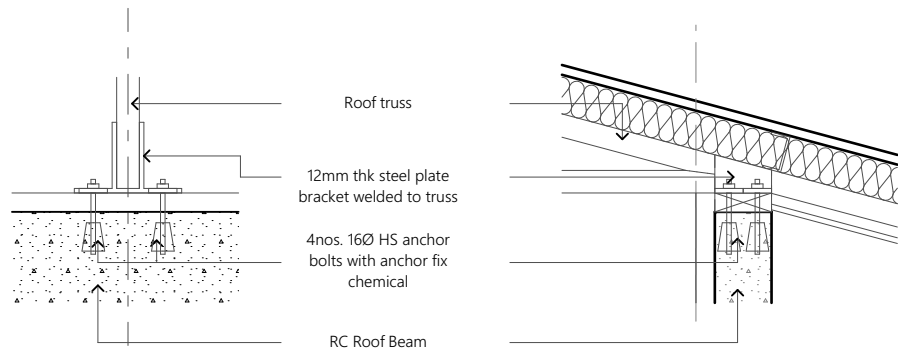


Truss Fixing Detail  
1:20

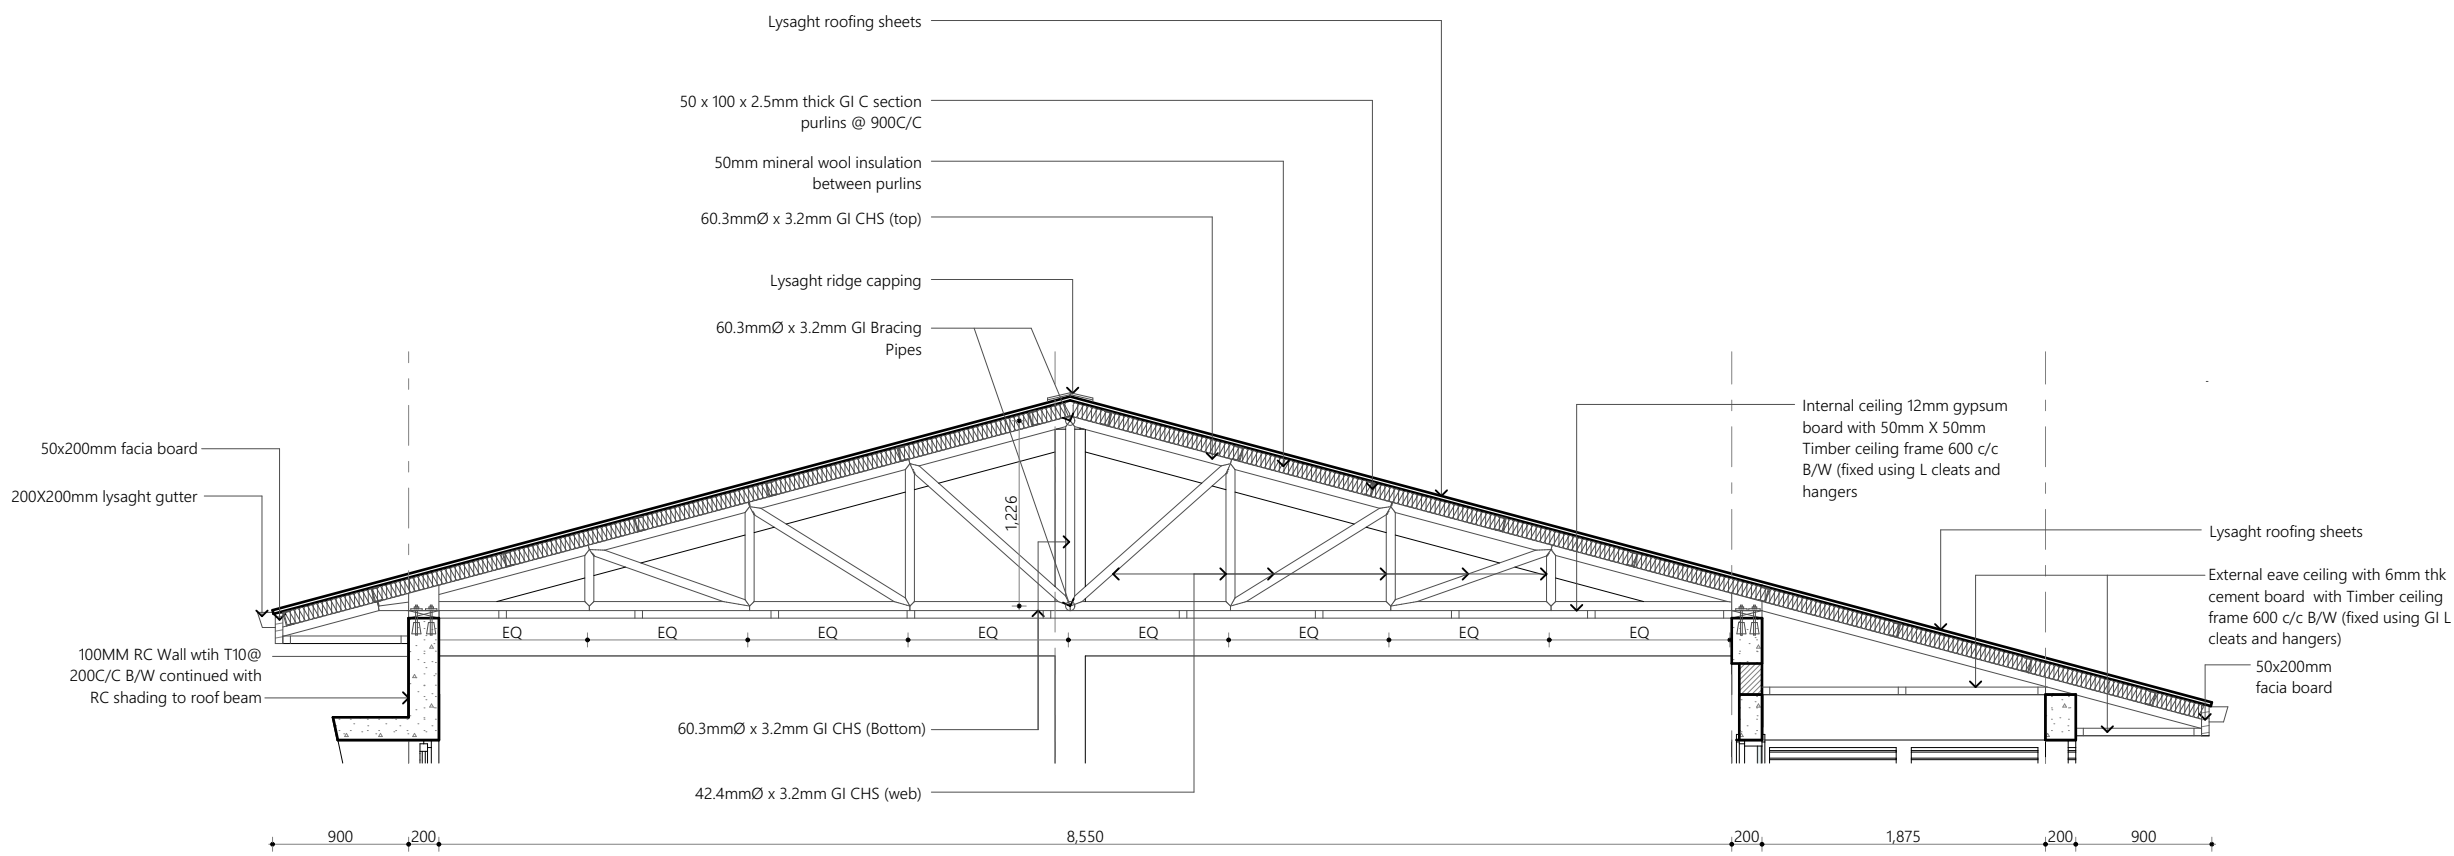

Truss Detail D-01  
1:50

Overview :



Legend :

Notes :

#	REVISION	BY	APP'D DATE

Project :

Ha Kelaa 12 Classroom Sen  
Room and Office Building

Client :

Ministry of Education, Maldives

Prepared by



T: +960 333 3528, E: info@epochassociates,  
W: www.epochassociates, A/G Rosary West, 3<sup>rd</sup>  
Floor, Husnuheena Magu, Male', Maldives

DESIGNER: Muaviyath A. Sathar	CHECKED: F. Ihudha Amir
DRAWN: Mohamed Hassan	APPROVED: Ihsaan Waheed

Page Title

Truss Detail

Scale : 1:50, 1:20


Doc No : EP/BLD-AR/2022/08/AR-104  
Date : Wednesday, March 15,  
2023

Rev No :


Pg : C.01.6

Notes:


All the CHS shall have minimum yield stress of 275MPa  
All welds shall be 6mm thick full parameter fillet welds  
All truss ends shall be capped with 6mm plates  
All truss members shall be protected with anti corrosive coatings

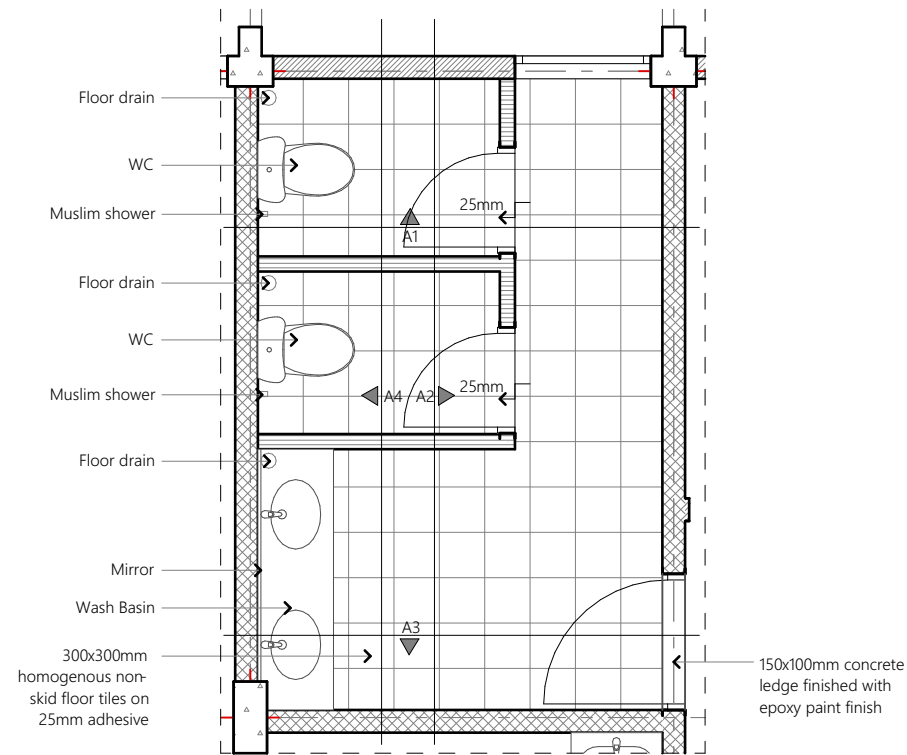


Toilet Plan (Male and Female)  
1:50

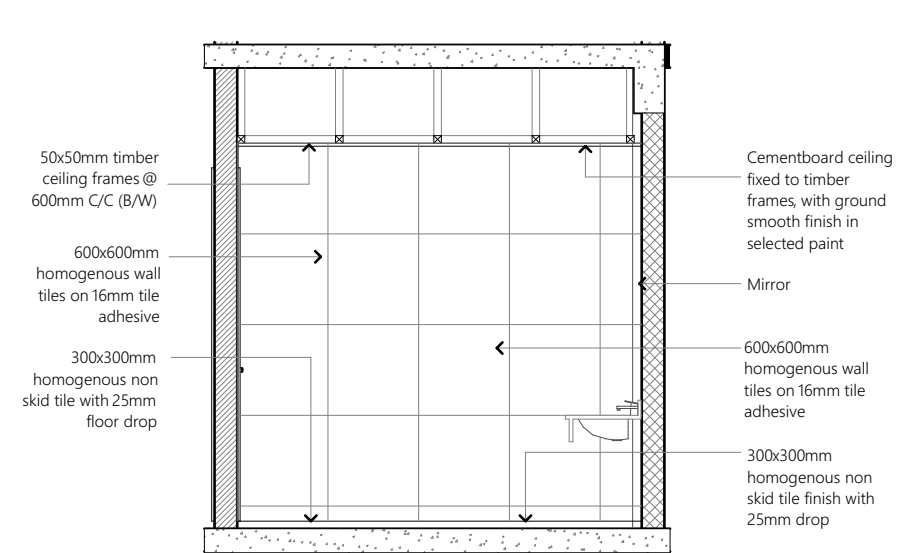


A3  
1:50

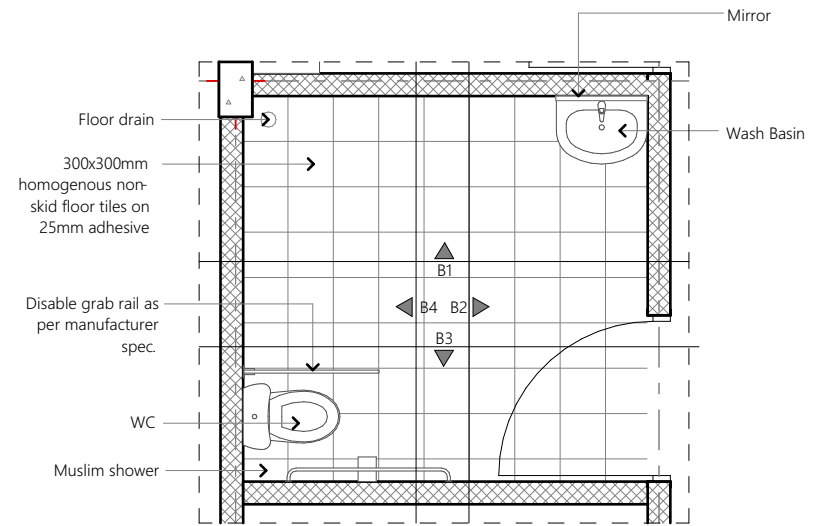


Disable Toilet Floor Plan  
1:50

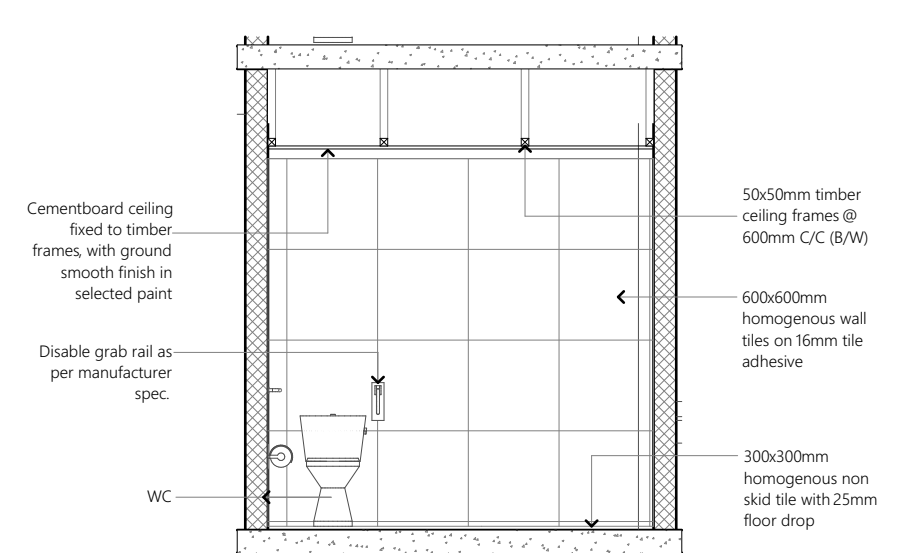


Elevation B 4  
1:50

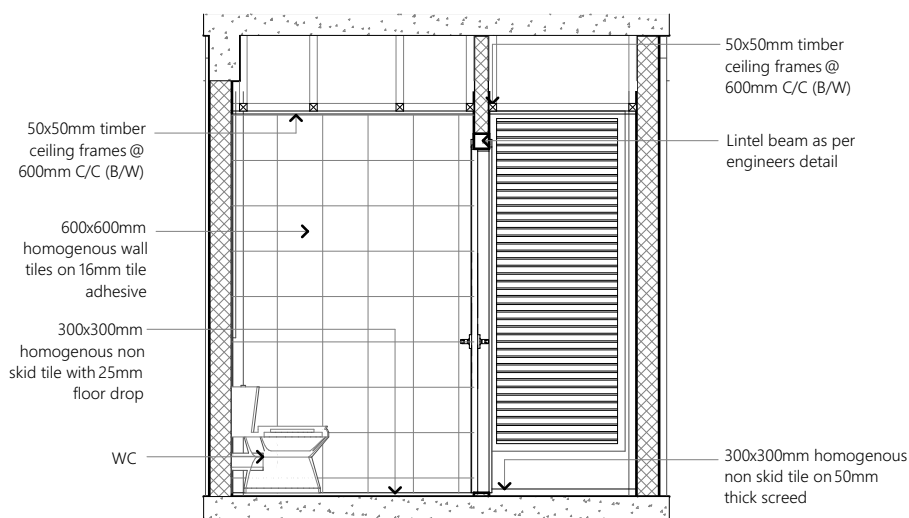


A1  
1:50

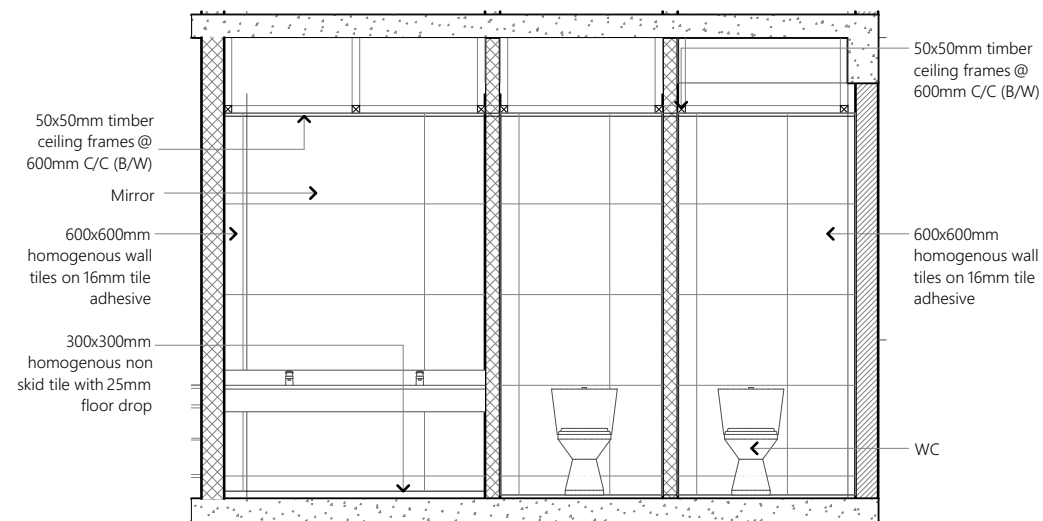


A4  
1:50

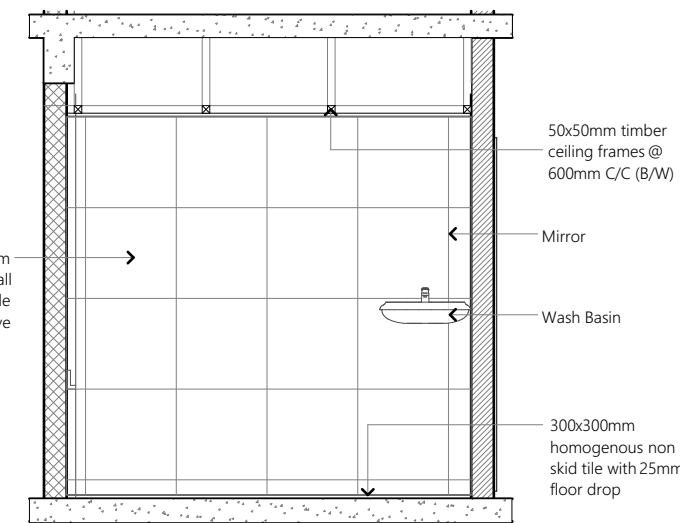


Elevation B 1  
1:50

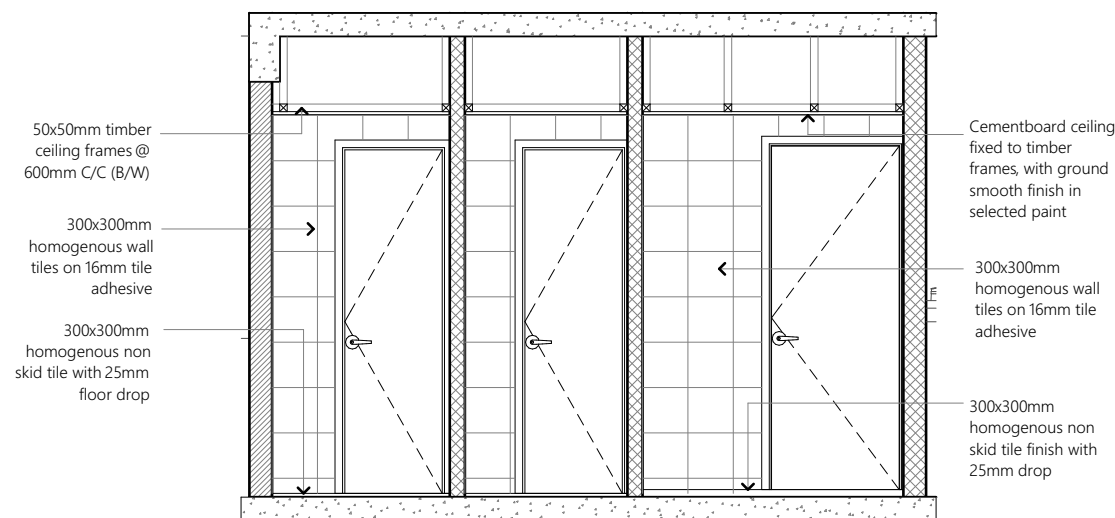

A2  
1:50

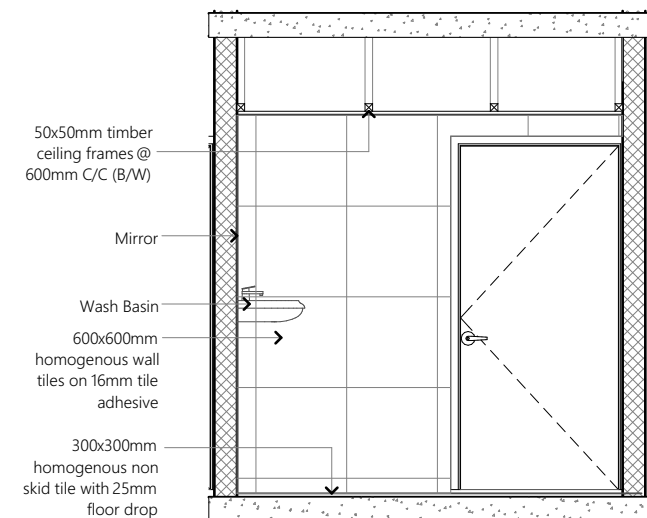


Elevation B 2  
1:50

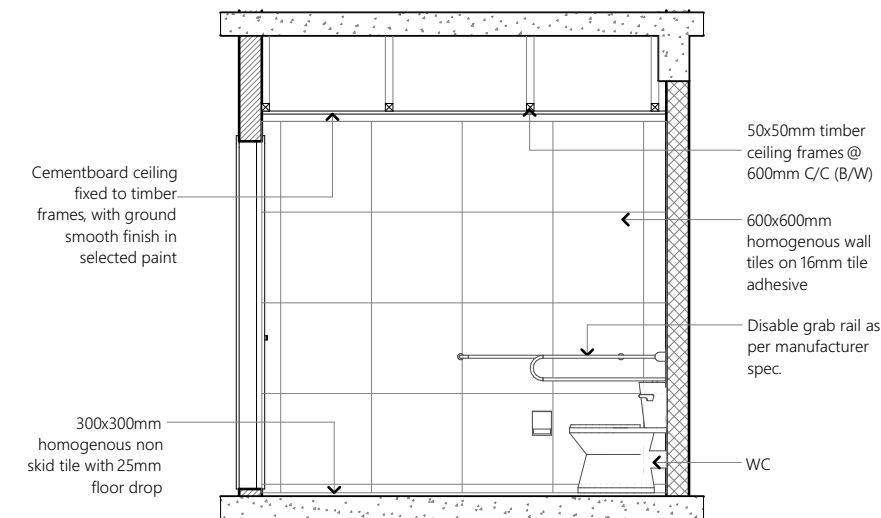

Elevation B 3  
1:50

Overview :



Legend :

Notes :

#	REVISION	BY	APP	DATE

**Project :**  
Ha Kelaa 12 Classroom Sen  
Room and Office Building

**Client :**  
Ministry of Education, Maldives

**Prepared by**



T: +960 333 3528, E: info@epochassociates,  
W: www.epochassociates, A/G Rosary West, 3<sup>rd</sup>  
Floor, Husnuheena Magu, Male', Maldives

DESIGNER: Muaviyath A. Sathar	CHECKED: F. Ihudha Amir
DRAWN: Mohamed Hassaan	APPROVED: Ihsaan Waheed

**Page Title**  
Toilet Details 1

**Scale :**

**Doc No :** EP/BLD-AR/2022/08/AR-104  
**Date :** Wednesday, March 15,  
2023

**Rev No :** **Pg :** C.01.7