


GRID NO:B7

- FIRE HYDRENT
- 25mm DIA SINGLE ORIFICE AIR VALVE
- 50mm DIA LARGE ORIFICE AIR VALVE
- 80mm DIA DOUBLE ORIFICE AIR VALVE
- SLUICE VALVE
- WASH OUT
- END CAP
- 63mm PIPE
- 90mm PIPE
- 110mm PIPE
- 160mm PIPE
- 225mm PIPE
- HOUSE CONNECTION

DIAMETER	DEPTH
63mm PIPE	0.9
90mm PIPE	1.1
110mm PIPE	1.2
160mm PIPE	1.2
225mm PIPE	1.3

PE PIPE

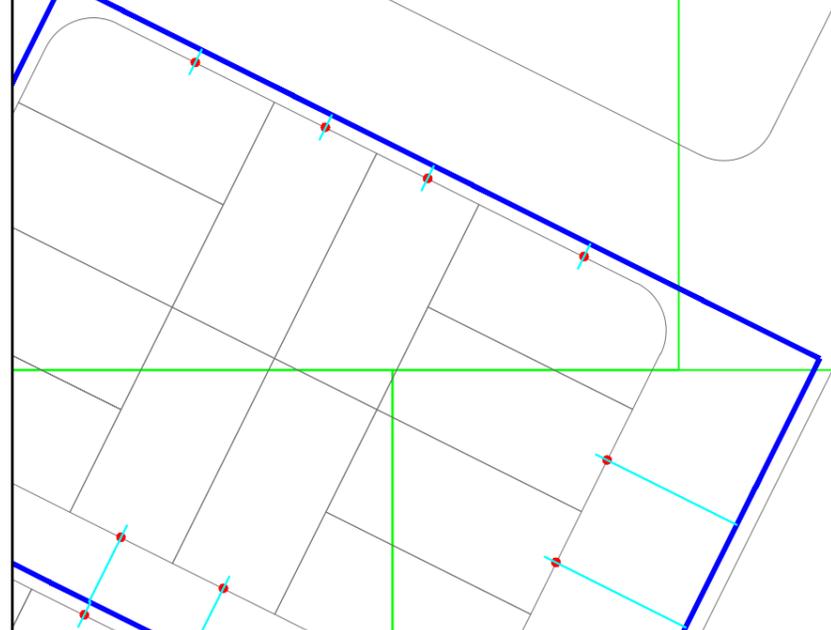

BALLAST BLOCK SURF ZONE-DIFFUSER

LVL ±0.00
MSL

116000

BALLAST BLOCK AT EVERY 3 MEATER

RO PLANT

<p>CLIENT: MINISTRY OF ENVIRONMENT AND ENERGY</p>	<p>CONSULTANCY SERVICES FOR DESIGN OF WATER SUPPLY FACILITIES IN Ha.HORAFUSHI, Hdh.HANIMAADHOO,Sh.MILANDHOO,R.UNGOOFAARU,Lh.NAIFARU,Dh,KUDAHUVADHOO ,Th.GURAI DHOO AND Ga.VILLINGILI , MALDIVES</p>	DESIGN	DRAWN	CHECKED	APPROVED	SL.NO	DRWING NO	DESCRIPTION
		ENGINEER		DESIGN CHIEF				
<p>GREENTECH CONSULTANTS (Pvt.) Ltd IN ASSOCIATION WITH DEVELOPMENT COLLABORATION PARTNERSHIP (Pvt.) Ltd MALDIVES AND OPTIMUM SOLOUTIONS (Pvt) Ltd, MALDIVES</p>	<p>TITLE: NAIFARU DISTRIBUTION SYSTEM</p>	DATE	DRG.NO: NAIFARU/DIST/13					
			SCALE: 1 : 500					