


D06-KUDAFARI

POWER HOUSE MAIN LV DISTRIBUTION BOARD

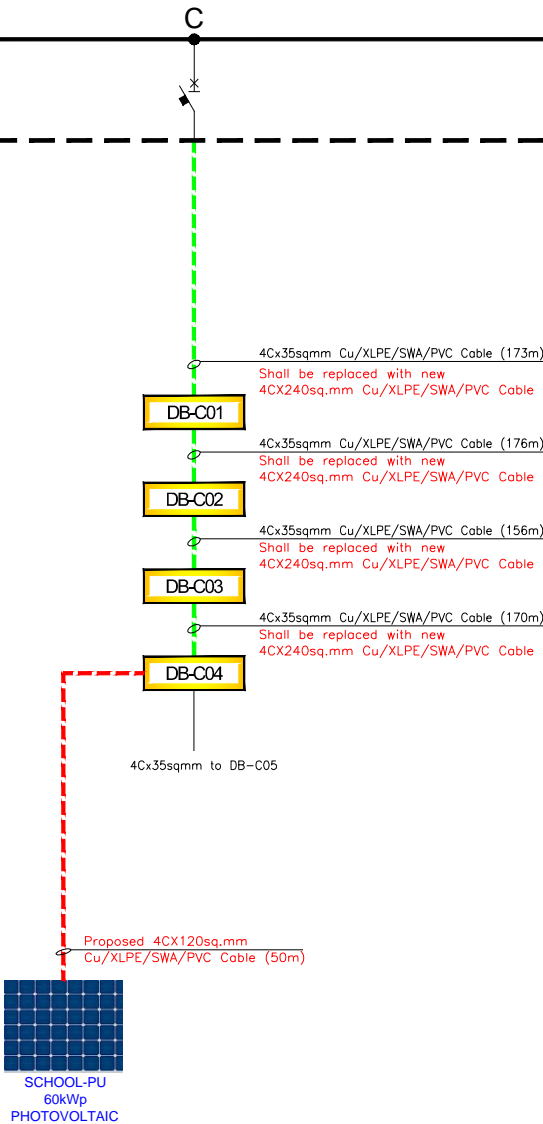

LEGEND:-

SYMBOL	DESCRIPTION	QUANTITY
	EXISTING Cable	-
	PROPOSED 120sq.mm Cu/XLPE/SWA/PVC Cable	50m
	PROPOSED 240sq.mm Cu/XLPE/SWA/PVC Cable	675m
	EXISTING DISTRIBUTION BOX	-
	PROPOSED DISTRIBUTION BOX	-
	EXISTING DISTRIBUTION BOX TO BE REPLACED	4 Nos.
	EXISTING DISTRIBUTION BOX TO BE MODIFIED	-

NOTES:-

- THESE DRAWINGS ARE PRELIMINARY AND ARE FOR TENDERING PURPOSES ONLY.
- CONTRACTOR SHALL CARRY OUT DETAILED SITE SURVEY AND ENGINEERING / STUDY TO EVALUATE AND PROPOSE THE EXTENT OF REPLACEMENT / MODIFICATION REQUIRED IN THE EXISTING DISTRIBUTION NETWORK. THIS IS SUBJECT TO REVIEW AND APPROVAL BY THE EMPLOYER DURING THE ENGINEERING PHASE OF THE PROJECT.

	PURPOSE OF SUBMISSION	REV	AUTHORISED BY	DATE	DRAWING TITLE NETWORK DIAGRAM FOR D06-KUDAFARI		DESIGN : ESM	SCALE : N.T.S
	FIRST REVISION	A	SWK	17/07/16			DRAWN : DAI	DRW NO. : J431-GOPA-056-GR-E-D-0001-REV.B
		B	A.M	20/12/16	PROJECT PREPARING OUTER ISLANDS SUSTAINABLE DEVELOPMENT	CLIENT: GOVERNMENT OF THE REPUBLIC OF MALDIVES	LICENCE NO:	ISLAND NAME : KUDAFARI
							DATE: : 17JULY16	PAGE : 1/1