


E01-ALIFUSHI

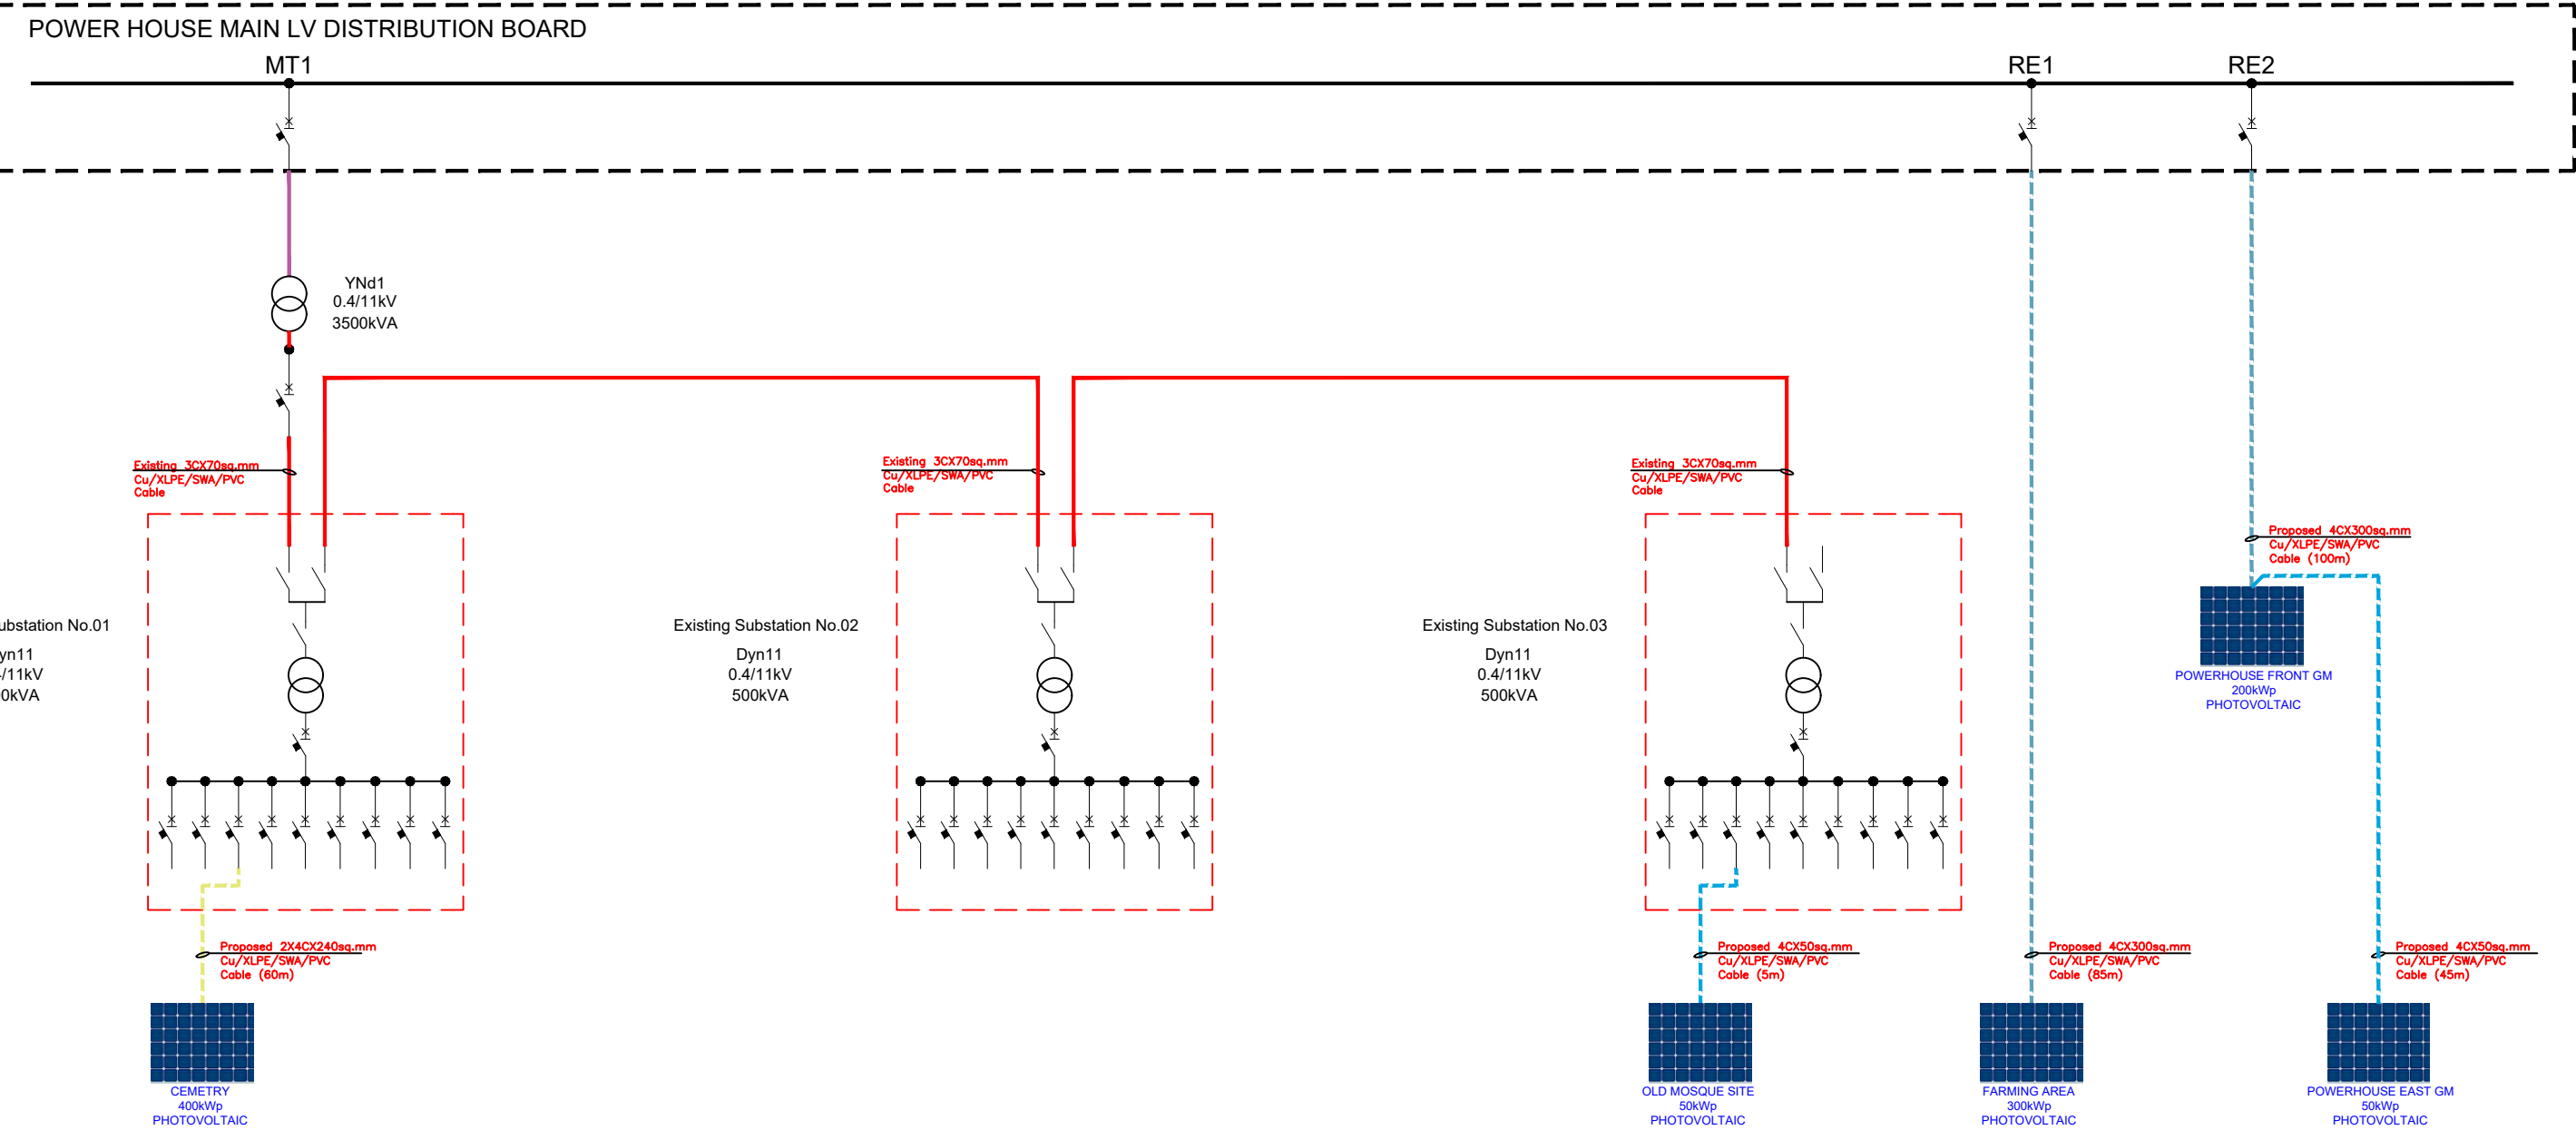

LEGEND:-

SYMBOL	DESCRIPTION	QUANTITY
<div></div>	PROPOSED 35sq.mm Cu/XLPE/SWA/PVC Cable	-
<div></div>	PROPOSED 50sq.mm Cu/XLPE/SWA/PVC Cable	50m
<div></div>	PROPOSED 95sq.mm Cu/XLPE/SWA/PVC Cable	-
<div></div>	PROPOSED 120sq.mm Cu/XLPE/SWA/PVC Cable	-
<div></div>	PROPOSED 185sq.mm Cu/XLPE/SWA/PVC Cable	-
<div></div>	PROPOSED 240sq.mm Cu/XLPE/PVC Cable	120m
<div></div>	PROPOSED 300sq.mm Cu/XLPE/PVC Cable	185m
<div></div>	PROPOSED 3Cx70sq.mm 11kV Cable	-
D/B	EXISTING DISTRIBUTION BOX	-
D/B	EXISTING DISTRIBUTION BOX TO BE REPLACED	-

NOTES:-

- THESE DRAWINGS ARE PRELIMINARY AND ARE FOR TENDERING PURPOSES ONLY.
- CONTRACTOR SHALL CARRY OUT DETAILED SITE SURVEY AND ENGINEERING / STUDY TO EVALUATE AND PROPOSE THE EXTENT OF REPLACEMENT / MODIFICATION REQUIRED IN THE EXISTING DISTRIBUTION NETWORK. THIS IS SUBJECT TO REVIEW AND APPROVAL BY THE EMPLOYER DURING THE ENGINEERING PHASE OF THE PROJECT.

	PURPOSE OF SUBMISSION	REV	AUTHORISED BY	DATE	DRAWING TITLE GRID MODIFICATION DIAGRAM FOR E01-ALIFUSHI FOR PV INTEGRATION		DESIGN : PMU	SCALE : N.T.S
							DRAWN : PMU	DRW NO. : E01-ALIFUSHI-AS-GR
					PROJECT ASSURE - ADB FUNDED	CLIENT: GOVERNMENT OF THE REPUBLIC OF MALDIVES	LICENCE NO:	ISLAND NAME : ALIFUSHI
							DATE: : 04MAY2024	PAGE : 1