


N03-MADIFUSHI

POWER HOUSE MAIN LV DISTRIBUTION BOARD

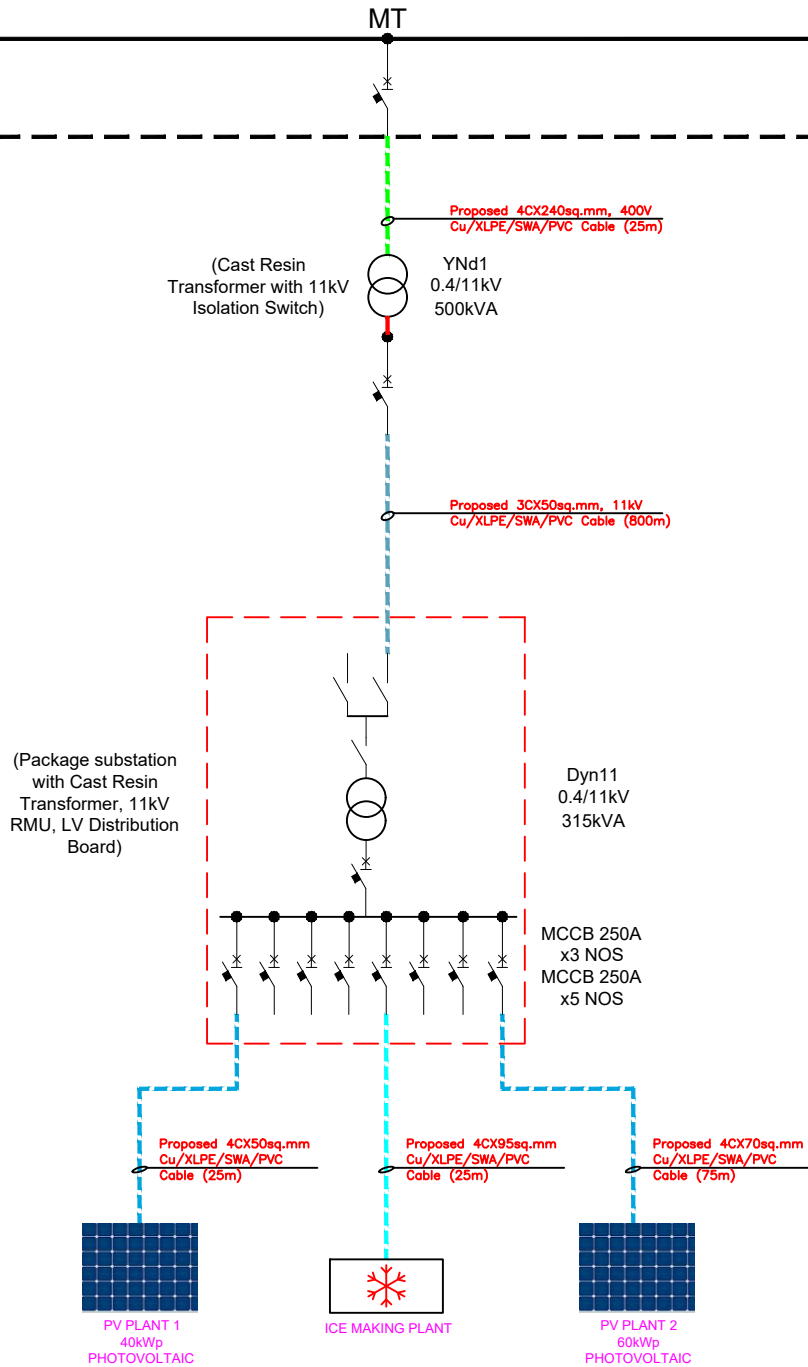

LEGEND:-

SYMBOL	DESCRIPTION	QUANTITY
————	EXISTING Cable	-
-----	PROPOSED 35sq.mm Cu/XLPE/SWA/PVC Cable	-
-----	PROPOSED 50sq.mm Cu/XLPE/SWA/PVC Cable	25m
-----	PROPOSED 70sq.mm Cu/XLPE/SWA/PVC Cable	75m
-----	PROPOSED 95sq.mm Cu/XLPE/SWA/PVC Cable	25m
-----	PROPOSED 120sq.mm Cu/XLPE/SWA/PVC Cable	-
-----	PROPOSED 150sq.mm Cu/XLPE/SWA/PVC Cable	-
-----	PROPOSED 185sq.mm Cu/XLPE/SWA/PVC Cable	-
-----	PROPOSED 240sq.mm Cu/XLPE/SWA/PVC Cable	25m
-----	PROPOSED 3C x 50sq.mm 11kV Cable	800m
	500kVA, YNd1, 0.4/11kV Step-up transformer	1 Nos.
	315kVA Package Substation	1 Nos.

	PURPOSE OF SUBMISSION	REV	AUTHORISED BY	DATE	DRAWING TITLE NETWORK MODIFICATION DIAGRAM FOR N03—MADIFUSHI		DESIGN : MARSOOM	SCALE : N.T.S
	FIRST REVISION	A		14OCT21			DRAWN : MARSOOM	DRW NO. : G409—THAA—N03—SLD—1
					PROJECT PREPARING OUTER ISLANDS SUSTAINABLE DEVELOPMENT	CLIENT: GOVERNMENT OF THE REPUBLIC OF MALDIVES	LICENCE NO:	ISLAND NAME : MADIFUSHI
							DATE: : 14OCT2021	PAGE : 1